


Area
INDEPENDENCE
Machine Id
Unit 05 DB200105E
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)

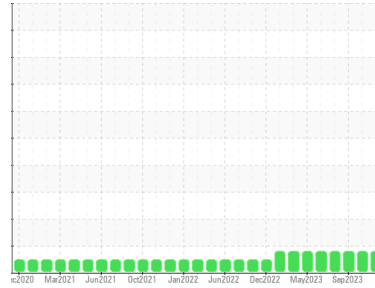

DIAGNOSIS

- Recommendation**
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
Light fuel dilution occurring.
- Fluid Condition**
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0097022	PCA0097025	PCA0097027
Sample Date	Client Info	05 Dec 2023	12 Oct 2023	07 Sep 2023
Machine Age	hrs	2584	2259	2088
Oil Age	hrs	2584	2259	2088
Oil Changed	Client Info	Not Chngd	Not Chngd	Not Chngd
Sample Status		MARGINAL	MARGINAL	MARGINAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	9	8	9
Chromium	ppm ASTM D5185m >4	<1	<1	<1
Nickel	ppm ASTM D5185m >2	0	0	0
Titanium	ppm ASTM D5185m	0	0	0
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >9	2	<1	<1
Lead	ppm ASTM D5185m >30	2	<1	2
Copper	ppm ASTM D5185m >35	2	3	2
Tin	ppm ASTM D5185m >4	<1	<1	<1
Vanadium	ppm ASTM D5185m	0	0	<1
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	5	4	5
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	4	3	4
Manganese	ppm ASTM D5185m	0	0	<1
Magnesium	ppm ASTM D5185m	868	785	978
Calcium	ppm ASTM D5185m	1039	958	1138
Phosphorus	ppm ASTM D5185m	983	924	1096
Zinc	ppm ASTM D5185m	1220	1070	1360
Sulfur	ppm ASTM D5185m	3155	2467	3674

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >+100	4	5	6
Sodium	ppm ASTM D5185m	<1	4	5
Potassium	ppm ASTM D5185m >20	1	0	<1
Fuel	% ASTM D3524 >4.0	▲ 3.1	▲ 2.9	▲ 3.1

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0	0	0.1
Nitration	Abs/cm *ASTM D7624 >20	4.5	4.4	4.6
Sulfation	Abs/.1mm *ASTM D7415 >30	13.4	13.4	13.0

FLUID DEGRADATION


method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	7.3	7.2	6.7
Acid Number (AN)	mg KOH/g ASTM D8045	1.07	1.24	1.18
Base Number (BN)	mg KOH/g ASTM D2896 8.5	8.45	7.65	8.46

OIL ANALYSIS REPORT


Fuel Dilution

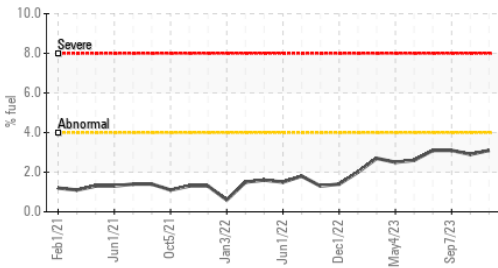


Acid Number

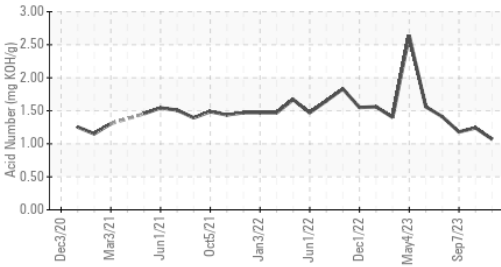

Base Number

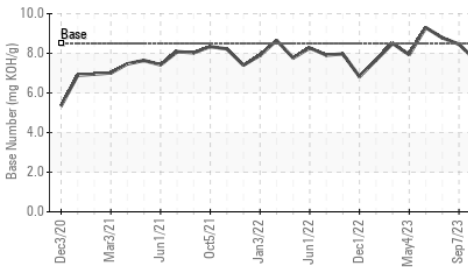

Viscosity @ 100°C

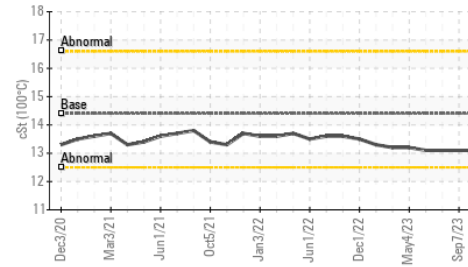

VISUAL


	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.1	13.1

GRAPHS


Iron (ppm)

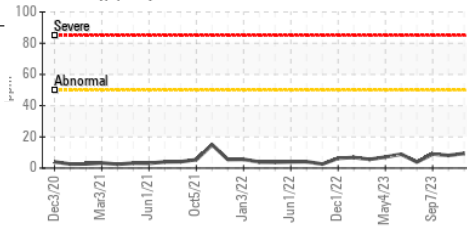


Lead (ppm)

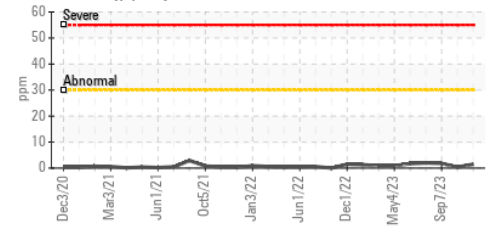


Aluminum (ppm)

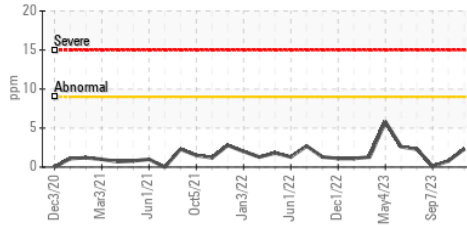


Chromium (ppm)

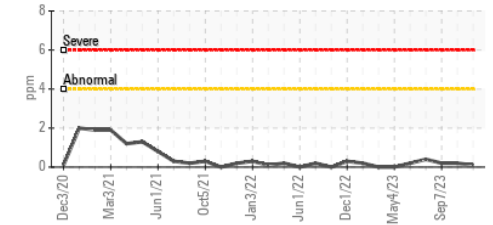


Copper (ppm)

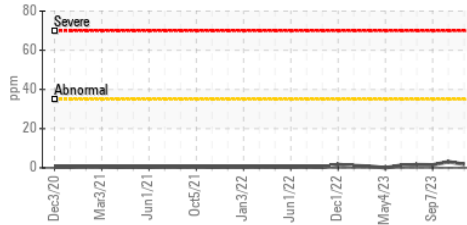


Silicon (ppm)

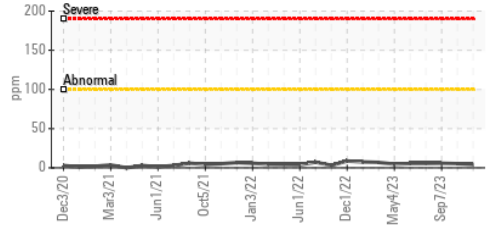

Viscosity @ 100°C

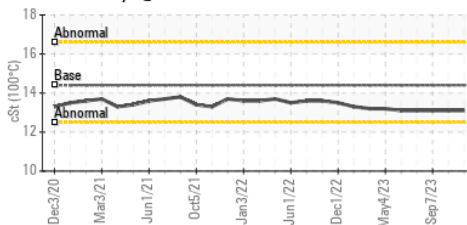

Base Number

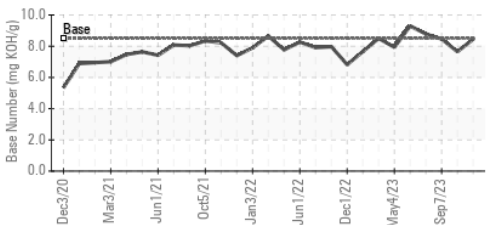

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0097022 **Received** : 06 Dec 2023
Lab Number : 06027200 **Diagnosed** : 14 Dec 2023
Unique Number : 10776991 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Magellan Midstream LP - Independence
 836 South Rosser Road
 Independence, KS
 US 67301
 Contact: Heath James
 heath.james@magellanlp.com
 T: (620)779-2040
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)