


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

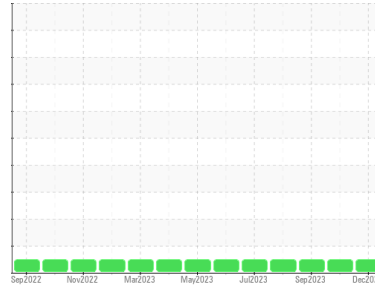

Machine Id
Copperhead Gap 2

Component
Compressor

Fluid
PETRO CANADA TURBOFLO R&O 150 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0111940	PCA0111859	PCA0103383
Sample Date	Client Info	01 Dec 2023	13 Nov 2023	06 Sep 2023
Machine Age	hrs Client Info	115416	1148806	1148806
Oil Age	hrs Client Info	115416	114580	114806
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<1	0	0
Chromium	ppm ASTM D5185m >10	<1	0	0
Nickel	ppm ASTM D5185m	<1	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >25	1	0	0
Lead	ppm ASTM D5185m >25	<1	0	0
Copper	ppm ASTM D5185m >50	<1	0	0
Tin	ppm ASTM D5185m >15	<1	<1	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	11	0	0
Molybdenum	ppm ASTM D5185m	<1	0	0
Manganese	ppm ASTM D5185m	0	0	0
Magnesium	ppm ASTM D5185m	0	0	0
Calcium	ppm ASTM D5185m 0	2	2	0
Phosphorus	ppm ASTM D5185m 4	28	8	4
Zinc	ppm ASTM D5185m 0	0	0	0
Sulfur	ppm ASTM D5185m	760	689	775




CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<1	0	0
Sodium	ppm ASTM D5185m	0	0	<1
Potassium	ppm ASTM D5185m >20	1	0	0

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.18	0.09	0.06	0.08

OIL ANALYSIS REPORT






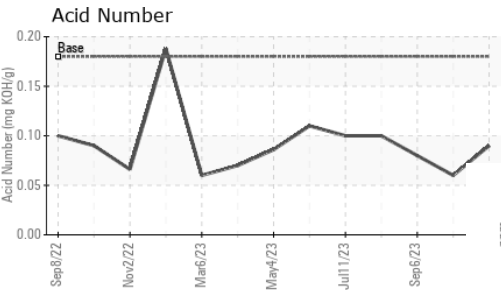
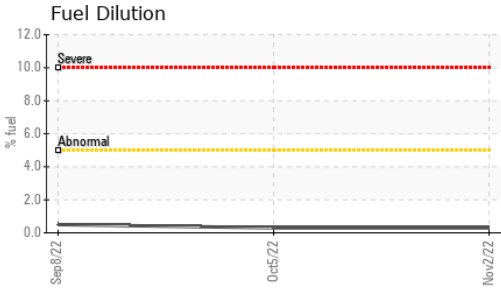
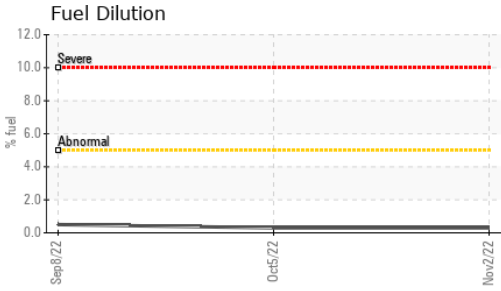


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	137.1	138	136

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

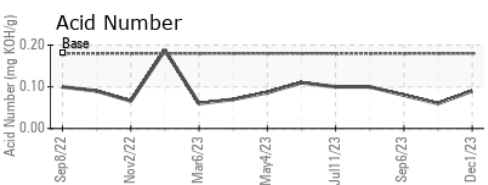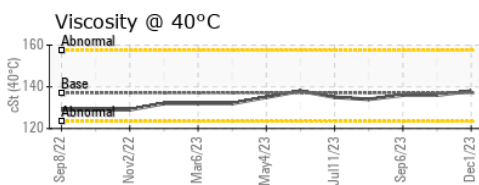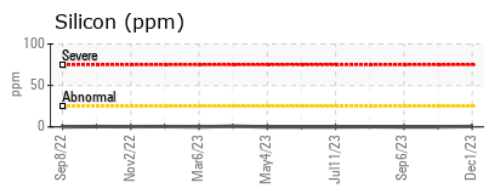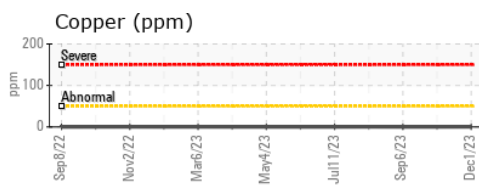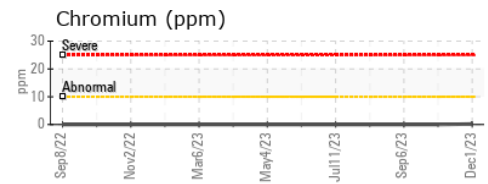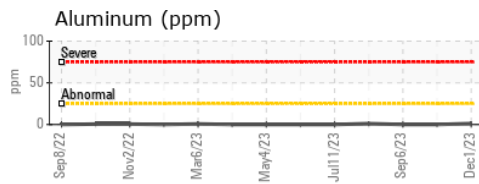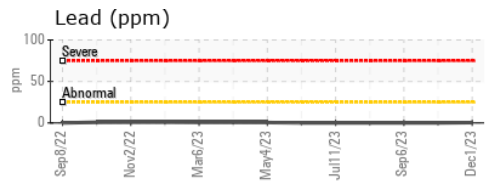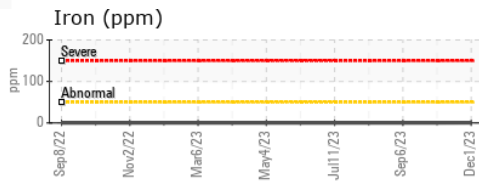

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111940 **Received** : 11 Dec 2023
Lab Number : 06031729 **Diagnosed** : 14 Dec 2023
Unique Number : 10781520 **Diagnostician** : Don Baldrige
Test Package : MOB 2 (Additional Tests: FuelDilution)

ENERVEST OPERATING - COPPERHEAD GAP
 3681 RABBIT RIDGE
 CLEVELAND, VA
 US 24225
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: