


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

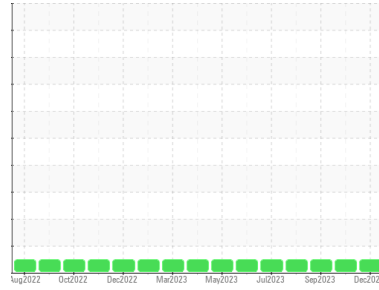

Machine Id  
**Nancy 2**

Component  
**Compressor**

Fluid  
**PETRO CANADA SENTRON LD 3000 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0111885</b>	PCA0111877	PCA0103473
Sample Date	Client Info			<b>01 Dec 2023</b>	07 Nov 2023	07 Sep 2023
Machine Age	hrs	Client Info		<b>159307</b>	158734	157295
Oil Age	hrs	Client Info		<b>37610</b>	37037	0
Oil Changed	Client Info			<b>Not Changed</b>	Not Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	2	3
Lead	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	1	<b>11</b>	0	0
Molybdenum	ppm	ASTM D5185m	2	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	1	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	5	<b>6</b>	11	4
Calcium	ppm	ASTM D5185m	1220	<b>1298</b>	1289	1343
Phosphorus	ppm	ASTM D5185m	298	<b>288</b>	275	264
Zinc	ppm	ASTM D5185m	350	<b>322</b>	328	314
Sulfur	ppm	ASTM D5185m	1995	<b>3302</b>	2623	3157

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	1	2
Sodium	ppm	ASTM D5185m		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	0	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.86	<b>0.45</b>	0.398	0.541

# OIL ANALYSIS REPORT






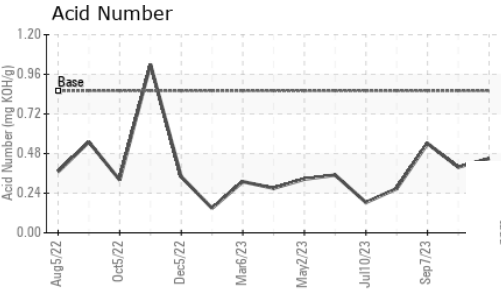
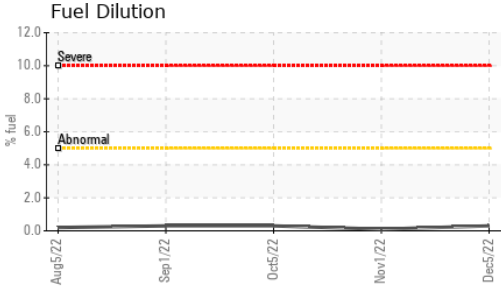
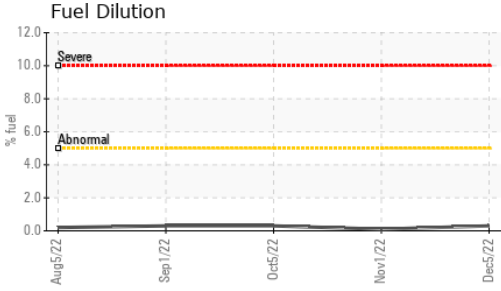


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	124.3	118	117

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

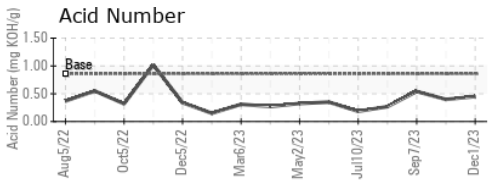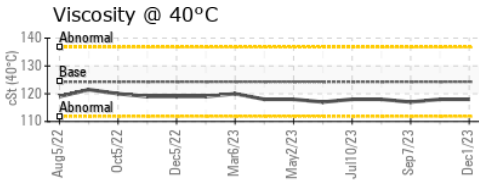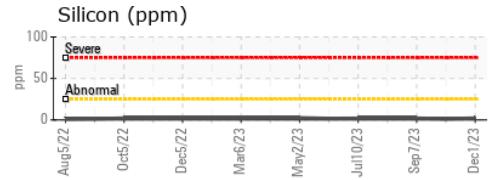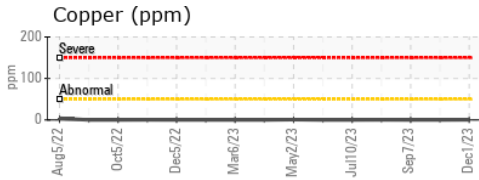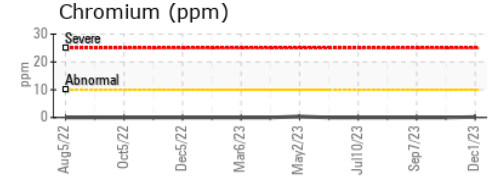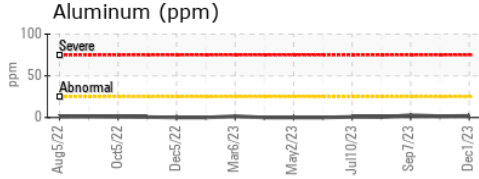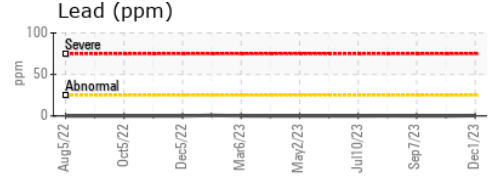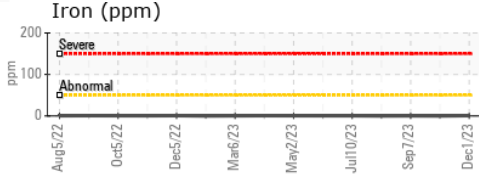

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0111885 **Received** : 11 Dec 2023  
**Lab Number** : 06031733 **Diagnosed** : 14 Dec 2023  
**Unique Number** : 10781524 **Diagnostician** : Don Baldrige  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution )

**ENERVEST OPERATING - NANCY**  
 2466 NANCY HOLLOW  
 HAYS, VA  
 US 24256  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: