

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 814048

Component Diesel Engine

Fluid PETRO CANADA DURON SHP 15W40 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Metal levels are typical for a new component breaking in.

Contamination

Elevated aluminum (AI) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

QTS)		Oct	2023	Nov2023 Dec20	23	
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0093591	GFL0093599	GFL0093611
Sample Date		Client Info		15 Dec 2023	22 Nov 2023	10 Oct 2023
Machine Age	hrs	Client Info		647	472	150
Oil Age	hrs	Client Info		647	472	150
Oil Changed		Client Info		Changed	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	43	53	36
Chromium	ppm	ASTM D5185m	>20	2	3	2
Nickel	ppm	ASTM D5185m	>4	<1	<1	1
Titanium	ppm	ASTM D5185m		15	<1	<1
Silver	ppm	ASTM D5185m	>3	0	0	<1
Aluminum	ppm	ASTM D5185m	>20	40	48	31
Lead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m	>330	14	19	16
Tin	ppm	ASTM D5185m	>15	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	<1	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	147	199	281
Barium	ppm	ASTM D5185m	0	<1	0	6
Molybdenum	ppm	ASTM D5185m	60	86	113	119
Manganese	ppm	ASTM D5185m	0	4	6	6
Magnesium	ppm	ASTM D5185m	1010	666	714	797
Calcium	ppm	ASTM D5185m	1070	1433	1492	1563
Phosphorus	ppm	ASTM D5185m	1150	739	655	791
Zinc	ppm	ASTM D5185m	1270	928	894	978
Sulfur	ppm	ASTM D5185m	2060	2601	2442	2855
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	19	23	25
Sodium	ppm	ASTM D5185m		3	3	<1
Potassium	ppm	ASTM D5185m	>20	108	130	80
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.4	0.3	0.1
Nitration	Abs/cm	*ASTM D7624	>20	8.9	9.1	6.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.5	24.1	21.9
FLUID DEGRA		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.6	19.7	16.0
Base Number (BN)	mg KOH/g	ASTM D2896	9.8	6.2	7.8	8.6




12


Abnorma

OIL ANALYSIS REPORT

VISUAL



50100mp

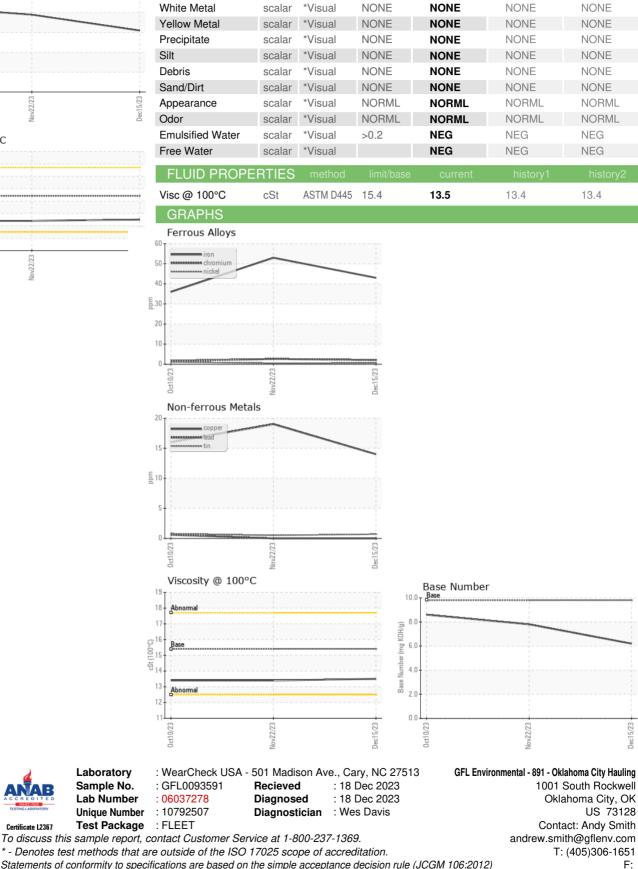

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Submitted By: Andy Smith