




# OIL ANALYSIS REPORT

Sample Rating Trend

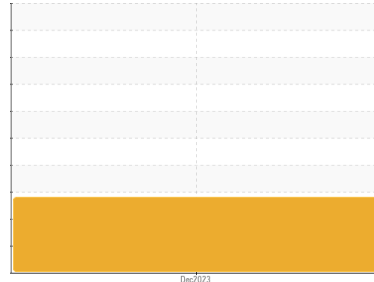

**WEAR**



Machine Id  
**SYSTEM 2 TOSIF W**

Component  
**Blower**  
Fluid  
**HYDROTEX Ultra-Kleen ISO 220 (1 GAL)**

## DIAGNOSIS

### ▲ Recommendation

We advise that you inspect for the source(s) of wear. Resample at the next service interval to monitor.

### ▲ Wear

The iron level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0110379</b>	---	---
Sample Date	Client Info			<b>20 Dec 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		▲ <b>111</b>	---	---
Iron	ppm	ASTM D5185m	>20	▲ <b>82</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>47</b>	---	---
Barium	ppm	ASTM D5185m		<b>1</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m		<b>2</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>11</b>	---	---
Calcium	ppm	ASTM D5185m		<b>11</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>238</b>	---	---
Zinc	ppm	ASTM D5185m		<b>59</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>4566</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m		<b>1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304		<b>NEG</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.28</b>	---	---

# OIL ANALYSIS REPORT

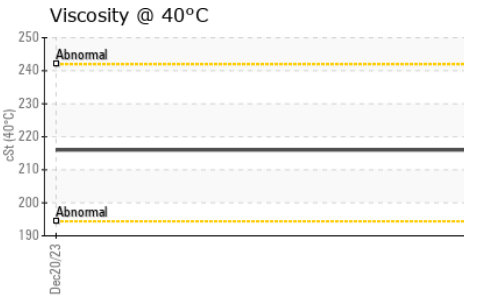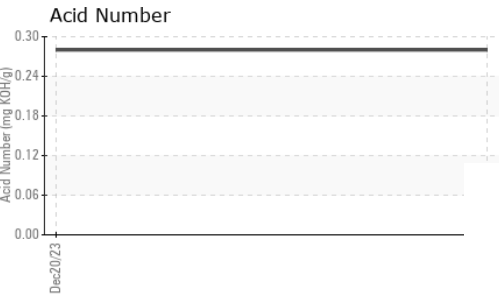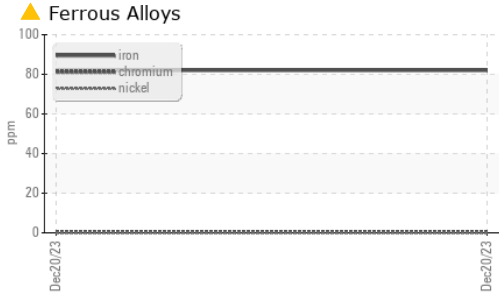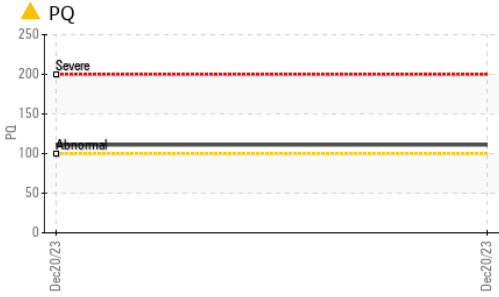





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	216	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

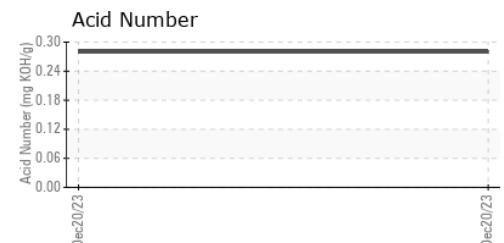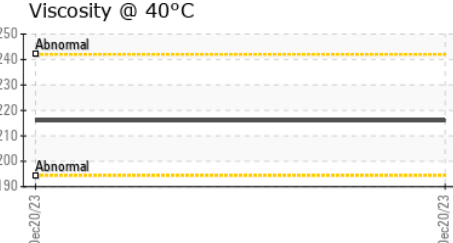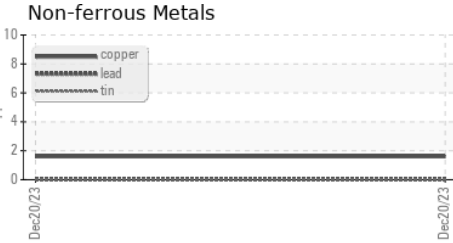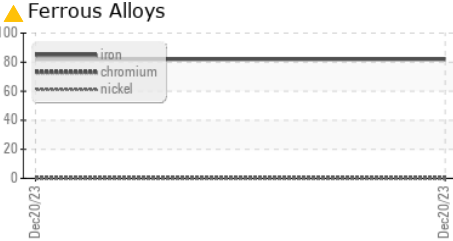

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0110379 **Recieved** : 26 Dec 2023  
**Lab Number** : 06044986 **Diagnosed** : 29 Dec 2023  
**Unique Number** : 10805594 **Diagnostician** : Angela Borella  
**Test Package** : PLANT

**Ardent Mills-Newton**  
 300 E BROADWAY  
 NEWTON, KS  
 US 67114

Contact: STEVEN GRABENDIKE  
 steven.grabendike@ardentmills.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: