

OIL ANALYSIS REPORT

Sample Rating Trend





Component Diesel Engine

Fluid

PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

AL)		Dec2021 Ma	r2023 May2023 May20	023 Aug2023 Oct2023 Nov20	23 Dec2023	
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0090935	GFL0103018	GFL0103008
Sample Date		Client Info		22 Dec 2023	07 Dec 2023	22 Nov 2023
Machine Age	hrs	Client Info		4649	4514	4376
Oil Age	hrs	Client Info		135	0	175
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	14	13	10
Chromium	ppm	ASTM D5185m	>20	1	1	1
Nickel	ppm	ASTM D5185m	>4	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	4	4	2
_ead	ppm	ASTM D5185m	>40	0	0	<1
Copper	ppm	ASTM D5185m		<1	<1	1
Tin	ppm	ASTM D5185m	>15	0	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm		0	7	4	3
Barium	ppm	ASTM D5185m		0	0	1
Volybdenum	ppm	ASTM D5185m	60	56	58	59
Vanganese	ppm	ASTM D5185m		<1	0	<1
Vagnesium	ppm	ASTM D5185m	1010	935	923	933
Calcium	ppm	ASTM D5185m	1070	1091	985	1047
Phosphorus	ppm	ASTM D5185m	1150	900	1024	1005
Zinc	ppm	ASTM D5185m	1270	1210	1213	1186
Sulfur	ppm	ASTM D5185m	2060	2812	3069	3181
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	4	4
Sodium	ppm	ASTM D5185m		3	4	1
Potassium	ppm	ASTM D5185m	>20	4	6	5
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.3	0.3	0.2
Nitration	Abs/cm	*ASTM D7624		6.9	6.5	5.7
Sulfation	Abs/.1mm	*ASTM D7415		18.9	18.7	18.0
FLUID DEGRA	DAT <u>ION</u>	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	14.8	14.4	13.7
Base Number (BN)	mg KOH/g	ASTM D7414	9.8	8.3	8.3	8.6
	ing KON/g	A0 IN D2030	0.0	0.0	0.0	0.0




Dec6/21-

Mar13/23

Vlav3/73

OIL ANALYSIS REPORT




Aug14/23

Nov22/23

Mav11/23

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.8	13.7	13.7
GRAPHS						
Ferrous Alloys						
	1					
Ferrous Alloys	1					
Ferrous Alloys	1					
Ferrous Alloys						
Ferrous Alloys						
Ferrous Alloys	L	$\overline{}$				
Ferrous Alloys	L					
Ferrous Alloys	May11/23 Aug14/23	0et25/23	Dec22/23			

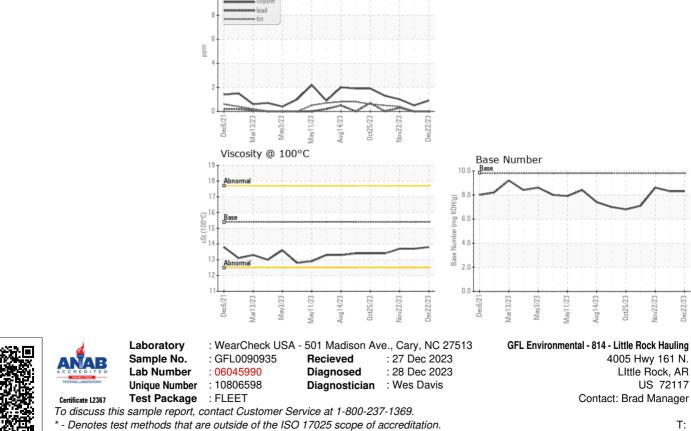

Non-ferrous Metals

10

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)