


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

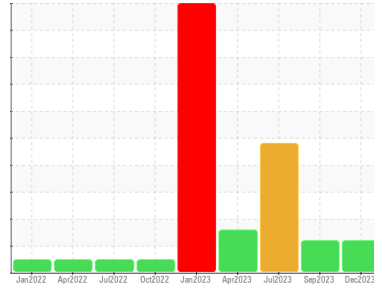

Area
INJECT B ROOM [98635795]
 Machine Id
KR-GF-003239 - INCLINE AUGER A NORTH (S/N INJECT B - 11513040)
 Component
Gearbox
 Fluid
PETRO CANADA 220 (9 QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: 98635795)

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0111165	PCA0106048	PCA0099334
Sample Date	Client Info		20 Dec 2023	22 Sep 2023	17 Jul 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		Not Chngd	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	SEVERE

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	NEG

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	8	8	▲ 433
Chromium	ppm	ASTM D5185m >15	0	0	2
Nickel	ppm	ASTM D5185m >15	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	0	1
Lead	ppm	ASTM D5185m >100	0	0	0
Copper	ppm	ASTM D5185m >200	0	<1	0
Tin	ppm	ASTM D5185m >25	0	0	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	<1





ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	2
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	5
Manganese	ppm	ASTM D5185m	<1	<1	2
Magnesium	ppm	ASTM D5185m	0	0	2
Calcium	ppm	ASTM D5185m	0	3	9
Phosphorus	ppm	ASTM D5185m	354	407	268
Zinc	ppm	ASTM D5185m	0	0	24
Sulfur	ppm	ASTM D5185m	3443	3909	13738

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	2	6
Sodium	ppm	ASTM D5185m	3	<1	2
Potassium	ppm	ASTM D5185m >20	1	0	0

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 111264	▲ 97232	---
Particles >6µm	ASTM D7647	>2500	▲ 8361	▲ 14240	---
Particles >14µm	ASTM D7647	>640	89	185	---
Particles >21µm	ASTM D7647	>160	20	34	---
Particles >38µm	ASTM D7647	>40	1	6	---
Particles >71µm	ASTM D7647	>10	0	6	---
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 24/20/14	▲ 24/21/15	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.45	0.45	---


OIL ANALYSIS REPORT

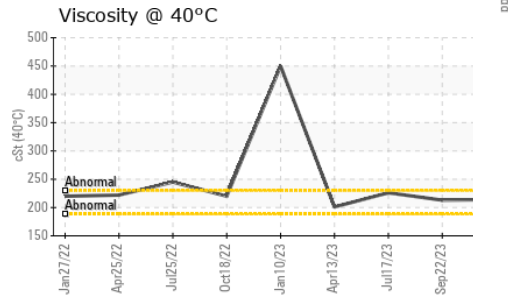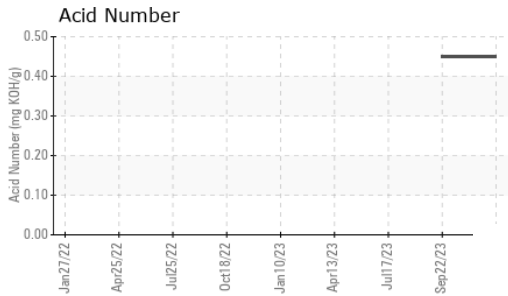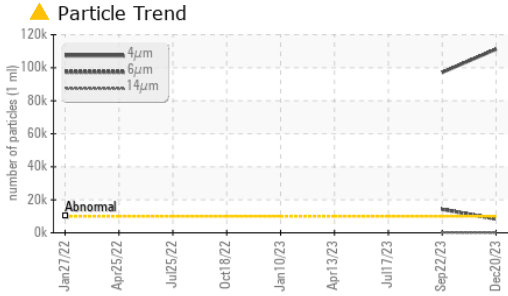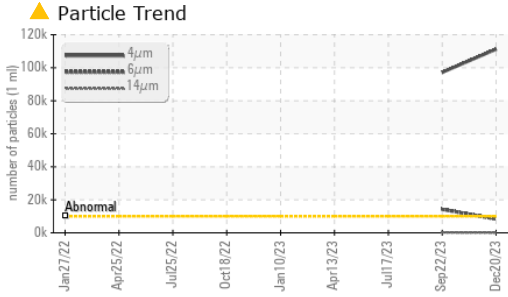





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	▲ HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	● 0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	214	213	226

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

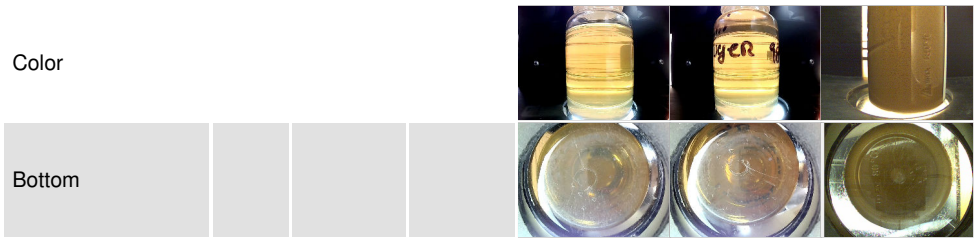

GRAPHS

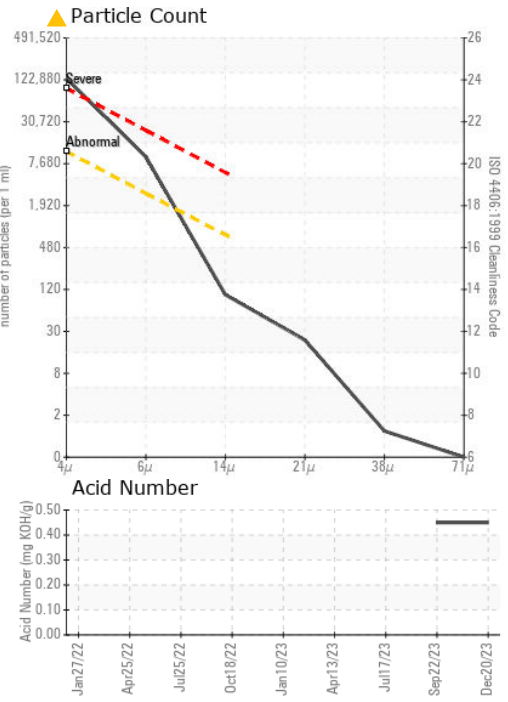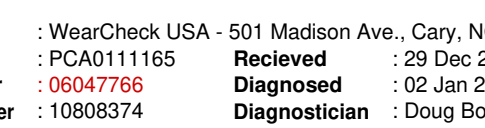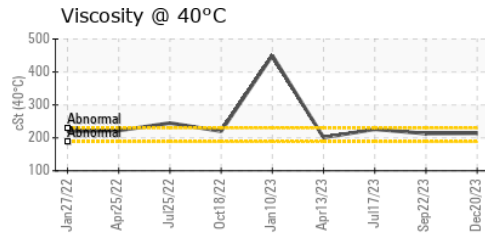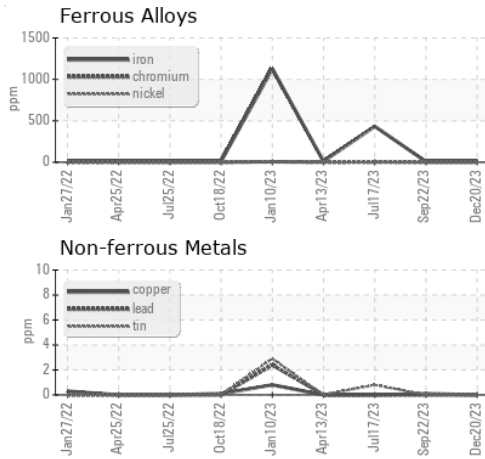

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111165 **Received** : 29 Dec 2023
Lab Number : 06047766 **Diagnosed** : 02 Jan 2024
Unique Number : 10808374 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Kirksville - Plant 8333 PCA
 2504 INDUSTRIAL DR
 KIRKSVILLE, MO
 US 63501
 Contact: WALLACE WARD
 wallace.ward@kraftheinzcompany.com
 T: (660)627-1031
 F: (660)627-5887

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)