


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

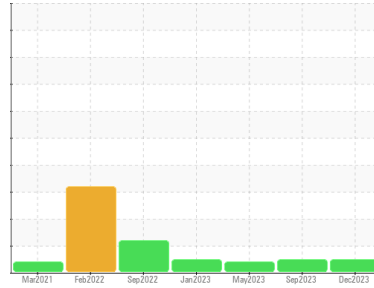

Machine Id  
**GRINDER AUTO LUBER 1**  
 Component  
**Bearing Lube**  
 Fluid  
**MOBIL DTE FM 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0113541</b>	PCA0099625	PCA0092048
Sample Date	Client Info	<b>29 Dec 2023</b>	08 Sep 2023	09 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >120	<b>1</b>	2	3
Chromium	ppm ASTM D5185m >5	<b>&lt;1</b>	0	0
Nickel	ppm ASTM D5185m >20	<b>&lt;1</b>	0	0
Titanium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >4	<b>2</b>	0	0
Lead	ppm ASTM D5185m >30	<b>&lt;1</b>	0	0
Copper	ppm ASTM D5185m >17	<b>&lt;1</b>	0	0
Tin	ppm ASTM D5185m >10	<b>&lt;1</b>	0	0
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>10</b>	0	2
Molybdenum	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm ASTM D5185m	<b>1</b>	<1	<1
Calcium	ppm ASTM D5185m	<b>5</b>	<1	0
Phosphorus	ppm ASTM D5185m	<b>601</b>	518	522
Zinc	ppm ASTM D5185m	<b>4</b>	<1	2
Sulfur	ppm ASTM D5185m	<b>627</b>	548	962

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm ASTM D5185m	<b>0</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	<1	<1

## FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>886</b>	1016	---
Particles >6µm	ASTM D7647 >2500	<b>277</b>	197	---
Particles >14µm	ASTM D7647 >640	<b>22</b>	16	---
Particles >21µm	ASTM D7647 >160	<b>5</b>	4	---
Particles >38µm	ASTM D7647 >40	<b>0</b>	0	---
Particles >71µm	ASTM D7647 >10	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c) >20/18/16	<b>17/15/12</b>	17/15/11	---

## FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.34</b>	0.33	0.36

# OIL ANALYSIS REPORT


## Particle Trend

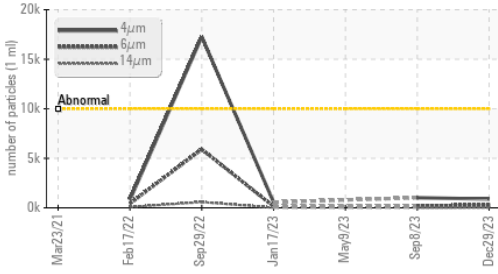


## Acid Number

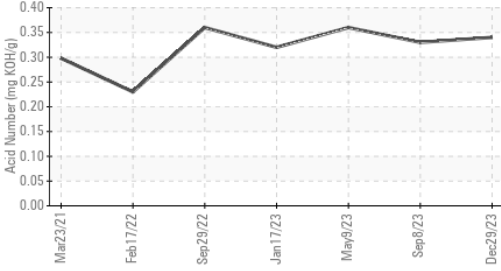

## Viscosity @ 40°C

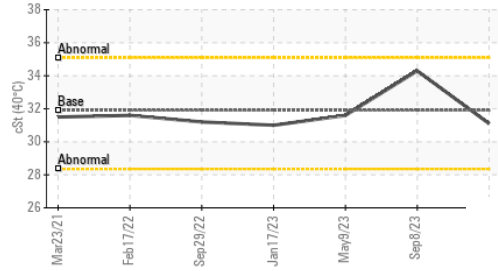

## Particle Trend

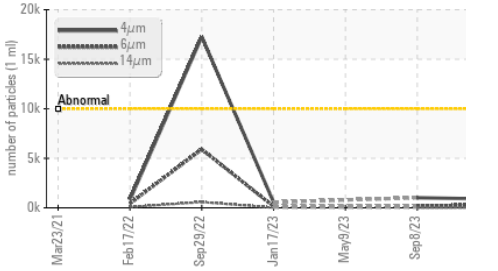


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.9	31.1	34.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color

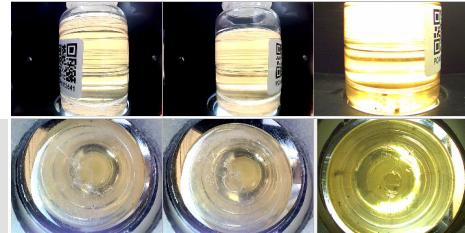


Bottom

## GRAPHS


### Ferrous Alloys

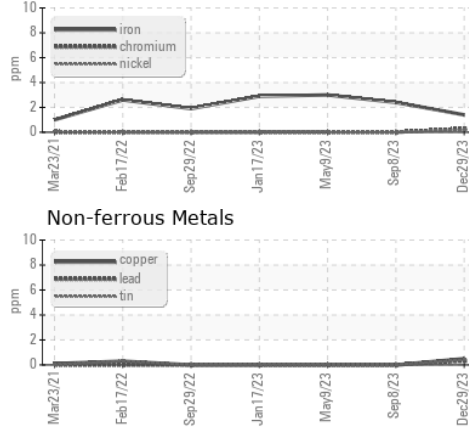


### Non-ferrous Metals

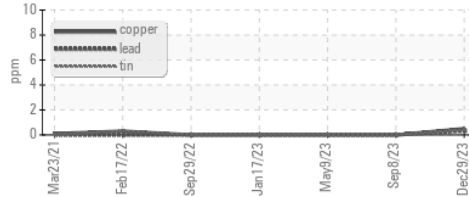


### Viscosity @ 40°C

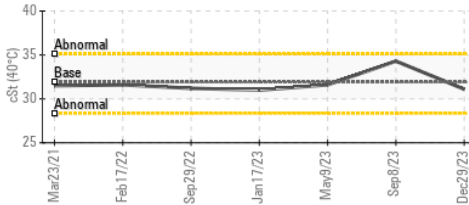

### Particle Count

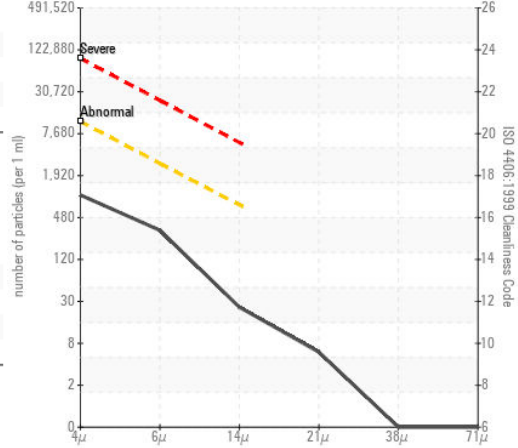

### Acid Number

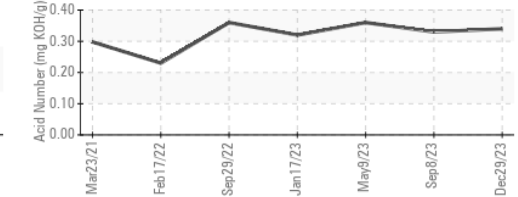

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0113541 **Received** : 04 Jan 2024  
**Lab Number** : 06050821 **Diagnosed** : 05 Jan 2024  
**Unique Number** : 10816770 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - New Ulm - Plant 8302**  
 2525 S BRIDGE STREET  
 NEW ULM, MN  
 US 56073  
 Contact: RYAN SCHMID  
 ryan.schmid@kraftheinz.com  
 T: (507)568-0338  
 F: (507)354-7927

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)