




Machine Id  
**#2 GRINDER MOTOR**

Component  
**Bearing**

Fluid  
**MOBIL CIBUS 68 (6 QTS)**

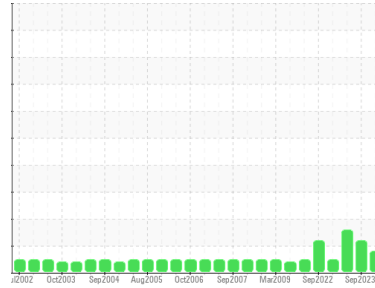

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0103606</b>	PCA0099624	PCA0092047
Sample Date	Client Info		<b>29 Dec 2023</b>	08 Sep 2023	09 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>1</b>	1	<1
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>10</b>	0	2
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>2</b>	<1	<1
Phosphorus	ppm	ASTM D5185m	<b>567</b>	442	524
Zinc	ppm	ASTM D5185m	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m	<b>556</b>	493	685

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	1

## FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 11990</b>	▲ 56853	---
Particles >6µm	ASTM D7647	>2500	<b>2058</b>	▲ 11251	---
Particles >14µm	ASTM D7647	>640	<b>70</b>	300	---
Particles >21µm	ASTM D7647	>160	<b>15</b>	49	---
Particles >38µm	ASTM D7647	>40	<b>1</b>	2	---
Particles >71µm	ASTM D7647	>10	<b>1</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>20/18/16	<b>▲ 21/18/13</b>	▲ 23/21/15	---

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.35</b>	0.28	0.40

# OIL ANALYSIS REPORT


▲ Particle Trend

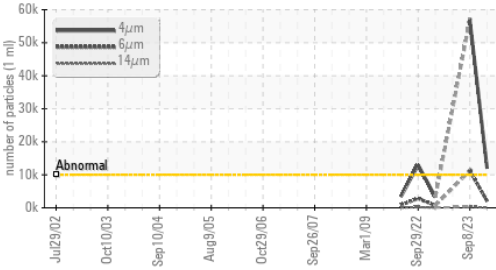


▲ Particle Trend

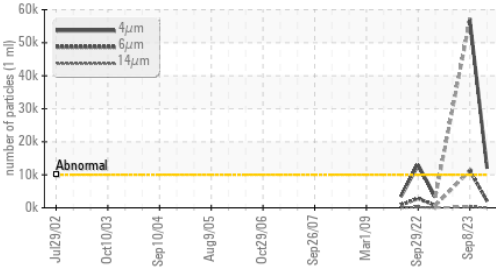

Acid Number

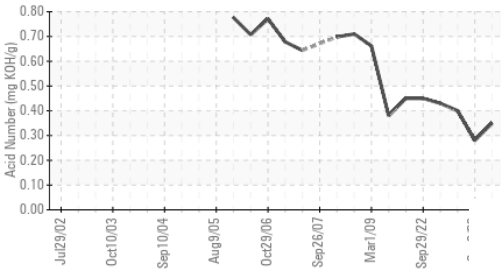

Viscosity @ 40°C

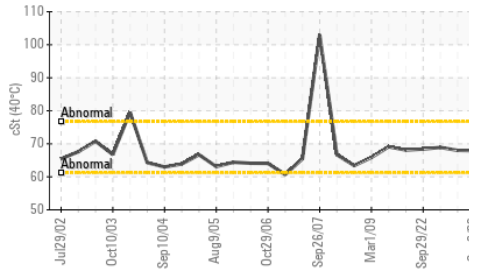

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	▲ MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	66.7	67.9	68.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------




## GRAPHS


Ferrous Alloys

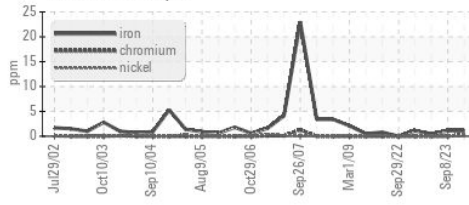


Non-ferrous Metals

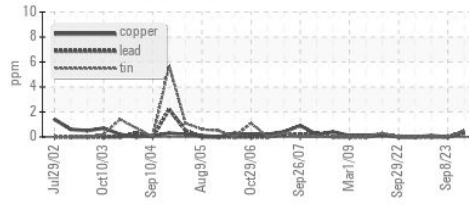


Viscosity @ 40°C

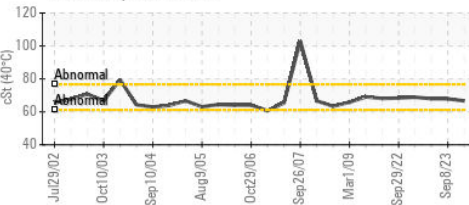

▲ Particle Count

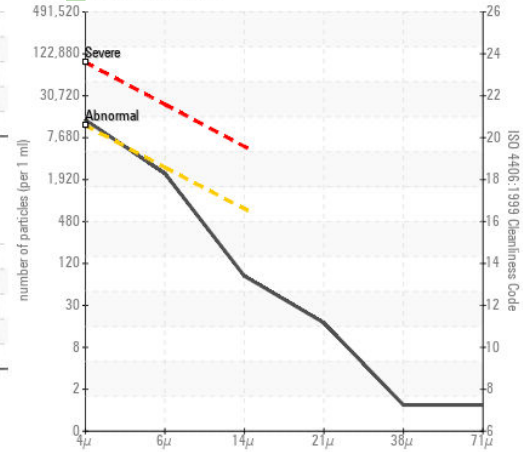

Acid Number

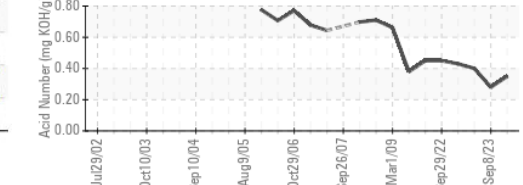

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0103606 **Received** : 04 Jan 2024  
**Lab Number** : 06050823 **Diagnosed** : 05 Jan 2024  
**Unique Number** : 10816772 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**KraftHeinz - New Ulm - Plant 8302**  
 2525 S BRIDGE STREET  
 NEW ULM, MN  
 US 56073  
 Contact: RYAN SCHMID  
 ryan.schmid@kraftheinz.com  
 T: (507)568-0338  
 F: (507)354-7927

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)