

# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**TANK 19 TANK 19**  
 Component  
**Gearbox**  
 Fluid  
**{not provided} (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0102815</b>	---	---
Sample Date	Client Info			<b>23 Dec 2023</b>	---	---
Machine Age	hrs	Client Info		<b>0</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	<b>NEG</b>	---	---





WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		<b>10</b>	---	---
Iron	ppm	ASTM D5185m	>200	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>416</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>436</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	<b>1427</b>	---	---
Particles >6µm		ASTM D7647	>5000	<b>777</b>	---	---
Particles >14µm		ASTM D7647	>640	<b>132</b>	---	---
Particles >21µm		ASTM D7647	>160	<b>45</b>	---	---
Particles >38µm		ASTM D7647	>40	<b>7</b>	---	---
Particles >71µm		ASTM D7647	>10	<b>1</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	<b>18/17/14</b>	---	---

# OIL ANALYSIS REPORT

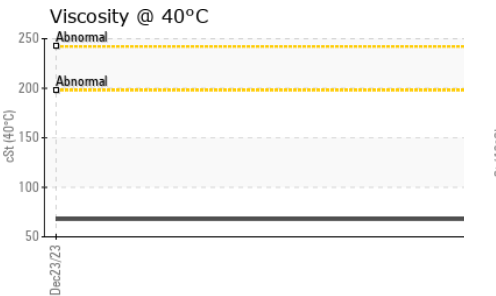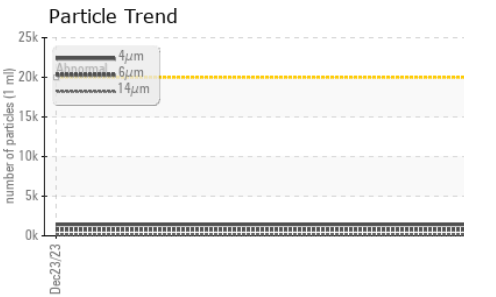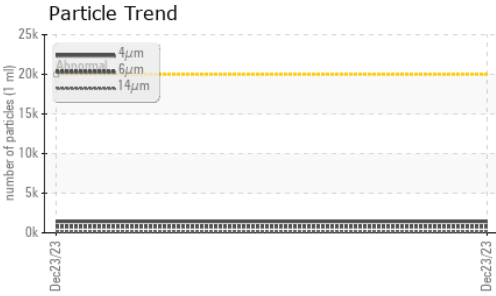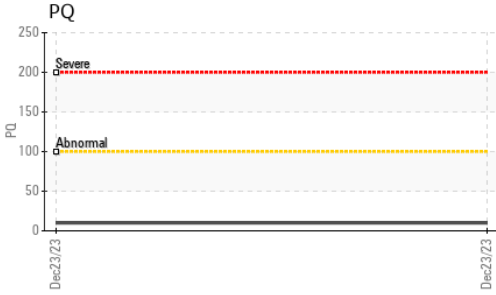

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.25</b>	---	---






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		<b>67.8</b>	---	---

### SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

### GRAPHS

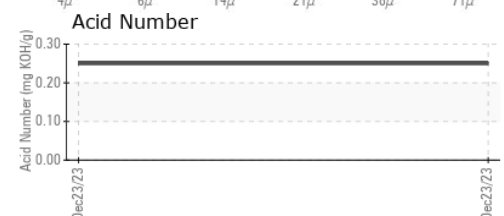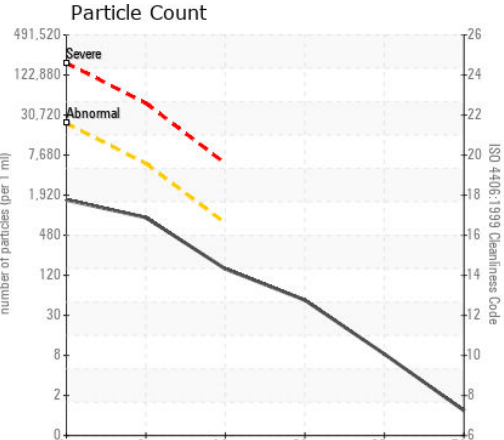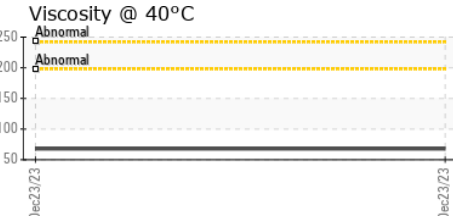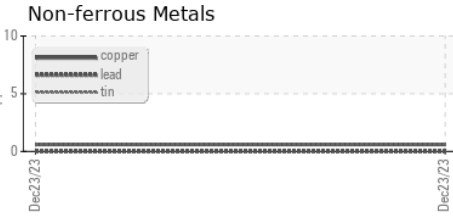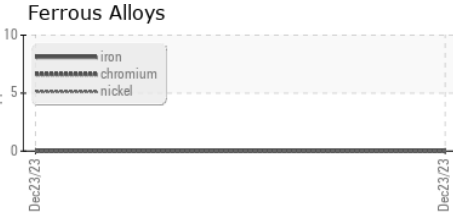

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0102815 **Received** : 04 Jan 2024  
**Lab Number** : **06051076** **Diagnosed** : 05 Jan 2024  
**Unique Number** : 10817025 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount )

**THE HERSHEY COMPANY**  
 WEST HERSHEY - TECHNICAL ASSURANCE, 1033 OLDE WEST CHOCOLATE  
 HERSHEY, PA  
 US 17033  
 Contact: CLINTON ZOHNER  
 clintzohner@hersheys.com  
 T: (717)374-4846  
 F: (717)374-4594

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)