


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

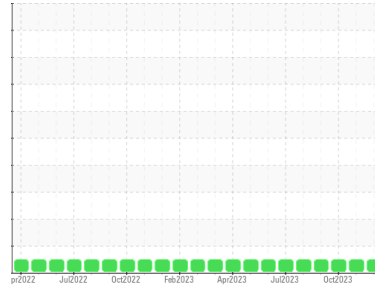

Area  
**WILLMAR**  
Machine Id  
**Unit 01 DB040101E**

Component  
**Natural Gas Engine**  
Fluid  
**DIESEL ENGINE OIL SAE 40 (250 GAL)**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. ( Customer Sample Comment: 24 Gallons Make-up Oil )

#### Wear

All component wear rates are normal.

#### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	<b>PCA0105946</b>	PCA0050293	PCA0050292	
Sample Date	Client Info	<b>27 Dec 2023</b>	30 Nov 2023	31 Oct 2023	
Machine Age	hrs	Client Info	<b>5750</b>	5637	5443
Oil Age	hrs	Client Info	<b>5750</b>	5637	5443
Oil Changed	Client Info	<b>Filtered</b>	Filtered	Filtered	
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL	

### CONTAMINATION

method	limit/base	current	history1	history2	
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	<b>3</b>	2	1
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>9	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>30	<b>2</b>	2	2
Copper	ppm	ASTM D5185m	>35	<b>2</b>	2	<1
Tin	ppm	ASTM D5185m	>4	<b>2</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1

### ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	250	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	10	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	100	<b>&lt;1</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	450	<b>865</b>	904	834
Calcium	ppm	ASTM D5185m	3000	<b>1031</b>	1032	997
Phosphorus	ppm	ASTM D5185m	1150	<b>1094</b>	1125	1023
Zinc	ppm	ASTM D5185m	1350	<b>1234</b>	1298	1241
Sulfur	ppm	ASTM D5185m	4250	<b>2940</b>	2815	2946

### CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+100	<b>5</b>	2	2
Sodium	ppm	ASTM D5185m	>216	<b>4</b>	3	2
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	1
Fuel	%	ASTM D3524	>4.0	<b>1.2</b>	0.5	1.2





### INFRA-RED

method	limit/base	current	history1	history2		
Soot %	%	*ASTM D7844		<b>0</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>4.0</b>	3.9	4.0
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>12.9</b>	12.9	13.0

### FLUID DEGRADATION

method	limit/base	current	history1	history2		
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>6.9</b>	6.8	6.8
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.40</b>	1.32	1.53
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>8.42</b>	8.54	7.99









# OIL ANALYSIS REPORT

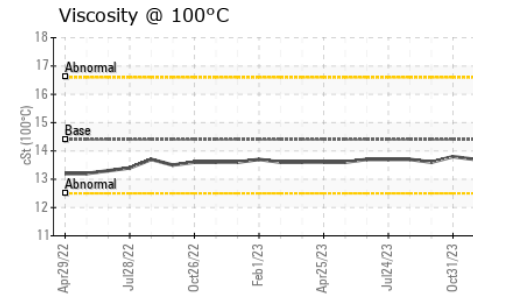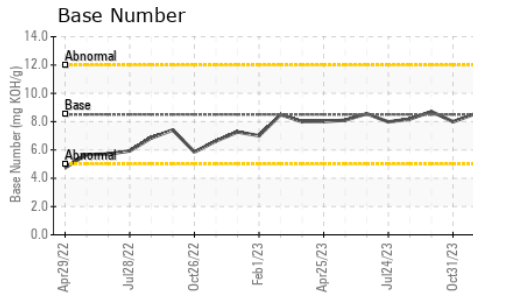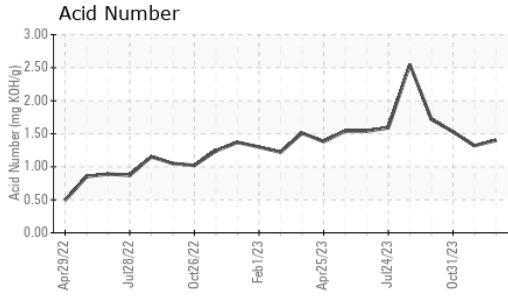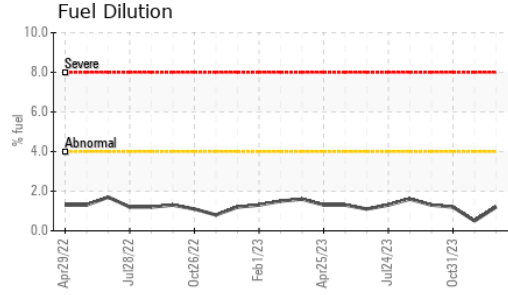

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.8</b>	13.7	13.8

## GRAPHS

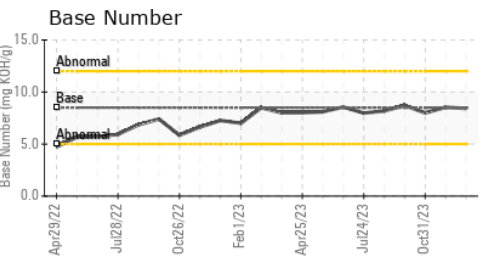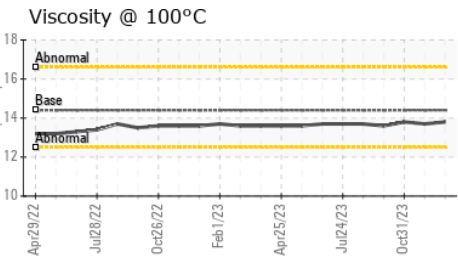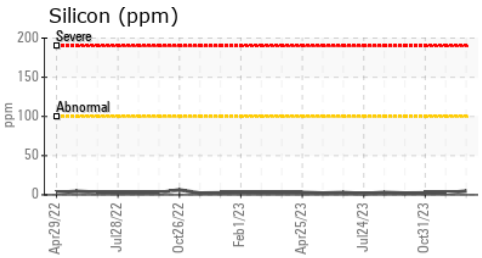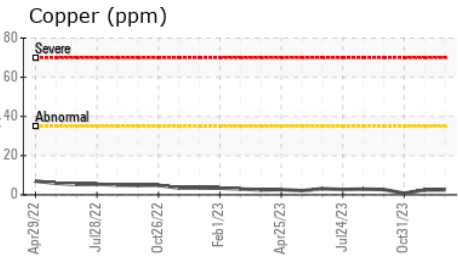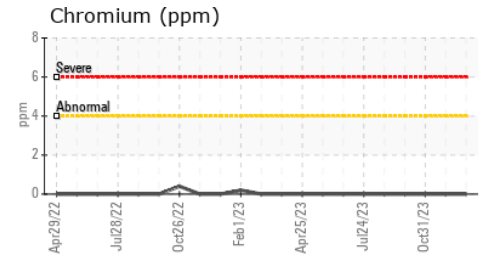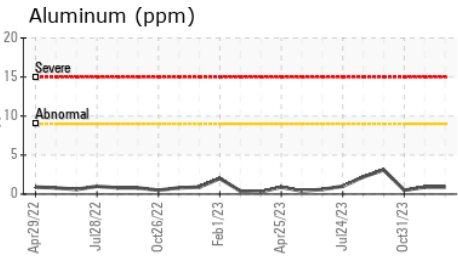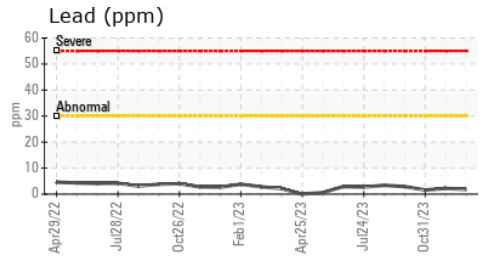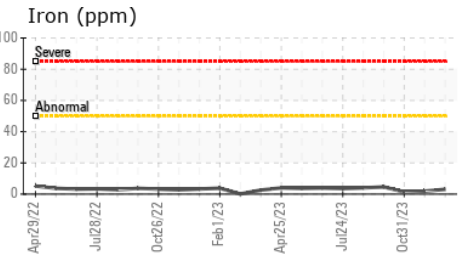

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0105946 **Received** : 04 Jan 2024  
**Lab Number** : 06051083 **Diagnosed** : 09 Jan 2024  
**Unique Number** : 10817032 **Diagnostician** : Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**Magellan Midstream LP - Willmar**  
 2131 30th Stree SW  
 Willmar, MN  
 US 56201  
 Contact: Andrew Lauer  
 andrew.lauer@magellanlp.com  
 T: (320)808-4364  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)