

OIL ANALYSIS REPORT

DEGRADATION

Machine Id

Component

Diesel Engine

PETRO CANADA DURON SHP 15W40 (12 GAL)

DIAGNOSIS

Recommendation

The oil is near the end of it's useful service life, recommend schedule an oil change. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN level is low. The condition of the oil is acceptable for the time in service.

GAL)									
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2			
Sample Number		Client Info		GFL0096938	GFL0069769	GFL0069791			
Sample Date	hrs	Client Info Client Info		03 Jan 2024 24938	18 Sep 2023 27539	17 May 2023 26787			
Machine Age Oil Age	hrs	Client Info		24930	27539	26787			
Oil Changed	1115	Client Info		Not Changd	Not Changd	N/A			
Sample Status				ABNORMAL	ATTENTION	ABNORMAL			
CONTAMINAT	ION	method	limit/base	current	history1	history2			
Fuel		WC Method	>3.0	<1.0	2.4	<1.0			
Water		WC Method	>0.2	NEG	NEG	NEG			
Glycol		WC Method		NEG	NEG	NEG			
WEAR METAL	.S	method	limit/base	current	history1	history2			
Iron	ppm	ASTM D5185m	>120	21	5	31			
Chromium	ppm	ASTM D5185m	>20	<1	<1	<1			
Nickel	ppm	ASTM D5185m	>5	<1	<1	<1			
Titanium	ppm	ASTM D5185m	>2	<1	0	0			
Silver	ppm	ASTM D5185m	>2	0	0	0			
Aluminum	ppm	ASTM D5185m		1	0	<1			
Lead	ppm	ASTM D5185m	>40	<1	0	1			
Copper	ppm	ASTM D5185m	>330	1	<1	2			
Tin	ppm		>15	<1	<1	<1			
Vanadium	ppm	ASTM D5185m		0	0	0			
Cadmium	ppm	ASTM D5185m		0	0	0			
ADDITIVES		method	limit/base	current	history1	history2			
Boron	ppm	ASTM D5185m	0	11	16	12			
Barium	ppm	ASTM D5185m	0	11	0	0			
Molybdenum	ppm	ASTM D5185m	60	61	67	63			
Manganese	ppm	ASTM D5185m	0	0	<1	<1			
Magnesium	ppm	ASTM D5185m	1010	778	920	830			
Calcium	ppm	ASTM D5185m	1070	1025	1167	1086			
Phosphorus	ppm	ASTM D5185m	1150	1027	1056	963			
Zinc	ppm	ASTM D5185m		1053	1253	1158			
Sulfur	ppm	ASTM D5185m		3197	3940	2866			
CONTAMINAN	ITS	method	limit/base	current	history1	history2			
Silicon	ppm	ASTM D5185m	>25	4	4	6			
Sodium	ppm	ASTM D5185m		2	4	3			
Potassium	ppm	ASTM D5185m		2	2	2			
INFRA-RED		method	limit/base	current	history1	history2			
Soot %	%	*ASTM D7844	>4	0.6	0.2	0.6			
Nitration Sulfation	Abs/cm Abs/.1mm	*ASTM D7624 *ASTM D7415	>20 >30	14.8 30.2	9.3 20.4	16.8 35.2			
FLUID DEGRAI			limit/base	current	history1	history2			
Oxidation	Abs/.1mm	*ASTM D7414	>25	31.5	18.3	42.1			
Base Number (BN)	mg KOH/g			31.5 A 2.7	7.2	42.1			
Dase Number (DN)	ing KOH/g	A01101 D2030	5.0	<u> </u>	1.2	- 1.0			



10


Mav22/15

Aar1/1

Mar28/

ah16/11

OIL ANALYSIS REPORT



Dec15/21

Mav20/22

cSt (100°C)

Laboratory


Sample No.


Lab Number


Unique Number

Sen1/20

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.1	12.4	13.6
GRAPHS						







Recieved


Diagnosed

Diagnostician

: 05 Jan 2024

: 08 Jan 2024

: Don Baldridge

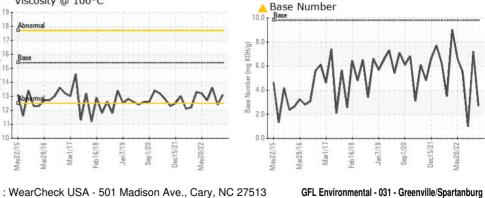

1635 Antioch Church Rd Piedmont, SC US 29673 Contact: TECHNICIAN ACCOUNT catherine.anastasio@wearcheck.com Т: F:



: GFL0096938

: 06052728

: 10818677