


OIL ANALYSIS REPORT

Sample Rating Trend

FUEL

Area
Irvington
Machine Id
Unit 02 DB060102E
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON MONOGRADE HD 40W (250 GAL)

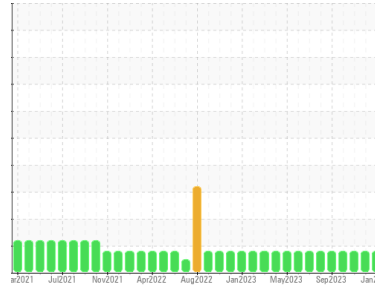

DIAGNOSIS

Recommendation
We advise that you check the fuel injection system. Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 0 GAL)

Wear
All component wear rates are normal.

Contamination
There is a moderate amount of fuel present in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0105165	PCA0105166	PCA0105168
Sample Date	Client Info	04 Jan 2024	13 Dec 2023	01 Nov 2023
Machine Age	hrs	26783	26689	26033
Oil Age	hrs	18355	18261	17605
Oil Changed	Client Info	Oil Added	Oil Added	Oil Added
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	15	12	12
Chromium	ppm ASTM D5185m >4	<1	<1	<1
Nickel	ppm ASTM D5185m >2	<1	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >9	2	<1	<1
Lead	ppm ASTM D5185m >30	13	12	11
Copper	ppm ASTM D5185m >35	13	11	11
Tin	ppm ASTM D5185m >4	3	2	2
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	<1	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	14	14	16
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	5	3	5
Manganese	ppm ASTM D5185m	<1	<1	0
Magnesium	ppm ASTM D5185m	826	800	743
Calcium	ppm ASTM D5185m	1166	1074	1107
Phosphorus	ppm ASTM D5185m	858	885	826
Zinc	ppm ASTM D5185m	1201	1165	1117
Sulfur	ppm ASTM D5185m	2304	2072	2051

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >+100	3	3	4
Sodium	ppm ASTM D5185m	2	5	7
Potassium	ppm ASTM D5185m >20	2	2	<1
Fuel	% ASTM D3524 >4.0	▲ 4.8	▲ 4.6	▲ 6.2

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	6.8	6.8	6.9
Sulfation	Abs/.1mm *ASTM D7415 >30	16.8	17.1	17.0

FLUID DEGRADATION


method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	11.1	11.1	11.0
Acid Number (AN)	mg KOH/g ASTM D8045	1.08	1.00	1.03
Base Number (BN)	mg KOH/g ASTM D2896 8.5	7.44	7.55	6.91

OIL ANALYSIS REPORT


▲ Fuel Dilution

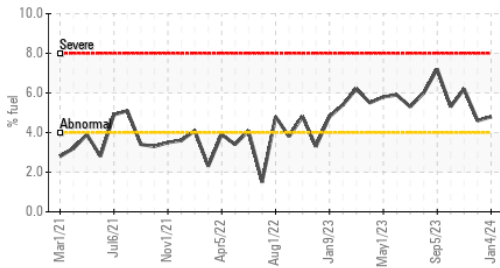


Acid Number

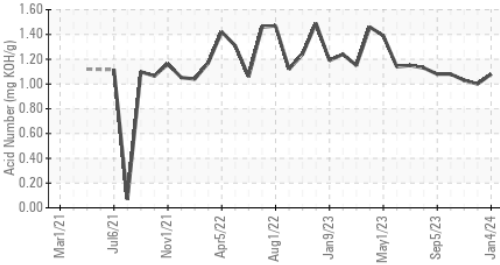

Base Number

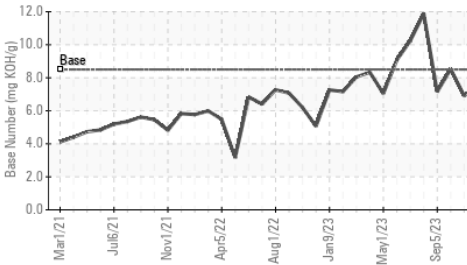

Viscosity @ 100°C

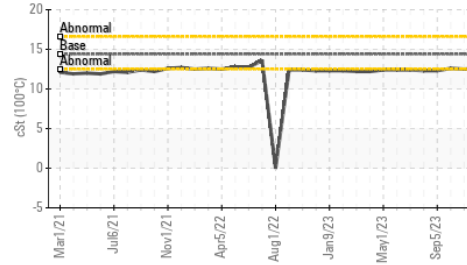


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	12.5	12.6

GRAPHS


Iron (ppm)

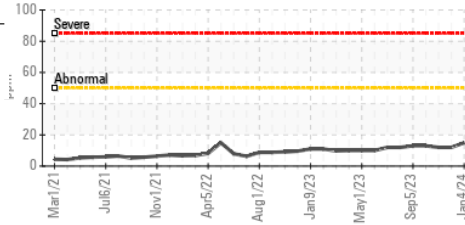


Aluminum (ppm)

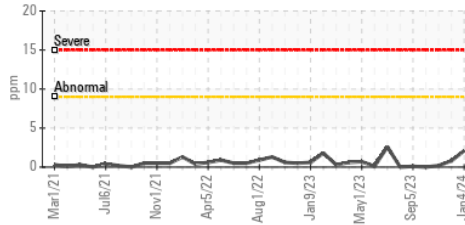


Copper (ppm)

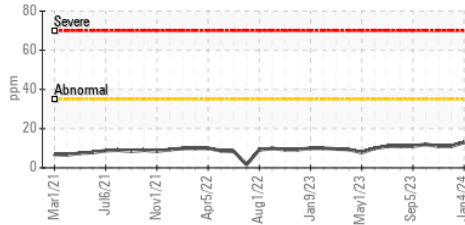


Viscosity @ 100°C

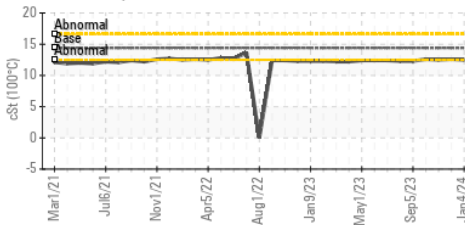


Lead (ppm)

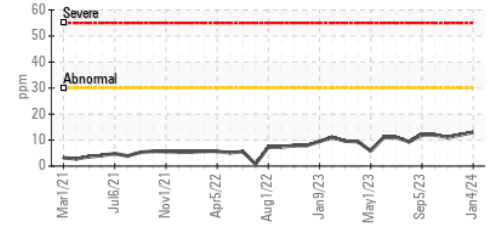


Chromium (ppm)

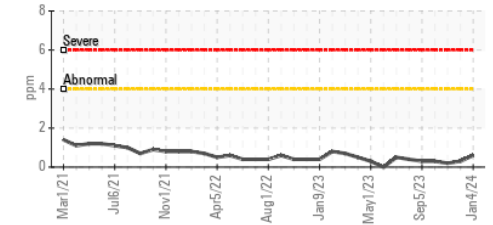

Silicon (ppm)

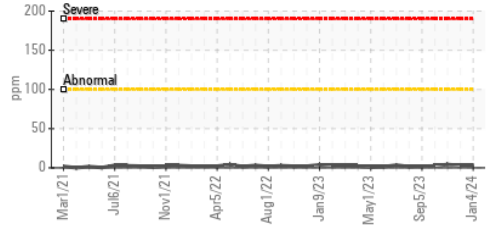

Base Number

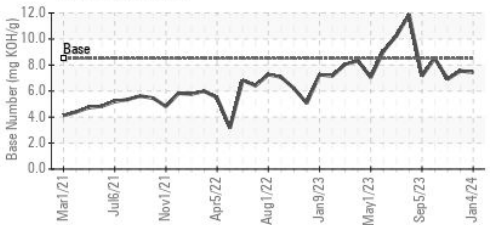

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0105165 **Received** : 08 Jan 2024
Lab Number : 06055015 **Diagnosed** : 12 Jan 2024
Unique Number : 10820964 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

Magellan Midstream LP - Omaha
 9405 Bennington Road
 Omaha, NE
 US 68122
 Contact: Zach Jones
 zach.jones@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: