


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

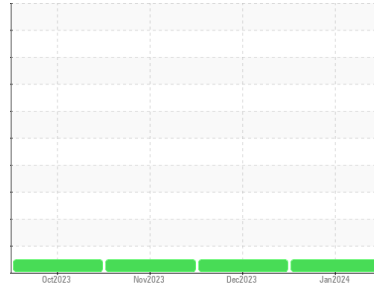

Machine Id  
**42**  
Component  
**Compressor**  
Fluid  
**PETRO CANADA SENTRON LD 3000 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0111888</b>	PCA0111928	PCA0111917
Sample Date	Client Info		<b>02 Jan 2024</b>	04 Dec 2023	09 Nov 2023
Machine Age	hrs	Client Info	<b>97005</b>	96360	96069
Oil Age	hrs	Client Info	<b>2852</b>	2205	1605
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>5</b>	1	2
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	<1	<1
Lead	ppm	ASTM D5185m >25	<b>4</b>	3	4
Copper	ppm	ASTM D5185m >50	<b>15</b>	12	13
Tin	ppm	ASTM D5185m >15	<b>6</b>	6	6
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185m 1	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 2	<b>2</b>	0	<1
Manganese	ppm	ASTM D5185m 1	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 5	<b>17</b>	19	17
Calcium	ppm	ASTM D5185m 1220	<b>1394</b>	1402	1344
Phosphorus	ppm	ASTM D5185m 298	<b>322</b>	292	287
Zinc	ppm	ASTM D5185m 350	<b>344</b>	370	351
Sulfur	ppm	ASTM D5185m 1995	<b>2723</b>	2618	2508

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	2	1
Sodium	ppm	ASTM D5185m	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m >20	<b>4</b>	1	<1
Fuel	%	ASTM D3524	<b>0.2</b>	---	---





## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	---	---
Nitration	Abs/cm	*ASTM D7624	<b>4.0</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415	<b>14.7</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>8.7</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	<b>0.318</b>	0.31	0.31
Base Number (BN)	mg KOH/g	ASTM D2896 3.85	<b>3.19</b>	---	---

# OIL ANALYSIS REPORT





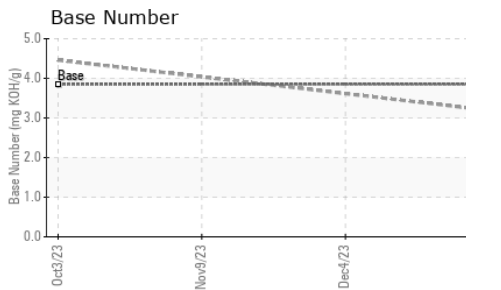
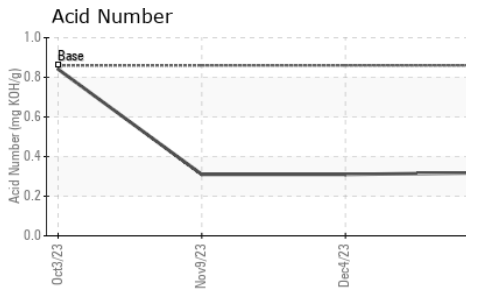
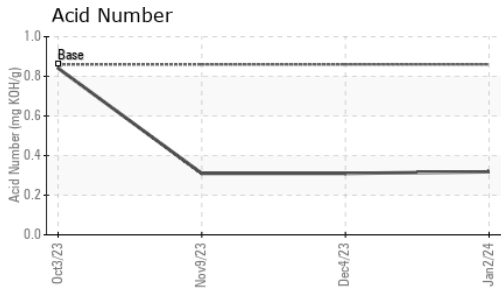
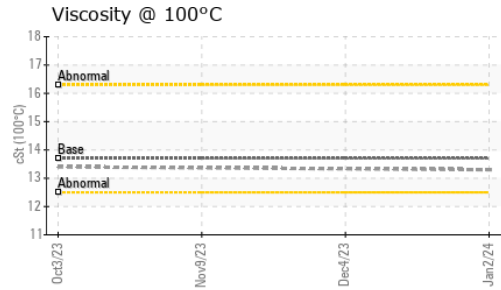


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	124.3	121	121
Visc @ 100°C	cSt	ASTM D445	13.7	---	---
Viscosity Index (VI)	Scale	ASTM D2270	106	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

## GRAPHS

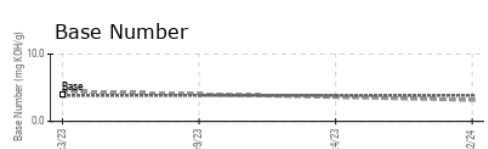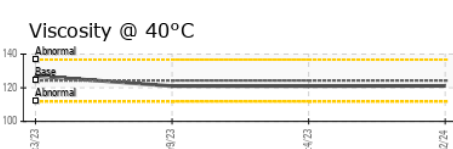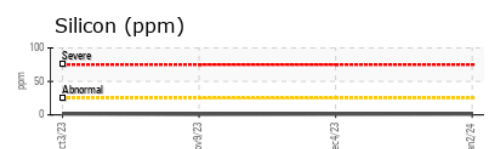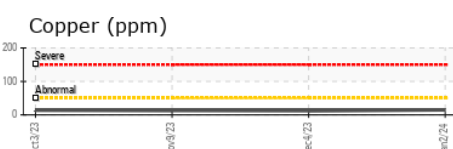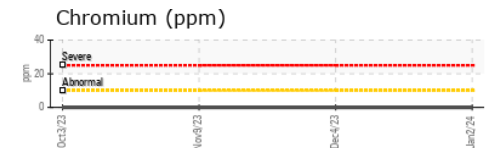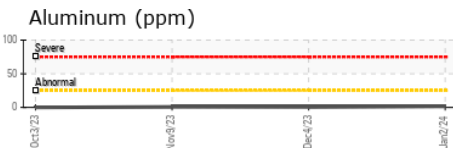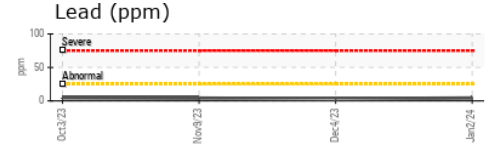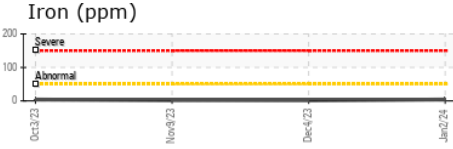

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **ENERVEST OPERATING - HAYS BOOSTER**  
**Sample No.** : PCA0111888 **Recieved** : 10 Jan 2024 **1705 BREAKS PARK ROAD**  
**Lab Number** : 06057447 **Diagnosed** : 17 Jan 2024 **HAYS1, VA**  
**Unique Number** : 10823396 **Diagnostician** : Jonathan Hester **US 24256**  
**Test Package** : MOB 2 ( Additional Tests: FT-IR, FuelDilution, KV100, PercentFuel, TBN, VI ) **Contact: Service Manager**

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)