

# OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY



Machine Id  
**ROBUSCHI RESLO DE**

Component  
**Blower**

Fluid  
**PETRO CANADA ENDURATEX EP 220 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### ▲ Fluid Condition

Viscosity of sample indicates oil is within ISO 150 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0098134</b>	---	---
Sample Date	Client Info		<b>22 Dec 2023</b>	---	---
Machine Age	yrs	Client Info	<b>10</b>	---	---
Oil Age	yrs	Client Info	<b>1</b>	---	---
Oil Changed	Client Info		<b>Changed</b>	---	---
Sample Status			<b>ATTENTION</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>1</b>	---	---
Chromium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m >20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 60	<b>7</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>25</b>	---	---
Phosphorus	ppm	ASTM D5185m 270	<b>302</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>214</b>	---	---
Sulfur	ppm	ASTM D5185m 11200	<b>7448</b>	---	---



## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.40	<b>0.38</b>	---	---

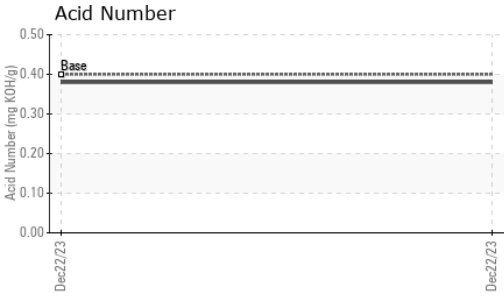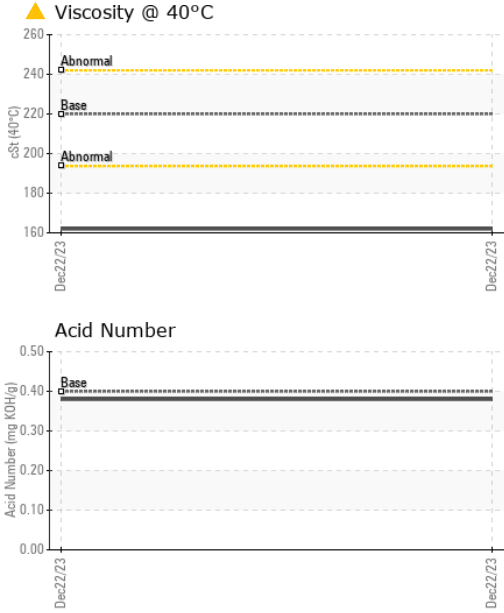

# OIL ANALYSIS REPORT







VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 220	<b>▲ 162</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

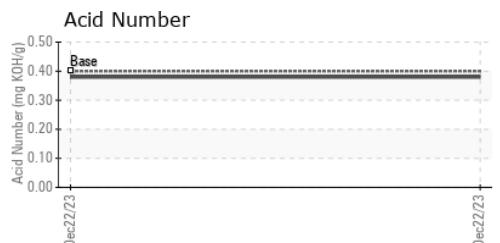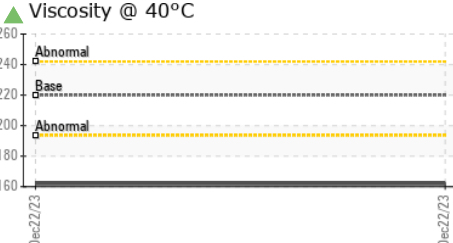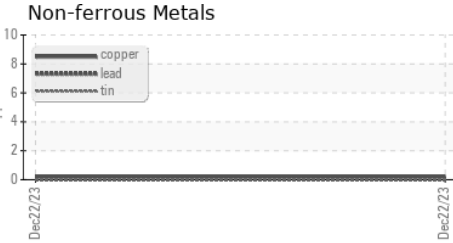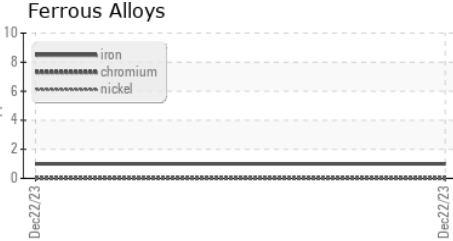

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0098134 **Received** : 11 Jan 2024  
**Lab Number** : 06058268 **Diagnosed** : 14 Jan 2024  
**Unique Number** : 10829650 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**CERTAINTED CORP**  
 200 RONTHOR DR  
 SOCIAL CIRCLE, GA  
 US 30025

Contact: MARK KIRKPATRICK  
 MARK.W.KIRKPATRICK@SAINT-GOBAIN.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (770)464-0878