


OIL ANALYSIS REPORT

Sample Rating Trend



WEAR

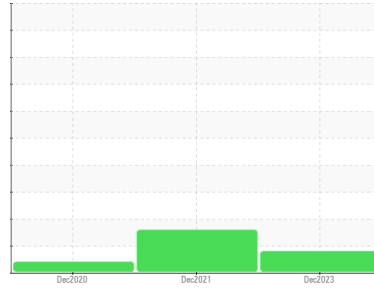

Machine Id
DRESSER RM 1 REGRIND (S/N 0408980602)

Component
Blower

Fluid
PETRO CANADA ENDURATEX EP 220 (--- GAL)

DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0110394	PCA0065582	PCAI25560
Sample Date	Client Info		28 Dec 2023	05 Dec 2021	18 Dec 2020
Machine Age	yrs	Client Info	10	7	0
Oil Age	yrs	Client Info	1	1	0
Oil Changed	Client Info		Changed	Changed	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	▲ 213	▲ 33	18
Chromium	ppm	ASTM D5185m >20	1	0	0
Nickel	ppm	ASTM D5185m >20	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	2	1	<1
Lead	ppm	ASTM D5185m >20	0	<1	0
Copper	ppm	ASTM D5185m >20	2	<1	<1
Tin	ppm	ASTM D5185m >20	0	<1	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 60	0	15	3
Barium	ppm	ASTM D5185m 0	5	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m 0	2	<1	<1
Magnesium	ppm	ASTM D5185m 0	0	0	1
Calcium	ppm	ASTM D5185m 0	0	20	50
Phosphorus	ppm	ASTM D5185m 270	69	402	271
Zinc	ppm	ASTM D5185m 0	<1	153	219
Sulfur	ppm	ASTM D5185m 11200	1959	4456	6484

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	2	2	1
Sodium	ppm	ASTM D5185m	0	<1	<1
Potassium	ppm	ASTM D5185m >20	<1	<1	0

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.40	0.22	0.89	0.277

OIL ANALYSIS REPORT


▲ Ferrous Alloys

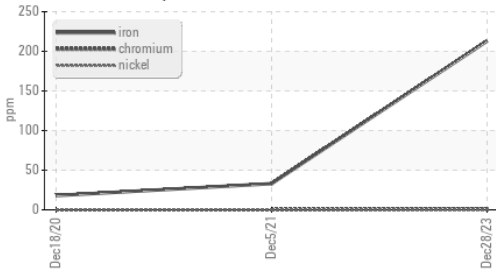

Acid Number

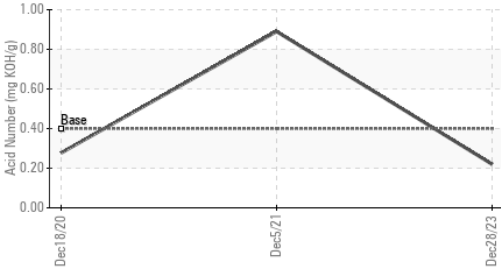

Viscosity @ 40°C

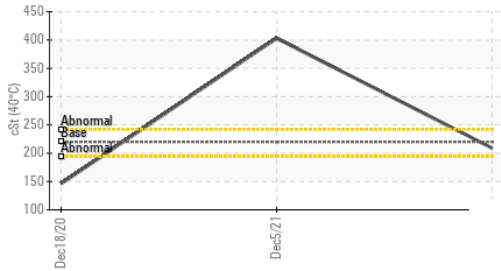

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 220	209	▲ 403	146

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


▲ Ferrous Alloys

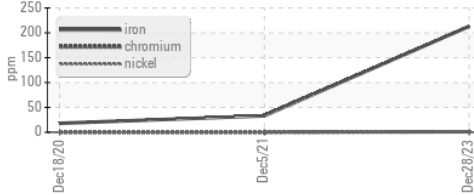


Non-ferrous Metals

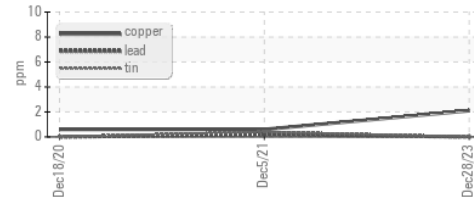

Viscosity @ 40°C

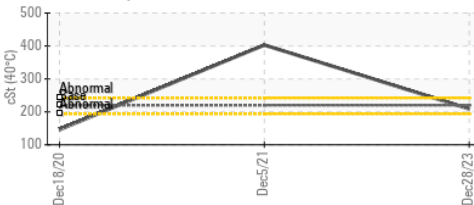

Acid Number

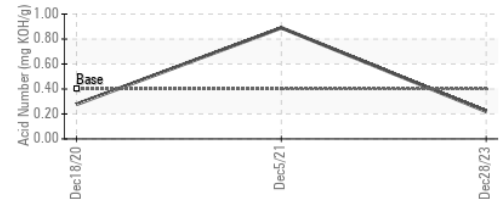

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0110394 **Received** : 11 Jan 2024
Lab Number : 06058272 **Diagnosed** : 14 Jan 2024
Unique Number : 10829654 **Diagnostician** : Don Baldrige
Test Package : IND 2

CERTAINTED CORP
 200 RONTHOR DR
 SOCIAL CIRCLE, GA
 US 30025

Contact: Dennis Shields
 Dennis.R.Shields@saint-gobain.com

T:
 F: (770)464-0878

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)