

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



DRESSER RM 2 REG (S/N 06039223315)

Component

Gearbox

PETRO CANADA ENDURATEX EP 220 (---

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

,	(((((((((((((((((((method Client Info Client Info Client Info Client Info Client Info Method Method Method	limit/base limit/base >0.2	current PCA0110393 23 Dec 2023 10 1 Changed NORMAL current	history1 PCA0065580 15 Dec 2021 7 1 Changed ABNORMAL history1	history2 history2
Sample Date Machine Age yr Oil Age yr Oil Changed Sample Status CONTAMINATION Water	N	Client Info Client Info Client Info Client Info Client Info method WC Method	>0.2	23 Dec 2023 10 1 Changed NORMAL current	15 Dec 2021 7 1 Changed ABNORMAL history1	 history2
Machine Age yr Oil Age yr Oil Changed Sample Status CONTAMINATIO	rs (rs (Client Info Client Info Client Info method WC Method	>0.2	10 1 Changed NORMAL	7 1 Changed ABNORMAL history1	 history2
Oil Age yi Oil Changed Sample Status CONTAMINATIO Water	N N	Client Info Client Info method WC Method	>0.2	1 Changed NORMAL	1 Changed ABNORMAL history1	 history2
Oil Changed Sample Status CONTAMINATION Water	N N	Client Info method WC Method	>0.2	Changed NORMAL current	Changed ABNORMAL history1	 history2
Sample Status CONTAMINATION Water	N V	method WC Method	>0.2	NORMAL	ABNORMAL history1	history2
CONTAMINATION Water	pm /	WC Method	>0.2	current	history1	history2
Water	pm /	WC Method	>0.2			
	pm /			1150		
WEAR METALS	1-	method		NEG	NEG	
	1-		limit/base	current	history1	history2
ron p		ASTM D5185m	>200	0	19	
Chromium p	pm A	ASTM D5185m	>15	0	0	
Nickel p	pm /	ASTM D5185m	>15	0	0	
Titanium p _l	pm A	ASTM D5185m		0	<1	
Silver p	pm A	ASTM D5185m		0	0	
Aluminum p _l	pm A	ASTM D5185m	>25	0	1	
Lead p	pm A	ASTM D5185m	>100	0	<1	
Copper p	pm A	ASTM D5185m	>200	0	1	
Tin p	pm A	ASTM D5185m	>25	0	<1	
Antimony p	pm A	ASTM D5185m	>5		0	
Vanadium p _l	pm A	ASTM D5185m		0	0	
Cadmium p	pm /	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron p	pm A	ASTM D5185m	60	2	15	
Barium p _l	pm A	ASTM D5185m	0	0	0	
Molybdenum p _l	pm A	ASTM D5185m	0	0	<1	
Manganese p	pm A	ASTM D5185m	0	0	<1	
Magnesium p	pm A	ASTM D5185m	0	0	0	
Calcium	pm A	ASTM D5185m	0	0	22	
Phosphorus p	pm /	ASTM D5185m	270	86	399	
Zinc p	pm /	ASTM D5185m	0	6	98	
Sulfur p	pm A	ASTM D5185m	11200	2261	4959	
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon p	pm A	ASTM D5185m	>50	0	2	
Sodium p _l	pm A	ASTM D5185m		0	1	
Potassium p	pm /	ASTM D5185m	>20	<1	<1	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.37


Acid Number (AN)

mg KOH/g ASTM D8045 0.40


0.81





OIL ANALYSIS REPORT

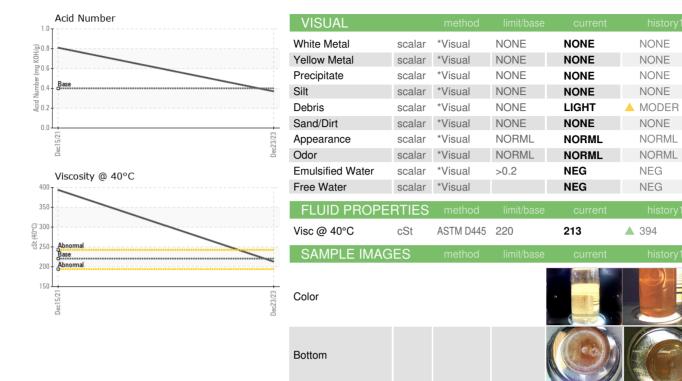

GRAPHS











Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : PCA0110393 : 06058274 : 10829656

Recieved

Diagnosed Diagnostician

: 11 Jan 2024 : 14 Jan 2024 : Don Baldridge

CERTAINTEED CORP 200 RONTHOR DR SOCIAL CIRCLE, GA US 30025

Contact: Dennis Shields

Dennis.R.Shields@saint-gobain.com

Contact/Location: Dennis Shields - CERSOC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (770)464-0878

T:

no image

no image