




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**(YA113967)**  
Machine Id  
**3444C**  
Component  
**Natural Gas Engine**  
Fluid  
**PETRO CANADA DURON GEO LD 15W40 (29 QTS)**

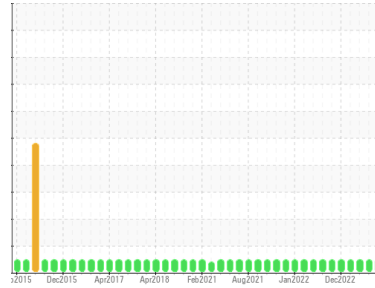

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>GFL0098138</b>	GFL0069401	GFL0061168
Sample Date	Client Info	<b>17 Jan 2024</b>	17 Jul 2023	09 May 2023
Machine Age	hrs	<b>15510</b>	15510	15510
Oil Age	hrs	<b>443</b>	413	529
Oil Changed	Client Info	<b>Changed</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>3</b>	5	4
Chromium	ppm ASTM D5185m >4	<b>0</b>	<1	<1
Nickel	ppm ASTM D5185m >2	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185m	<b>0</b>	<1	0
Silver	ppm ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >9	<b>&lt;1</b>	<1	0
Lead	ppm ASTM D5185m >30	<b>0</b>	<1	<1
Copper	ppm ASTM D5185m >35	<b>&lt;1</b>	0	0
Tin	ppm ASTM D5185m >4	<b>0</b>	<1	1
Vanadium	ppm ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 50	<b>46</b>	50	39
Barium	ppm ASTM D5185m 5	<b>0</b>	1	0
Molybdenum	ppm ASTM D5185m 50	<b>46</b>	48	48
Manganese	ppm ASTM D5185m 0	<b>0</b>	<1	<1
Magnesium	ppm ASTM D5185m 560	<b>580</b>	586	565
Calcium	ppm ASTM D5185m 1510	<b>1564</b>	1582	1473
Phosphorus	ppm ASTM D5185m 780	<b>815</b>	773	767
Zinc	ppm ASTM D5185m 870	<b>940</b>	955	919
Sulfur	ppm ASTM D5185m 2040	<b>2736</b>	3001	2903

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >+100	<b>15</b>	14	11
Sodium	ppm ASTM D5185m	<b>4</b>	3	3
Potassium	ppm ASTM D5185m >20	<b>12</b>	2	3

## INFRA-RED



method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm *ASTM D7624 >20	<b>6.0</b>	5.9	6.2
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>18.9</b>	18.6	17.1

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>15.1</b>	15.4	14.8
Base Number (BN)	mg KOH/g ASTM D2896 10.2	<b>8.7</b>	9.0	7.4







# OIL ANALYSIS REPORT

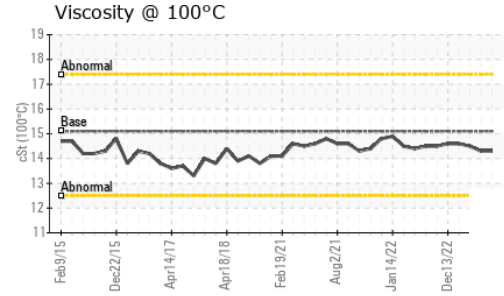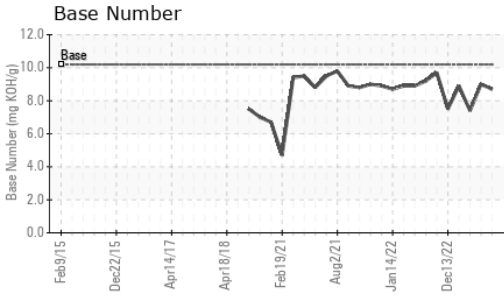

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.1	<b>14.3</b>	14.3	14.5

## GRAPHS

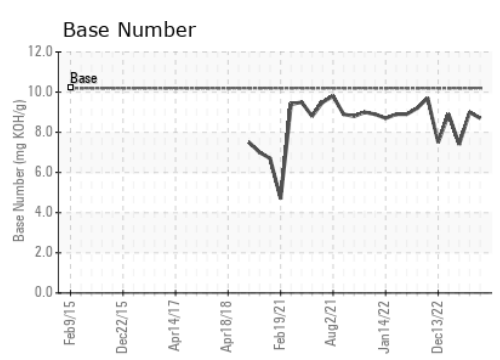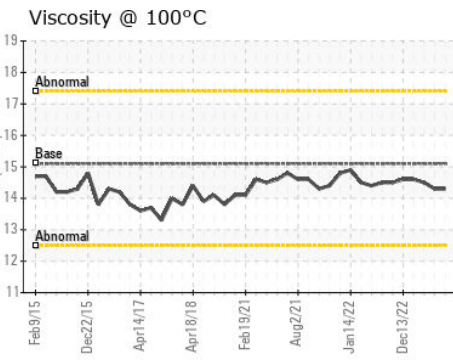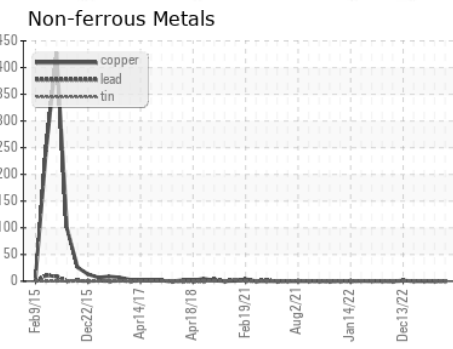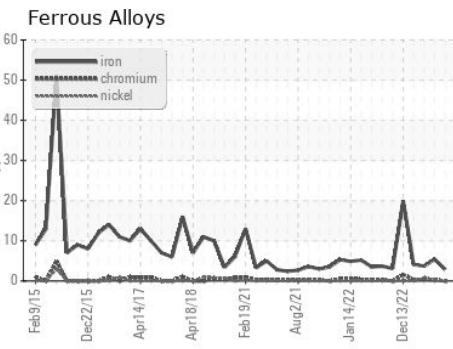

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0098138 **Recieved** : 17 Jan 2024  
**Lab Number** : **06063482** **Diagnosed** : 18 Jan 2024  
**Unique Number** : 10834864 **Diagnostician** : Wes Davis  
**Test Package** : FLEET

**GFL Environmental - 017 - Durham**  
 148 Stone Park Court  
 Durham, NC  
 US 27703  
 Contact: Shane Parks  
 shane.parks@gflenv.com  
 T: (919)596-1363  
 F: (919)598-1852

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)