


Machine Id
BLENDER 1
 Component
Gearbox
 Fluid
MOBIL SHC 630 (15 GAL)

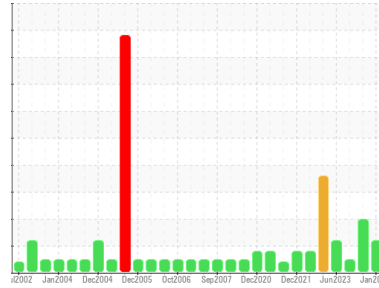

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0113568	PCA0103612	PCA0094154
Sample Date	Client Info	15 Jan 2024	29 Sep 2023	14 Jul 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	2	9	<1
Chromium	ppm ASTM D5185m >15	0	<1	0
Nickel	ppm ASTM D5185m >15	0	0	0
Titanium	ppm ASTM D5185m	0	<1	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >25	0	2	<1
Lead	ppm ASTM D5185m >100	0	<1	0
Copper	ppm ASTM D5185m >200	0	1	<1
Tin	ppm ASTM D5185m >25	<1	0	0
Vanadium	ppm ASTM D5185m	0	0	<1
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	<1	0	0
Magnesium	ppm ASTM D5185m	1	<1	<1
Calcium	ppm ASTM D5185m	2	1	0
Phosphorus	ppm ASTM D5185m	449	432	494
Zinc	ppm ASTM D5185m	0	2	0
Sulfur	ppm ASTM D5185m	319	398	454

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	21	24	20
Sodium	ppm ASTM D5185m	0	2	<1
Potassium	ppm ASTM D5185m >20	<1	<1	0

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	▲ 53505	▲ 159537	465
Particles >6µm	ASTM D7647 >2500	▲ 6705	▲ 65969	63
Particles >14µm	ASTM D7647 >640	283	▲ 3861	3
Particles >21µm	ASTM D7647 >160	61	▲ 904	0
Particles >38µm	ASTM D7647 >40	1	32	0
Particles >71µm	ASTM D7647 >10	0	1	0
Oil Cleanliness	ISO 4406 (c) >20/18/16	▲ 23/20/15	▲ 24/23/19	16/13/9

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045	0.42	0.50	0.52

OIL ANALYSIS REPORT


▲ Particle Trend

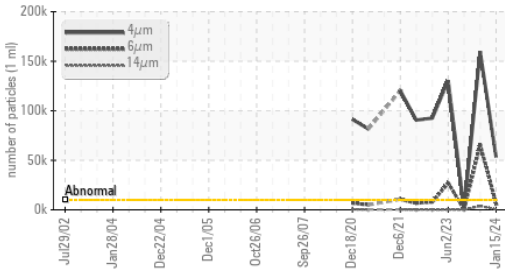


▲ Particle Trend

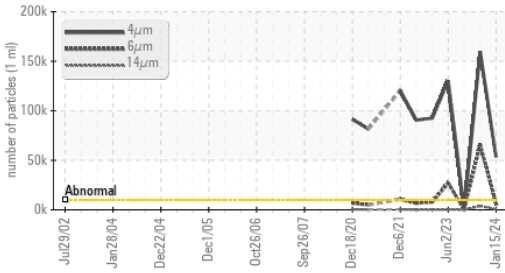

Acid Number

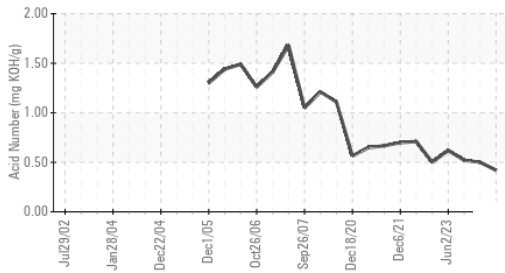


Viscosity @ 40°C

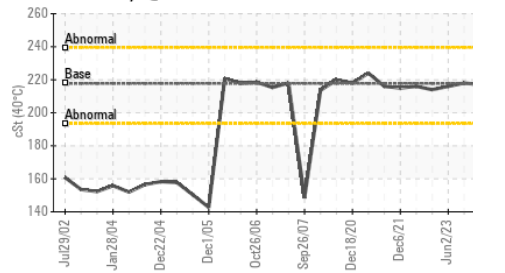

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	MODER	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	217.7	219	217	218

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

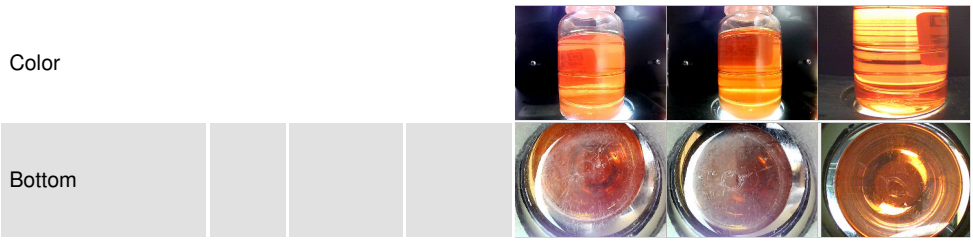


GRAPHS


Ferrous Alloys

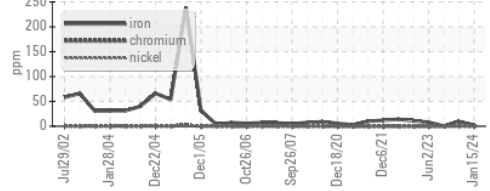


Non-ferrous Metals

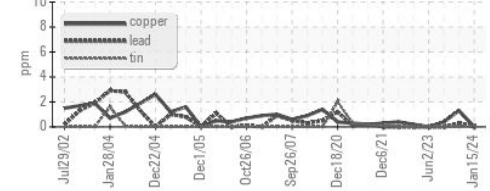


Viscosity @ 40°C

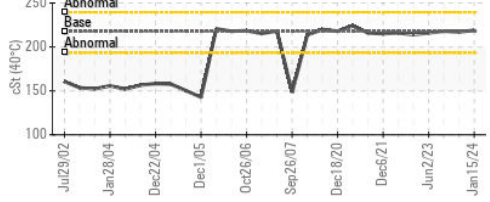

▲ Particle Count

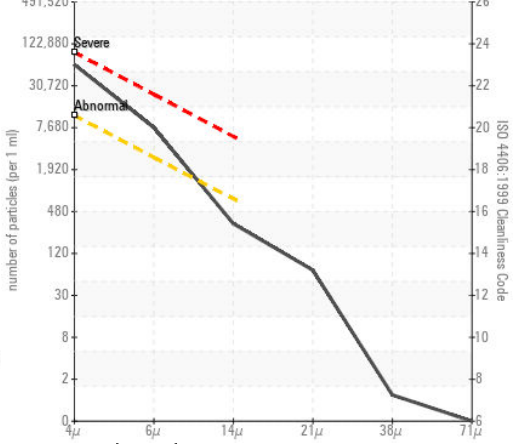

Acid Number

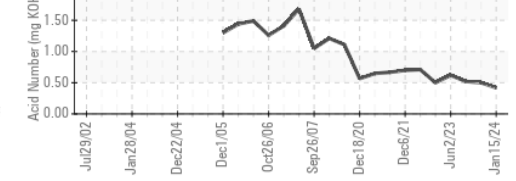

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0113568 **Received** : 18 Jan 2024
Lab Number : 06064327 **Diagnosed** : 21 Jan 2024
Unique Number : 10835709 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - New Ulm - Plant 8302
 2525 S BRIDGE STREET
 NEW ULM, MN
 US 56073
 Contact: RYAN SCHMID
 ryan.schmid@kraftheinz.com
 T: (507)568-0338
 F: (507)354-7927

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)