


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

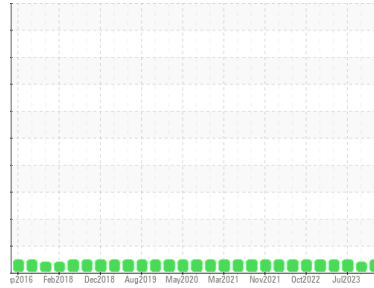

Machine Id  
**100 REDUCTION L-3 100 REDUCTION**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA ENDURATEX EP 220 (15 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0116715</b>	PCA0091823	PCA0091852
Sample Date	Client Info		<b>12 Jan 2024</b>	10 Oct 2023	27 Jul 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ABNORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>11</b>	15	14
Iron	ppm	ASTM D5185m >200	<b>7</b>	9	7
Chromium	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 60	<b>29</b>	18	18
Barium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 270	<b>445</b>	404	419
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	4
Sulfur	ppm	ASTM D5185m 11200	<b>5829</b>	6565	6537




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>0</b>	1	0
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	1	1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.40	<b>0.97</b>	1.04	0.96


# OIL ANALYSIS REPORT

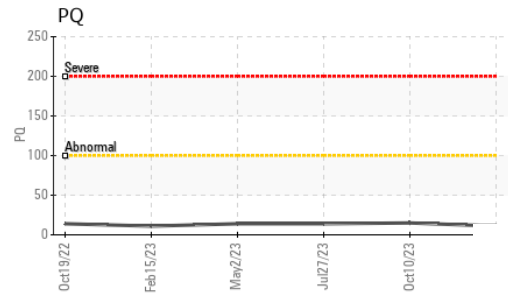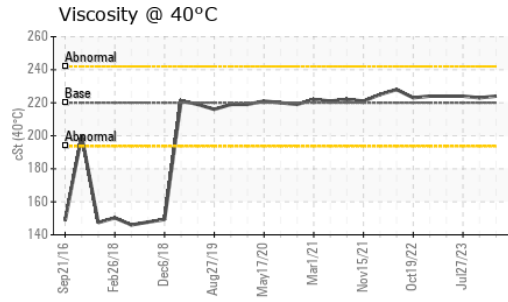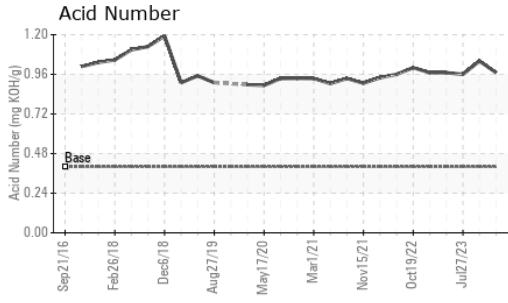






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	220	<b>224</b>	223

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

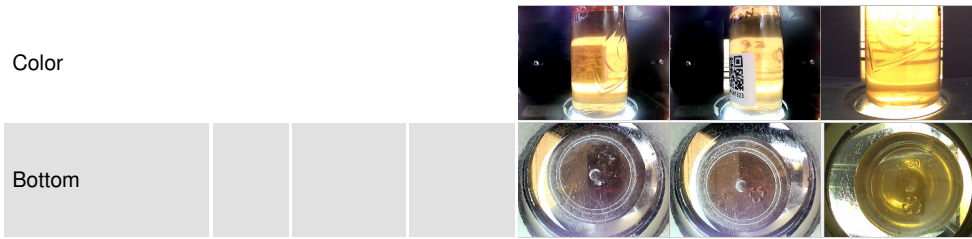

## GRAPHS

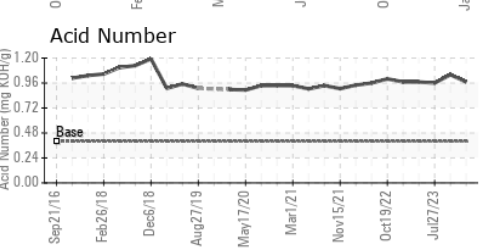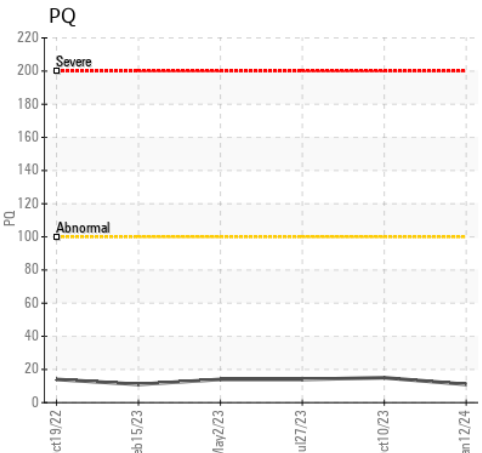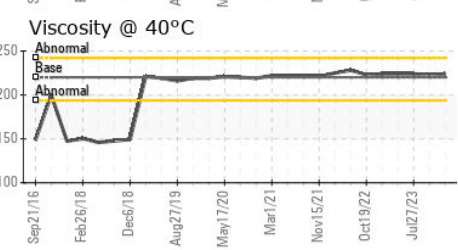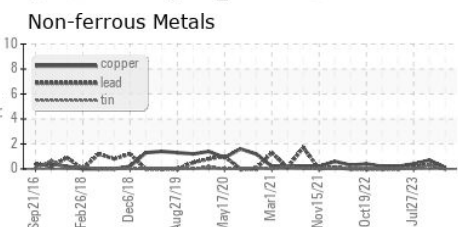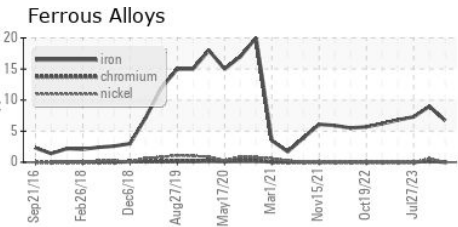

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0116715 **Recieved** : 19 Jan 2024  
**Lab Number** : 06066281 **Diagnosed** : 22 Jan 2024  
**Unique Number** : 10842958 **Diagnostician** : Wes Davis  
**Test Package** : PLANT

**CERTAINTED VINYL PLANT**  
 2651 PENNY RD  
 CLAREMONT, NC  
 US 28613  
 Contact: BRUCE JAMES  
 bruce.a.james@saint-gobain.com  
 T: (828)459-3320  
 F: (828)459-3329

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)