


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

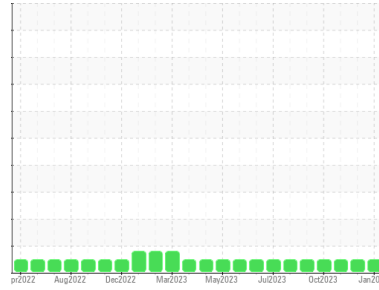

Machine Id
M5 (S/N 1457456)

Component
Biogas Engine

Fluid
PETRO CANADA SENTRON LD 8000 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0106200	PCA0106186	PCA0106193
Sample Date	Client Info	15 Jan 2024	29 Nov 2023	07 Nov 2023
Machine Age	hrs	9837	9336	8836
Oil Age	hrs	5917	8671	4171
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >45	12	9	6
Chromium	ppm ASTM D5185m >2	1	<1	0
Nickel	ppm ASTM D5185m >2	<1	0	0
Titanium	ppm ASTM D5185m	<1	0	0
Silver	ppm ASTM D5185m >5	0	0	0
Aluminum	ppm ASTM D5185m >10	2	2	1
Lead	ppm ASTM D5185m >5	2	<1	0
Copper	ppm ASTM D5185m >14	1	<1	0
Tin	ppm ASTM D5185m >13	5	4	3
Vanadium	ppm ASTM D5185m	0	<1	0
Cadmium	ppm ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	2	<1	<1
Manganese	ppm ASTM D5185m	<1	0	0
Magnesium	ppm ASTM D5185m	12	15	11
Calcium	ppm ASTM D5185m 1351	1731	1861	1764
Phosphorus	ppm ASTM D5185m 302	365	351	336
Zinc	ppm ASTM D5185m 358	427	473	442
Sulfur	ppm ASTM D5185m 2758	3611	3262	3260

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >200	2	2	1
Sodium	ppm ASTM D5185m	0	2	3
Potassium	ppm ASTM D5185m >20	2	0	0
Fuel	% ASTM D3524 >4.0	0.1	0.0	0.3

INFRA-RED


method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0.1	0.1	0.1
Nitration	Abs/cm *ASTM D7624 >20	6.7	6.5	6.4
Sulfation	Abs/.1mm *ASTM D7415 >30	22.0	21.9	21.9

FLUID DEGRADATION


method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	16.3	15.8	15.7
Acid Number (AN)	mg KOH/g ASTM D8045 0.86	2.22	1.67	1.36
Base Number (BN)	mg KOH/g ASTM D2896 4.64	3.01	4.50	3.31

OIL ANALYSIS REPORT


Fuel Dilution

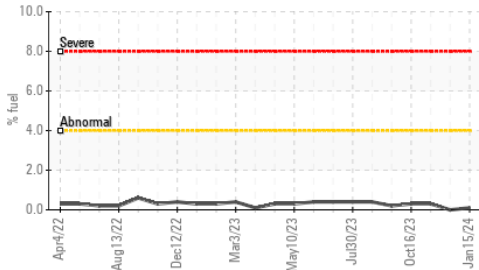


Acid Number

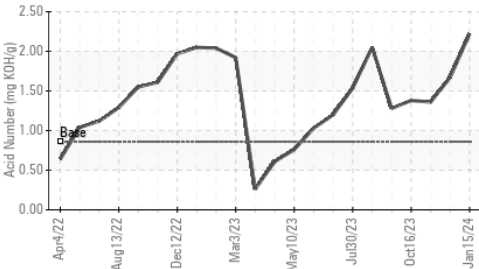

Base Number

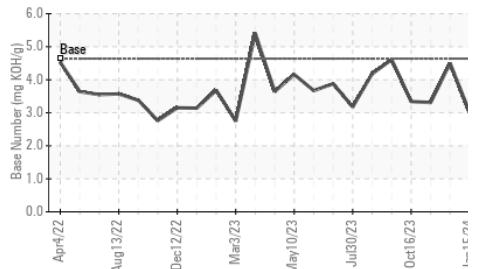

Viscosity @ 100°C

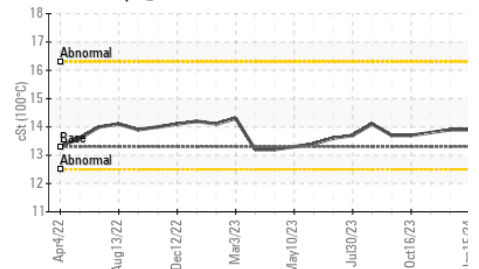


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.3	13.9	13.8

GRAPHS


Iron (ppm)

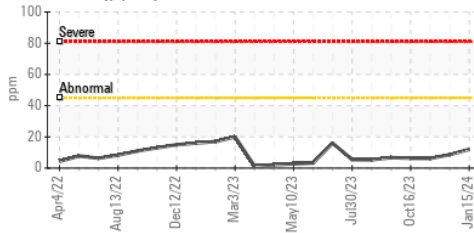


Lead (ppm)

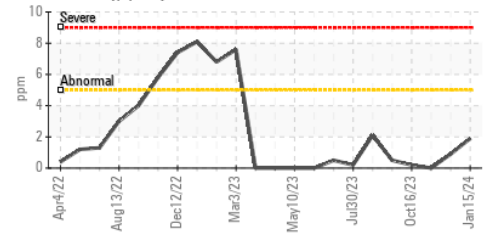


Aluminum (ppm)

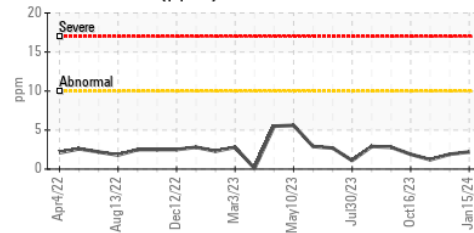


Chromium (ppm)

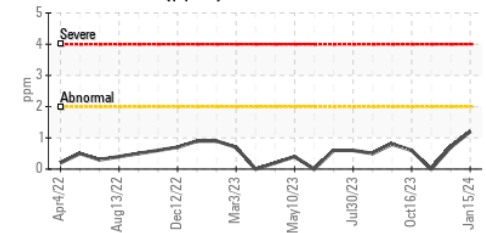


Copper (ppm)

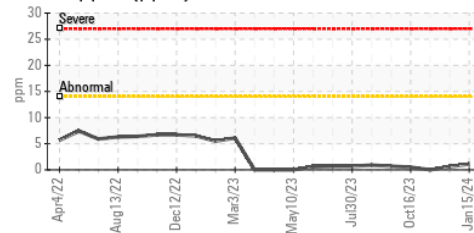


Silicon (ppm)

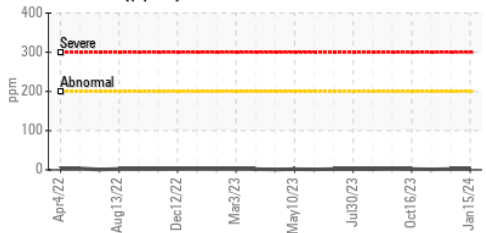

Viscosity @ 100°C

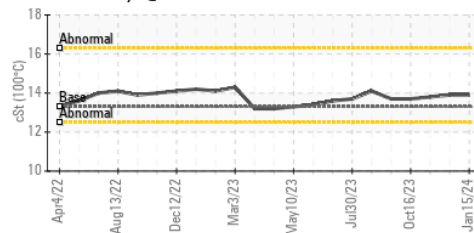

Base Number

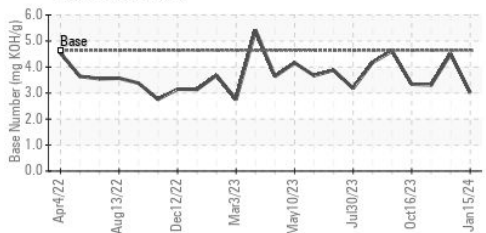

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0106200 **Received** : 22 Jan 2024
Lab Number : 06066963 **Tested** : 24 Jan 2024
Unique Number : 10843640 **Diagnosed** : 04 Feb 2024 - Doug Bogart
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

AMERICAN PETROLEUM
 CARR 865 KM 0.2 CAMPANILA
 TOA BAJA, PR
 US 00949
 Contact: NEFTALI ORTIZ
 nortiz@americanpetroleumpr.com
 T: (787)794-1985
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)