


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

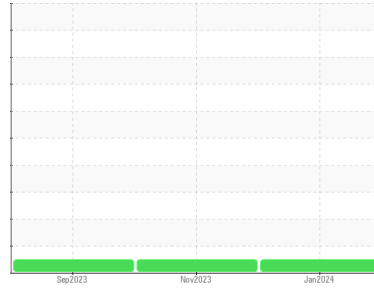

Machine Id  
**2124**  
Component  
**Natural Gas Engine**  
Fluid  
**LO-ASH ENGINE OIL SAE 40 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

### Wear

All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PCA0111226</b>	PCA0111229	PCA0099787
Sample Date	Client Info			<b>12 Jan 2024</b>	28 Nov 2023	05 Sep 2023
Machine Age	hrs	Client Info		<b>97405</b>	96369	94358
Oil Age	hrs	Client Info		<b>4243</b>	3207	1196
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>4</b>	1	2
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>9	<b>2</b>	1	3
Lead	ppm	ASTM D5185m	>30	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>35	<b>2</b>	0	2
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	37	<b>9</b>	8	11
Barium	ppm	ASTM D5185m	12	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	200	<b>11</b>	8	11
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	5	<b>33</b>	35	32
Calcium	ppm	ASTM D5185m	1600	<b>1465</b>	1385	1338
Phosphorus	ppm	ASTM D5185m	300	<b>315</b>	306	300
Zinc	ppm	ASTM D5185m	400	<b>410</b>	412	358
Sulfur	ppm	ASTM D5185m	2600	<b>2444</b>	2454	2635

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	<b>2</b>	1	2
Sodium	ppm	ASTM D5185m		<b>2</b>	0	3
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Fuel	%	ASTM D3524	>4.0	<b>0.1</b>	0.4	0.1

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.9</b>	5.4	4.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.1</b>	18.0	15.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>15.1</b>	13.4	9.4
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>1.38</b>	1.19	0.78
Base Number (BN)	mg KOH/g	ASTM D2896	3.0	<b>2.60</b>	2.42	4.52









# OIL ANALYSIS REPORT

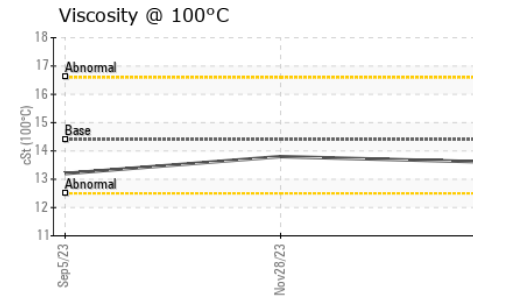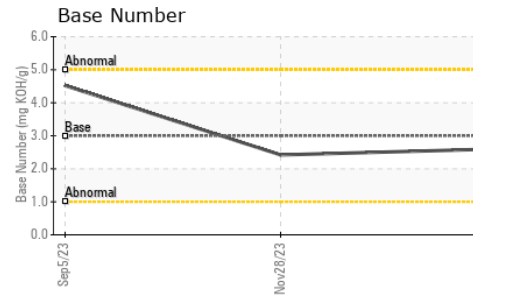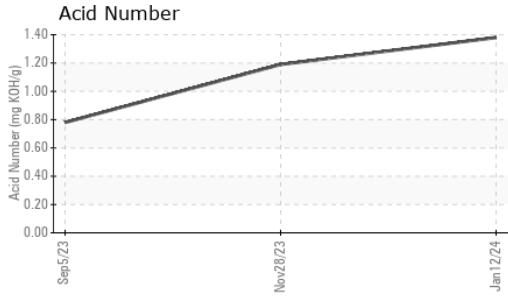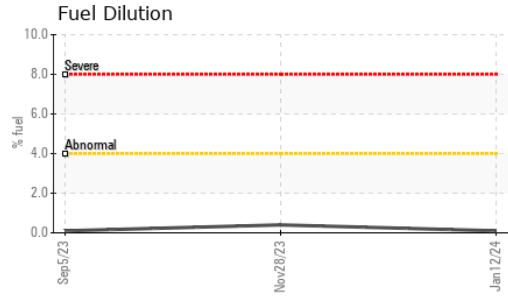

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	14.4	<b>13.6</b>	13.8	13.2

## GRAPHS

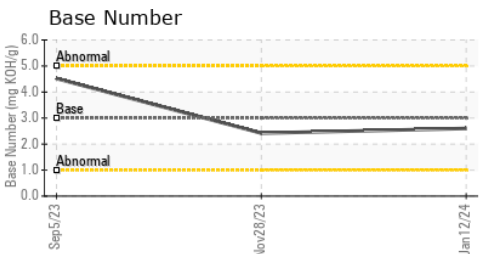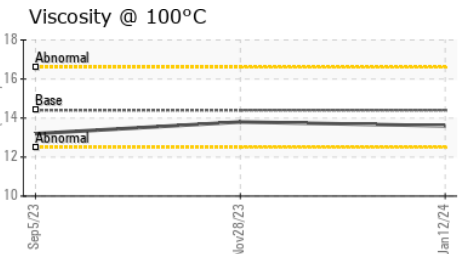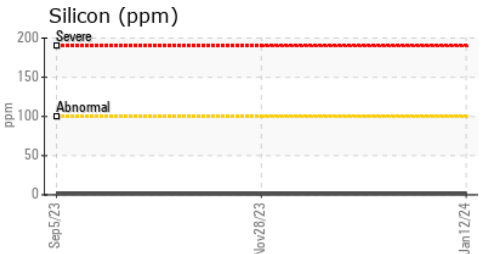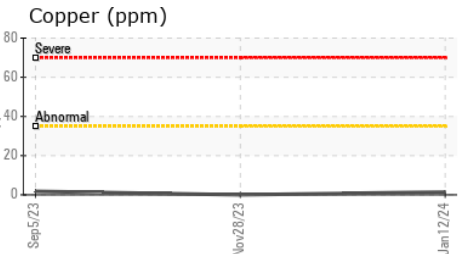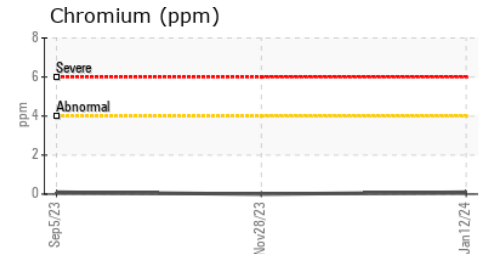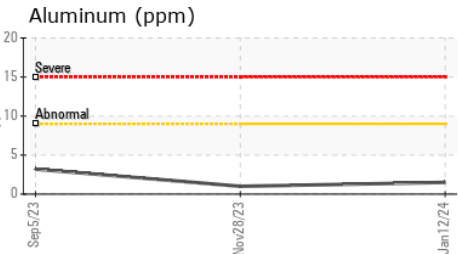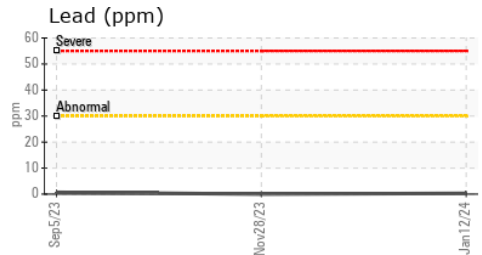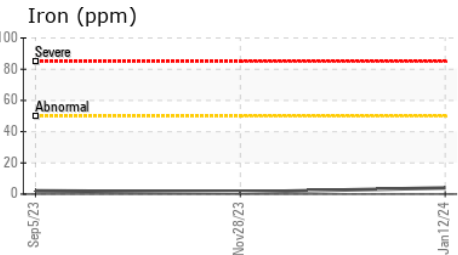

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0111226 **Received** : 23 Jan 2024  
**Lab Number** : 06068706 **Diagnosed** : 25 Jan 2024  
**Unique Number** : 10845383 **Diagnostician** : Wes Davis  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**USA COMPRESSION**  
 375 S MAIN STREET  
 MANSFIELD, PA  
 US 16933

Contact: JASON KUZNESKI  
 jkuzneski@usacompression.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: