


OIL ANALYSIS REPORT

24A Machine Id [24A] 24A Calender - Cooling Rolls Gearbox #4 Component

Gear Drive

MOBIL MOBILGEAR 600 XP 220 (--- GAL)





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct	2020	Aug2023 Jan20	24	
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0076334	PCA0076287	PCA0024765
Sample Date		Client Info		23 Jan 2024	15 Aug 2023	22 Oct 2020
Machine Age	hrs	Client Info		0	8760	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Oil Added	Changed
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
PQ		ASTM D8184		15		
Iron	ppm	ASTM D5185m	>150	0	1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>10	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>50	5	4	3
Tin	ppm	ASTM D5185m	>10	<1	<1	<1
Antimony	ppm	ASTM D5185m	>5			0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		22	18	27
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		<1	<1	<1
Calcium	ppm	ASTM D5185m		3	2	<1
Phosphorus	ppm	ASTM D5185m		281	317	306
Zinc	ppm	ASTM D5185m		4	0	0
Sulfur	ppm	ASTM D5185m		7866	10048	7704
CONTAMINAN	ITS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	5	6	3
Sodium	ppm	ASTM D5185m		1	2	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
FLUID DEGRA	DATION	method	limit/base	current	history1	history2
A '	1/011/	4 OT1 4 D00 45		0.54	0.50	0.400

0.51


Acid Number (AN) mg KOH/g ASTM D8045

0.56

0.486



OIL ANALYSIS REPORT

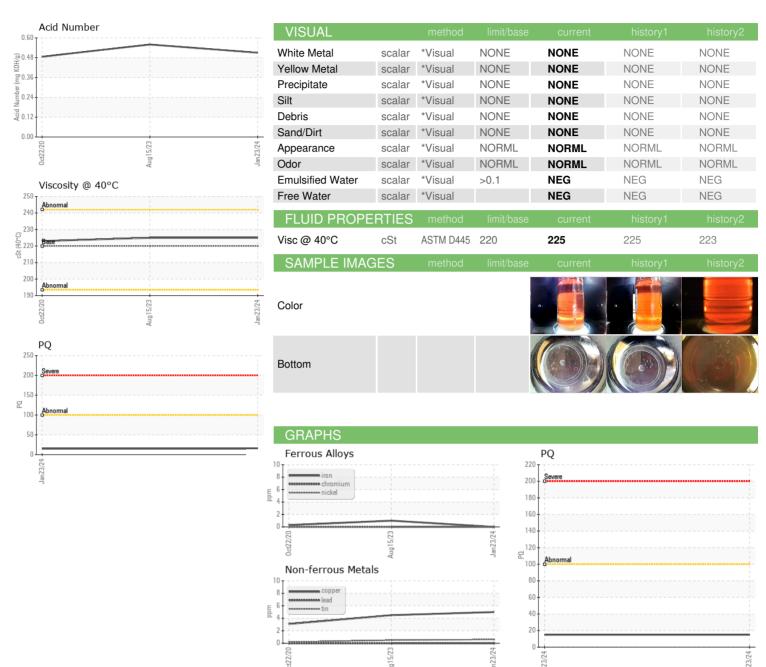





Certificate L2367

Laboratory Sample No.

Lab Number **Unique Number**

Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 24 Jan 2024 : PCA0076334 Recieved : 06070091 Diagnosed : 25 Jan 2024 : Wes Davis : 10846768 Diagnostician

Aug15/23

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Viscosity @ 40°C

240

180

ś 200

ACHILLES USA INC

1407 80TH STREET SW EVERETT, WA US 98203

Contact: TONY DEHLER tdehler@achillesusa.com T: (425)438-4681

F:

Aug15/23

Acid Number

(B) 0.60 W 0.48

Ĕ0.36 흗 0.24

₹ 0.12 0.00 kg