


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

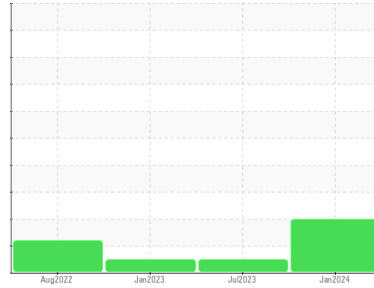

Area
MANTLE LINE 8

Machine Id
HT 81

Component
Agitator Gearbox

Fluid
PETRO CANADA PURITY FG SYNTH EP GEAR 220 (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0111042	USP244672	USP247611
Sample Date	Client Info			22 Jan 2024	28 Jul 2023	30 Jan 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			Not Changed	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	13	8	11
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>10	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	0	<1	0
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>50	0	<1	<1
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	<1	0





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		47	26	45
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		11	6	4
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		2	0	2
Phosphorus	ppm	ASTM D5185m		638	597	611
Zinc	ppm	ASTM D5185m		8	7	6
Sulfur	ppm	ASTM D5185m		9105	7720	10531

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	18	45	16
Sodium	ppm	ASTM D5185m		3	2	2
Potassium	ppm	ASTM D5185m	>20	0	2	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 95914	3422	16706
Particles >6µm		ASTM D7647	>2500	▲ 26590	361	1631
Particles >14µm		ASTM D7647	>640	▲ 992	30	82
Particles >21µm		ASTM D7647	>160	▲ 187	5	21
Particles >38µm		ASTM D7647	>40	3	0	3
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	▲ 24/22/17	19/16/12	21/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.59	1.00	0.88	1.06


OIL ANALYSIS REPORT

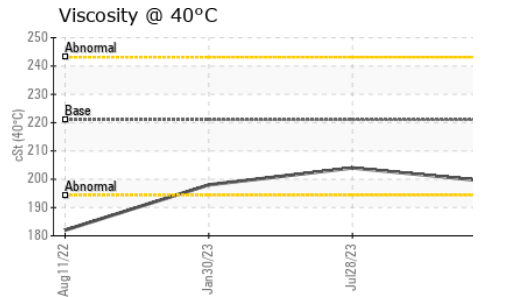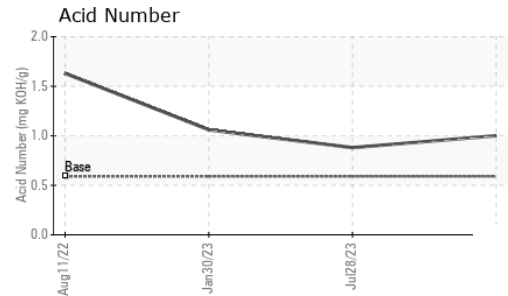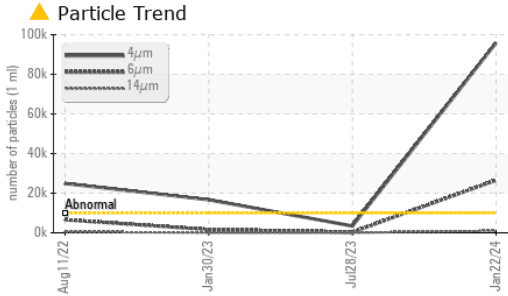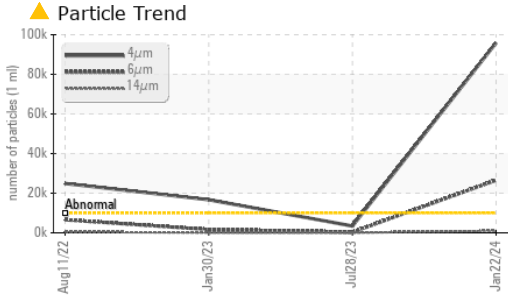






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 221	199	204	198

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

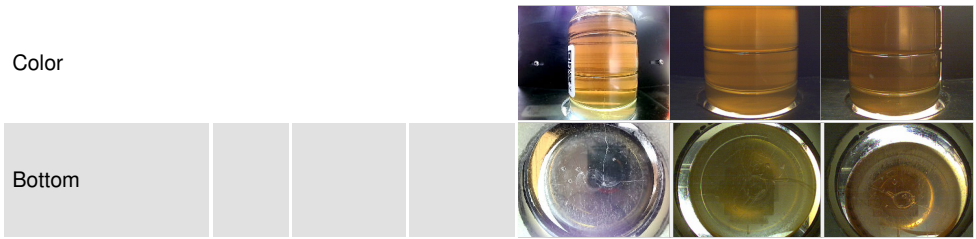

GRAPHS

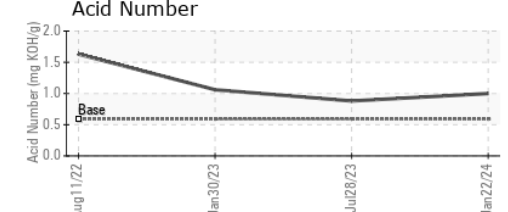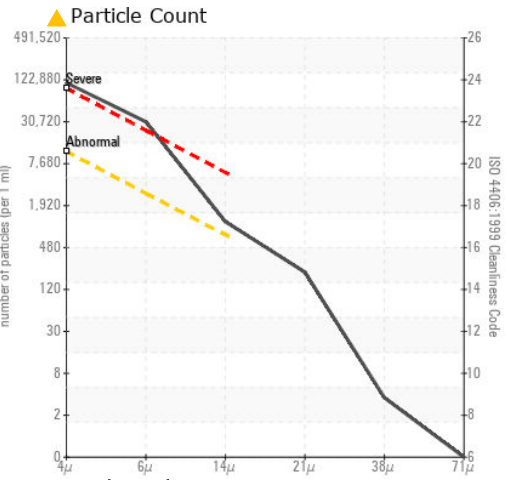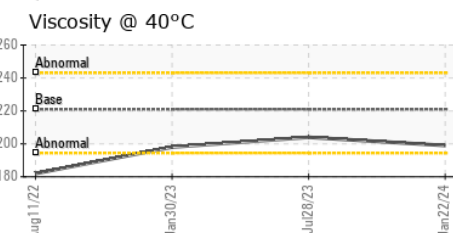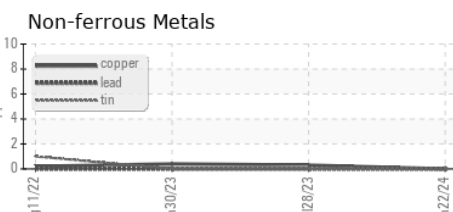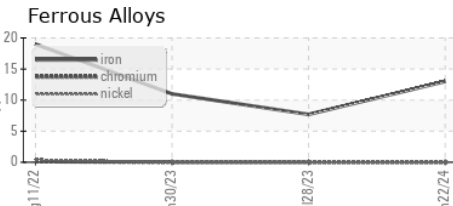

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111042 **Received** : 25 Jan 2024
Lab Number : 06070456 **Diagnosed** : 28 Jan 2024
Unique Number : 10847133 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Mason City - Plant 8360
 1022 12TH ST
 MASON CITY, IA
 US 50401
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: (641)421-2936