


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

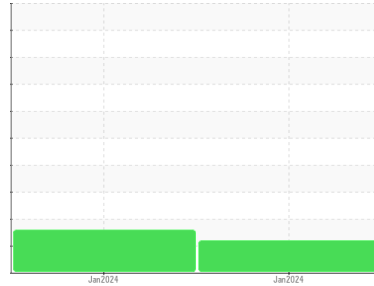

Area
DINNERS [98709269 AFTER]
 Machine Id
L21 MAIN DRIVE FILLER HEAD TRANSFER
 Component
Gearbox
 Fluid
GEAR OIL ISO 320 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. (after).

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0108436	PCA0108437	---
Sample Date	Client Info			20 Jan 2024	19 Jan 2024	---
Machine Age	hrs	Client Info		0	0	---
Oil Age	hrs	Client Info		0	0	---
Oil Changed	Client Info			N/A	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	1	29	---
Chromium	ppm	ASTM D5185m	>15	<1	<1	---
Nickel	ppm	ASTM D5185m	>15	0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	3	3	---
Lead	ppm	ASTM D5185m	>100	0	0	---
Copper	ppm	ASTM D5185m	>200	0	<1	---
Tin	ppm	ASTM D5185m	>25	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	0	0	---
Barium	ppm	ASTM D5185m	15	0	0	---
Molybdenum	ppm	ASTM D5185m	15	0	0	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m	50	<1	<1	---
Calcium	ppm	ASTM D5185m	50	<1	<1	---
Phosphorus	ppm	ASTM D5185m	350	471	711	---
Zinc	ppm	ASTM D5185m	100	3	34	---
Sulfur	ppm	ASTM D5185m	12500	1365	1992	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	2	6	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	1	2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 33762	▲ 137605	---
Particles >6µm		ASTM D7647	>2500	▲ 3857	▲ 41885	---
Particles >14µm		ASTM D7647	>640	126	206	---
Particles >21µm		ASTM D7647	>160	35	26	---
Particles >38µm		ASTM D7647	>40	1	2	---
Particles >71µm		ASTM D7647	>10	0	1	---
Oil Cleanliness		ISO 4406 (c)	>20/18/16	▲ 22/19/14	▲ 24/23/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.48	0.56	---


OIL ANALYSIS REPORT

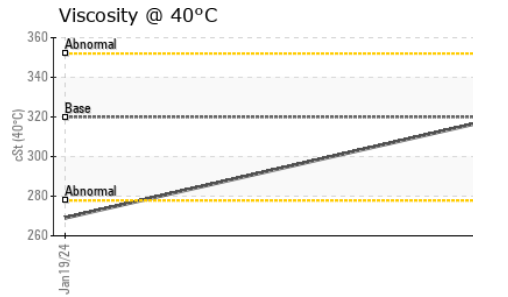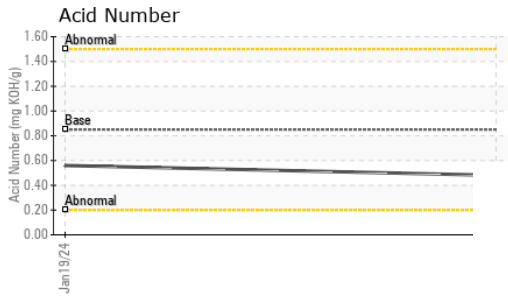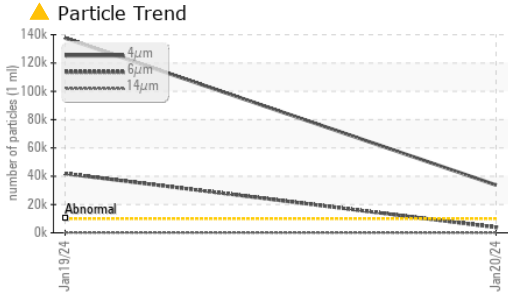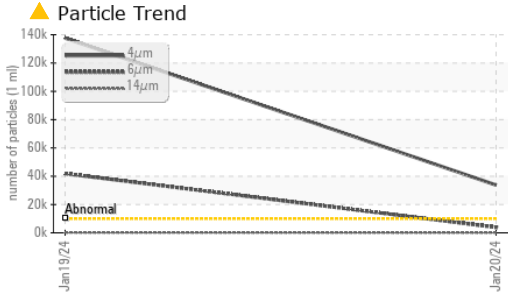






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 320	319	▲ 269	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

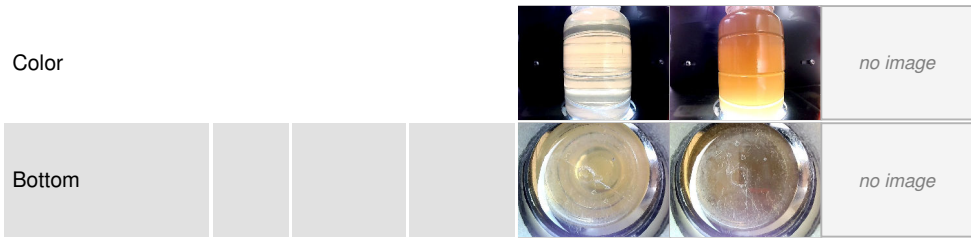

GRAPHS

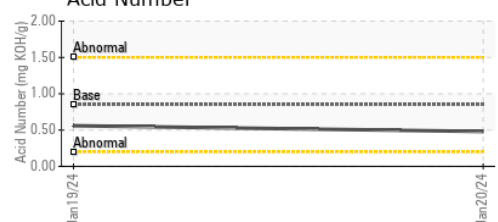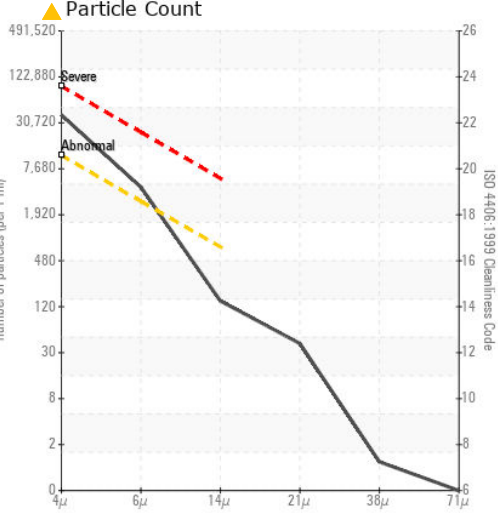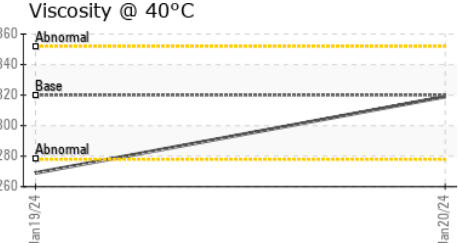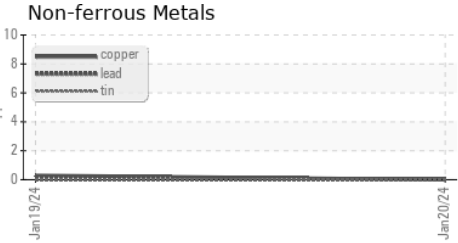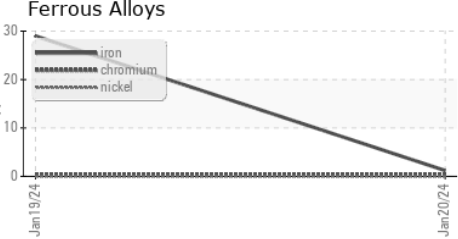

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0108436 **Received** : 26 Jan 2024
Lab Number : 06071648 **Diagnosed** : 30 Jan 2024
Unique Number : 10848325 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: