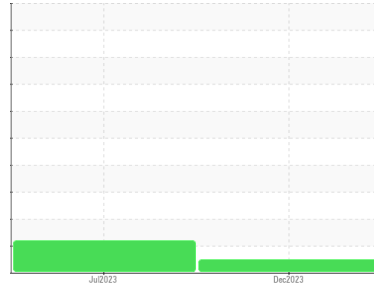


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

 Area
(36762)

 Machine Id
1

 Component
Diesel Engine

 Fluid
AMSOIL PREMIUM 5W40 SYNTHETIC (--- GAL)
DIAGNOSIS
Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

Wear

Metal levels are typical for a new component breaking in.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0013556	PCA0013565	---
Sample Date	Client Info		27 Dec 2023	18 Jul 2023	---
Machine Age	mls	Client Info	1774	36762	---
Oil Age	mls	Client Info	278	1766	---
Oil Changed	Client Info		Changed	N/A	---
Sample Status			NORMAL	MARGINAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	▲ 3.7	---
Water	WC Method	>0.2	NEG	NEG	---
Glycol	WC Method		NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	29	12	---
Chromium	ppm	ASTM D5185m >20	<1	0	---
Nickel	ppm	ASTM D5185m >4	0	0	---
Titanium	ppm	ASTM D5185m	<1	<1	---
Silver	ppm	ASTM D5185m >3	0	0	---
Aluminum	ppm	ASTM D5185m >20	24	8	---
Lead	ppm	ASTM D5185m >40	0	0	---
Copper	ppm	ASTM D5185m >330	26	6	---
Tin	ppm	ASTM D5185m >15	<1	0	---
Vanadium	ppm	ASTM D5185m	0	<1	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	53	76	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	<1	---
Manganese	ppm	ASTM D5185m	1	<1	---
Magnesium	ppm	ASTM D5185m	700	661	---
Calcium	ppm	ASTM D5185m	1177	1232	---
Phosphorus	ppm	ASTM D5185m	1113	1049	---
Zinc	ppm	ASTM D5185m	1275	1219	---
Sulfur	ppm	ASTM D5185m	3539	4162	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	7	6	---
Sodium	ppm	ASTM D5185m	4	4	---
Potassium	ppm	ASTM D5185m >20	18	11	---



INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.3	0.2	---
Nitration	Abs/cm	*ASTM D7624 >20	10.9	9.8	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	23.4	19.5	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	16.7	14.2	---
Base Number (BN)	mg KOH/g	ASTM D2896 10.4	7.58	15.07	---









OIL ANALYSIS REPORT

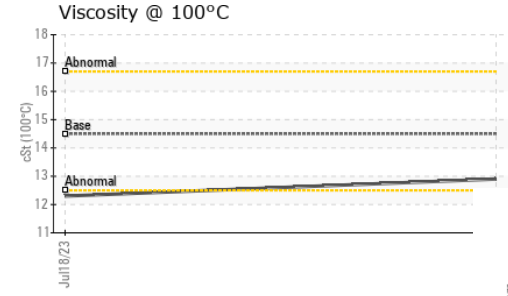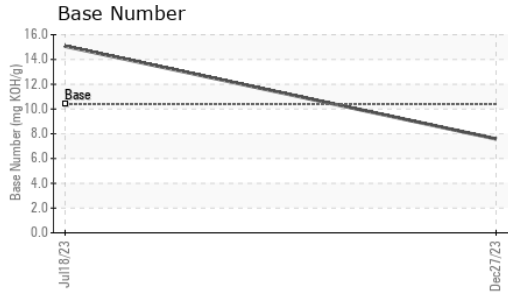

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.5	12.9	▲ 12.3

GRAPHS

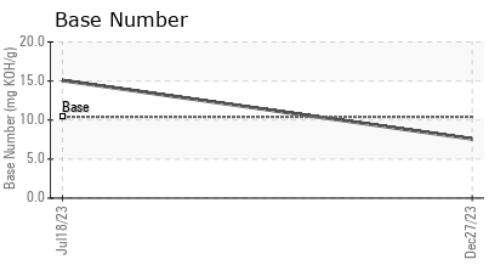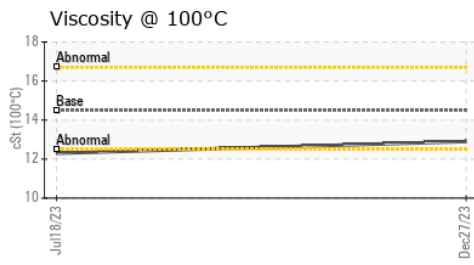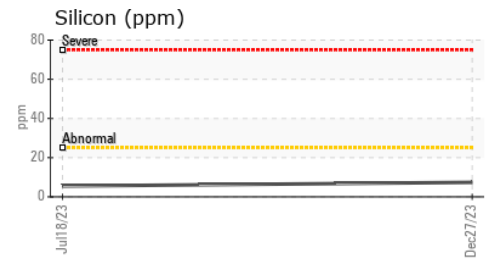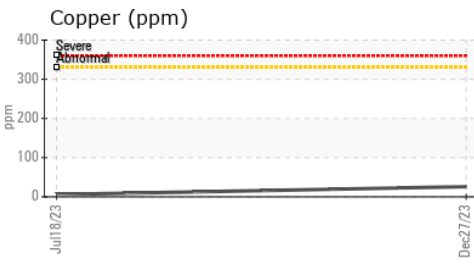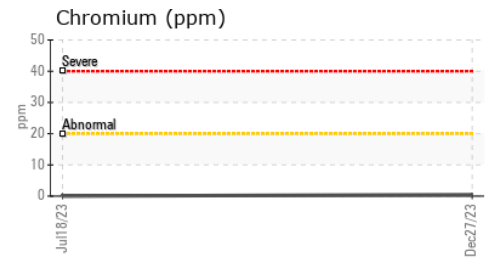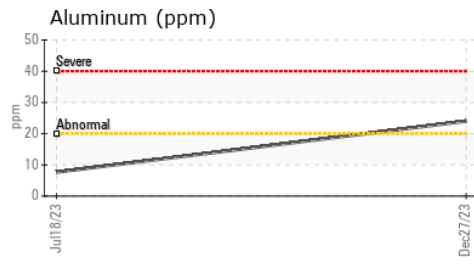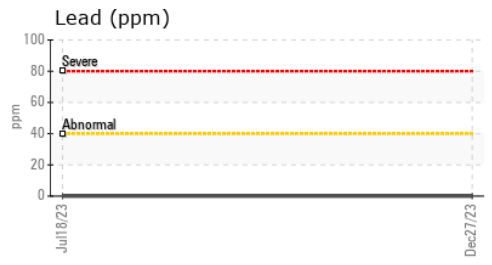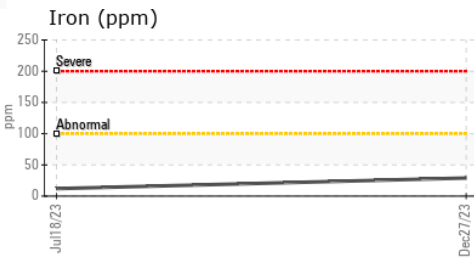

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0013556 **Received** : 26 Jan 2024
Lab Number : 06071866 **Diagnosed** : 29 Jan 2024
Unique Number : 10848543 **Diagnostician** : Wes Davis
Test Package : MOB 2

DOCTOR DIESEL
 2 BISHOP PATH
 SANDWICH, MA
 US 02563
 Contact: JEREMY MENDES
 doctordiesel2004@gmail.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: