

OIL ANALYSIS REPORT

Sample Rating Trend



VISCOSITY



Area
PROCESS CHEESE [98739264]
 Machine Id
SODIUM HYDROXIDE BAY (S/N UP900137)
 Component
Pump
 Fluid
ISO 68 (1 LTR)

DIAGNOSIS

Recommendation
 The oil change at the time of sampling has been noted. We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0114282	---	---
Sample Date	Client Info	21 Jan 2024	---	---
Machine Age	days	0	---	---
Oil Age	days	0	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >.1	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	0	---	---
Chromium	ppm ASTM D5185m >5	<1	---	---
Nickel	ppm ASTM D5185m >5	0	---	---
Titanium	ppm ASTM D5185m >3	<1	---	---
Silver	ppm ASTM D5185m >3	0	---	---
Aluminum	ppm ASTM D5185m >7	2	---	---
Lead	ppm ASTM D5185m >12	0	---	---
Copper	ppm ASTM D5185m >30	<1	---	---
Tin	ppm ASTM D5185m >9	<1	---	---
Vanadium	ppm ASTM D5185m	0	---	---
Cadmium	ppm ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	---	---
Barium	ppm ASTM D5185m	0	---	---
Molybdenum	ppm ASTM D5185m	<1	---	---
Manganese	ppm ASTM D5185m	0	---	---
Magnesium	ppm ASTM D5185m	0	---	---
Calcium	ppm ASTM D5185m	1	---	---
Phosphorus	ppm ASTM D5185m	496	---	---
Zinc	ppm ASTM D5185m	0	---	---
Sulfur	ppm ASTM D5185m	1386	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >60	2	---	---
Sodium	ppm ASTM D5185m	0	---	---
Potassium	ppm ASTM D5185m >20	2	---	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	▲ 29838	---	---
Particles >6µm	ASTM D7647 >320	▲ 5690	---	---
Particles >14µm	ASTM D7647 >80	41	---	---
Particles >21µm	ASTM D7647 >20	5	---	---
Particles >38µm	ASTM D7647 >4	0	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 22/20/13	---	---

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D8045	0.28	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

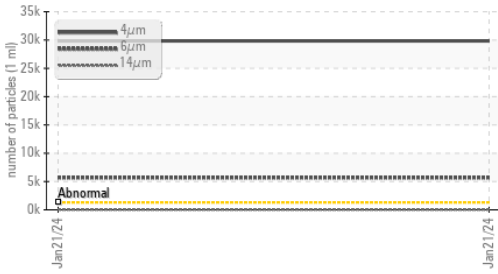


▲ Viscosity @ 40°C

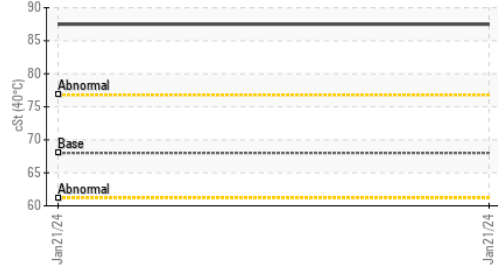

▲ Particle Trend

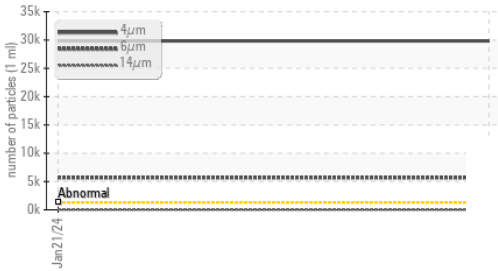

Acid Number

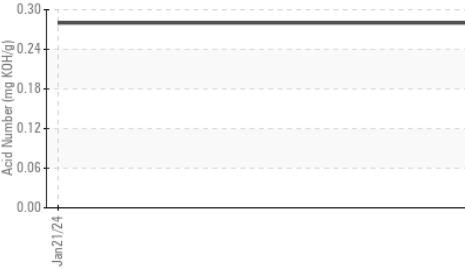





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0 ▲ 87.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

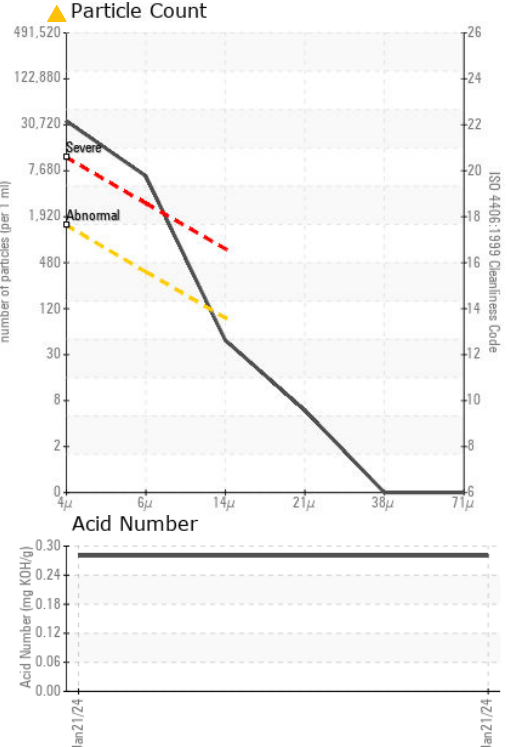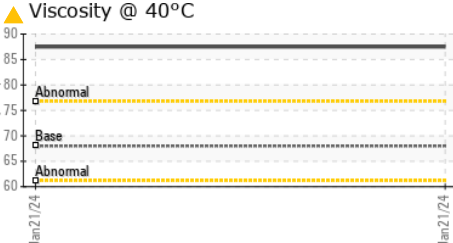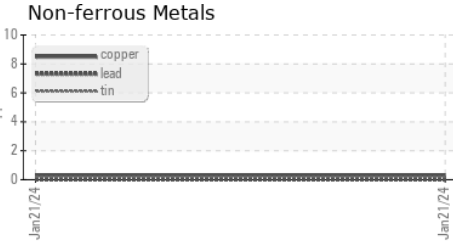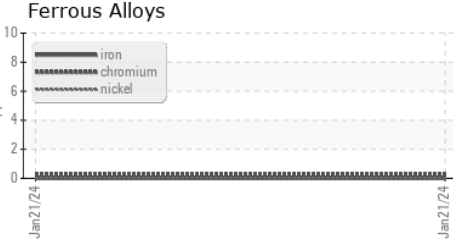

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0114282 **Received** : 30 Jan 2024
Lab Number : 06074667 **Diagnosed** : 01 Feb 2024
Unique Number : 10856758 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: