OIL ANALYSIS REPORT

OIL DIAGNOSTICS

Sample Rating Trend

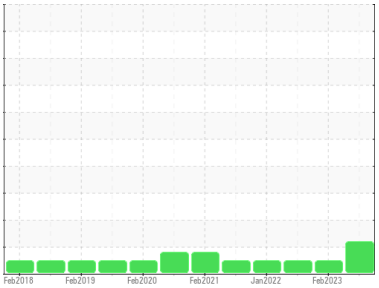

ISO

Area
PLANT 1 [907260193]
Machine Id
INGERSOLL RAND SSR-EP125 AIR COMP 1 (S/N F12823U95342)
Component
Air Compressor
Fluid
INGERSOLL-RAND ULTRA FG (18 GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PCA0103372**	PCA0071503	PCA0060089
Sample Date		Client Info		**23 Jan 2024**	02 Feb 2023	09 Aug 2022
Machine Age	hrs	Client Info		**6052**	97848	93655
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**Not Changd**	Not Changd	Not Changd
Sample Status				**ABNORMAL**	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	**NEG**	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>70	**0**	0	<1
Chromium	ppm	ASTM D5185m	>15	**0**	0	0
Nickel	ppm	ASTM D5185m	>6	**0**	<1	0
Titanium	ppm	ASTM D5185m		**<1**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	0	<1
Lead	ppm	ASTM D5185m	>20	**<1**	<1	0
Copper	ppm	ASTM D5185m	>80	**<1**	0	0
Tin	ppm	ASTM D5185m	>15	**<1**	<1	0
Antimony	ppm	ASTM D5185m		**---**	---	---
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**<1**	<1	4
Molybdenum	ppm	ASTM D5185m		**0**	0	0
Manganese	ppm	ASTM D5185m		**<1**	0	0
Magnesium	ppm	ASTM D5185m		**1**	<1	<1
Calcium	ppm	ASTM D5185m		**18**	73	58
Phosphorus	ppm	ASTM D5185m		**239**	247	124
Zinc	ppm	ASTM D5185m		**3**	3	7
Sulfur	ppm	ASTM D5185m		**424**	618	298

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>12	**<1**	<1	0
Sodium	ppm	ASTM D5185m		**27**	14	18
Potassium	ppm	ASTM D5185m	>20	**4**	4	3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ **51478**	1572	1145
Particles >6µm		ASTM D7647	>2500	▲ **9409**	564	217
Particles >14µm		ASTM D7647	>320	**311**	53	15
Particles >21µm		ASTM D7647	>80	**48**	13	4
Particles >38µm		ASTM D7647	>20	**0**	1	1
Particles >71µm		ASTM D7647	>4	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ **23/20/15**	18/16/13	17/15/11

OIL DIAGNOSTICS

OIL ANALYSIS REPORT

Particle Trend

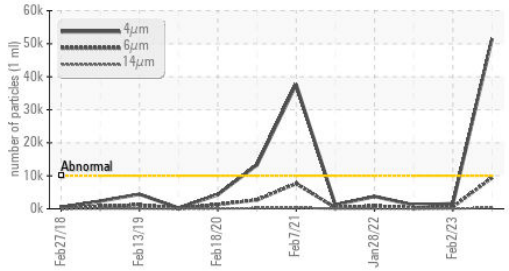

Particle Trend

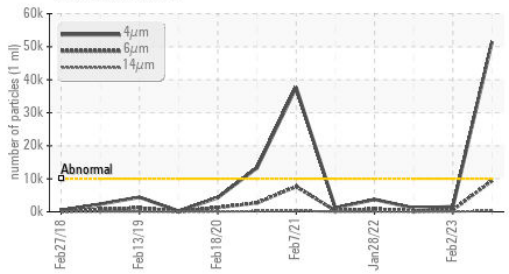

Acid Number

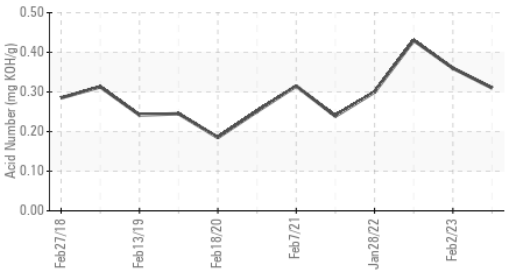

Viscosity @ 40°C

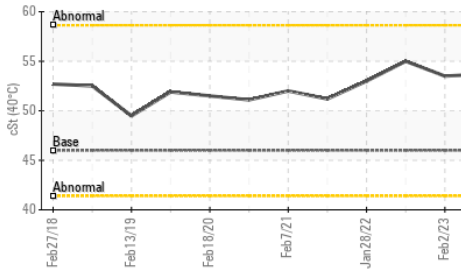

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.31**	0.36	0.43

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.0	**53.7**	53.5	55.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

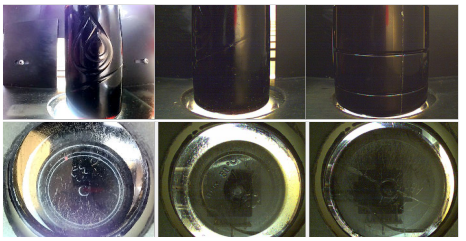

GRAPHS

Ferrous Alloys

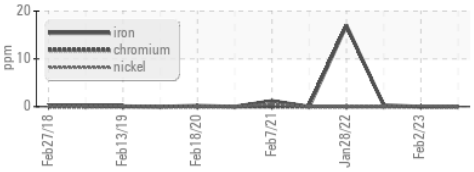

Non-ferrous Metals

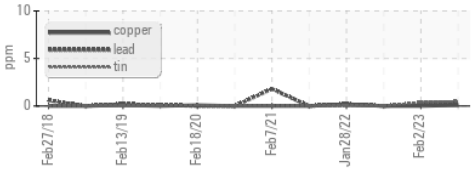

Viscosity @ 40°C

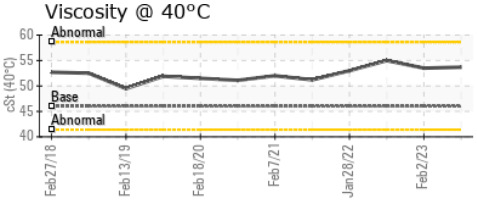

Particle Count

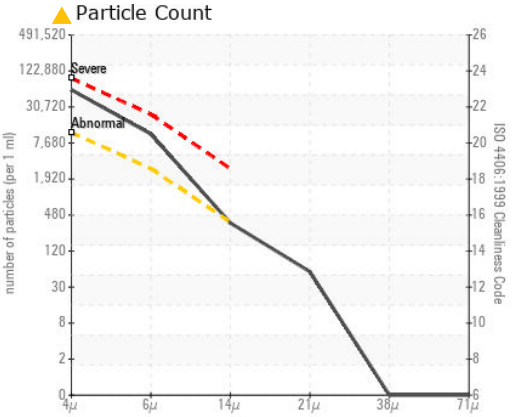

Acid Number

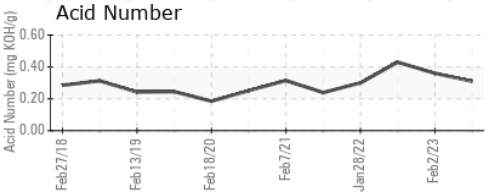

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0103372 **Recieved** : 01 Feb 2024
Lab Number : 06076832 **Diagnosed** : 02 Feb 2024
Unique Number : 10858923 **Diagnostician** : Don Baldridge
Test Package : IND 2 (Additional Tests: PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MCCAIN FOODS
319 RICHARDSON RD
EASTON, ME
US 04740
Contact: HADLEY MCNAMEE
hadley.mcnamee@mccain.ca
T: (207)488-1335
F: (207)488-1249