


OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION

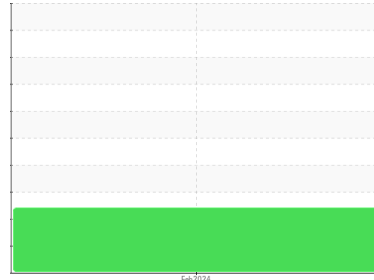

Machine Id
RESIDUE 2
 Component
Biogas Engine
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil and perform a filter service on this component if not already done. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

▲ Fluid Condition

The BN level is low. The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0118699	---	---
Sample Date	Client Info		05 Feb 2024	---	---
Machine Age	hrs	Client Info	50423	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	---	---
Glycol	WC Method		NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >45	20	---	---
Chromium	ppm	ASTM D5185m >2	<1	---	---
Nickel	ppm	ASTM D5185m >2	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >10	2	---	---
Lead	ppm	ASTM D5185m >5	0	---	---
Copper	ppm	ASTM D5185m >14	3	---	---
Tin	ppm	ASTM D5185m >13	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	5	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	3	---	---
Calcium	ppm	ASTM D5185m	1441	---	---
Phosphorus	ppm	ASTM D5185m	344	---	---
Zinc	ppm	ASTM D5185m	373	---	---
Sulfur	ppm	ASTM D5185m	3544	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >200	<1	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	1	---	---
Fuel	%	ASTM D3524 >4.0	0.4	---	---





INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	---	---
Nitration	Abs/cm	*ASTM D7624 >20	15.4	---	---
Sulfation	Abs/.1mm	*ASTM D7415 >30	28.7	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	34.7	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ 5.261	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	▲ 1.53	---	---









OIL ANALYSIS REPORT

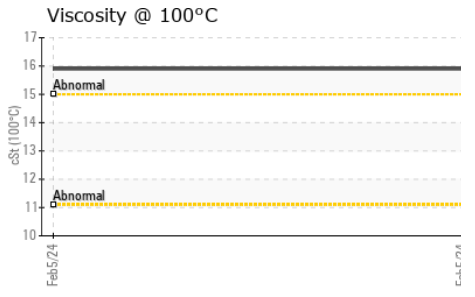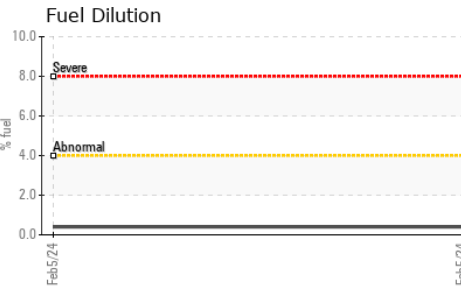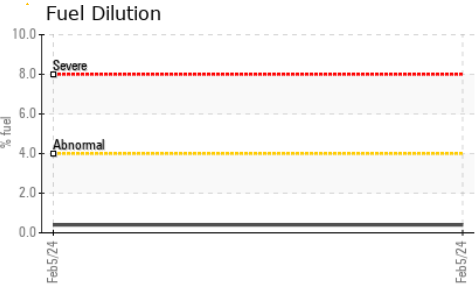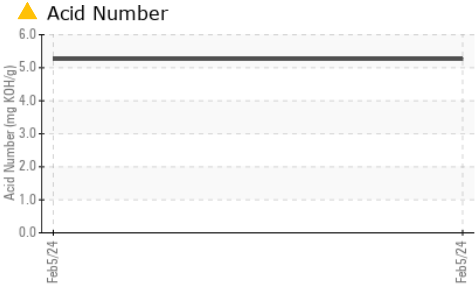

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.9	---	---

GRAPHS

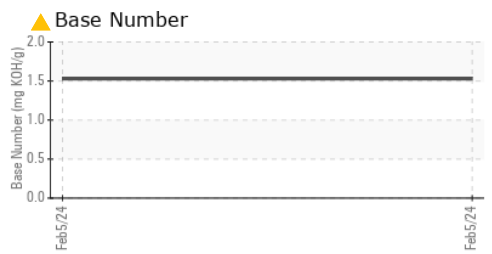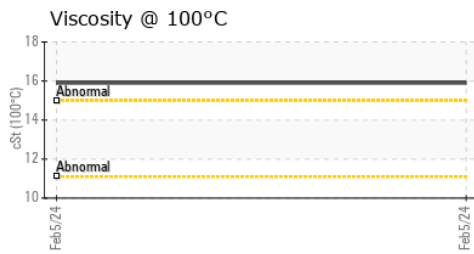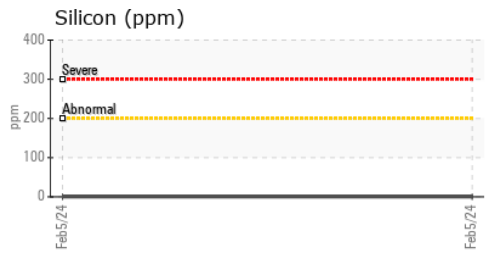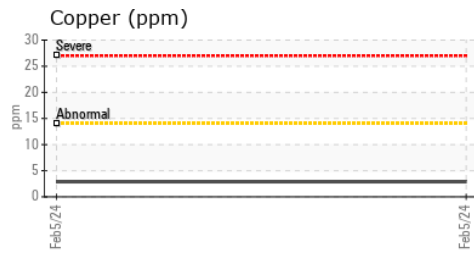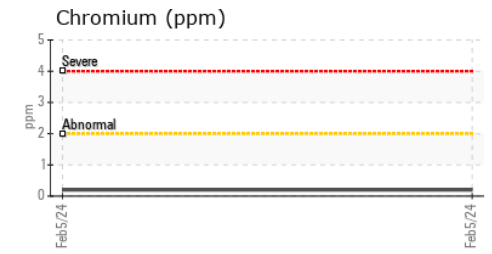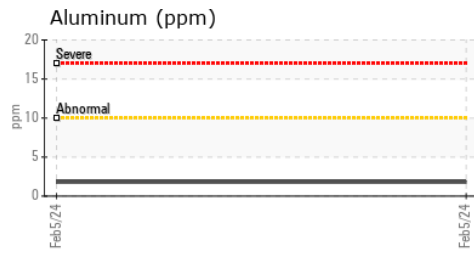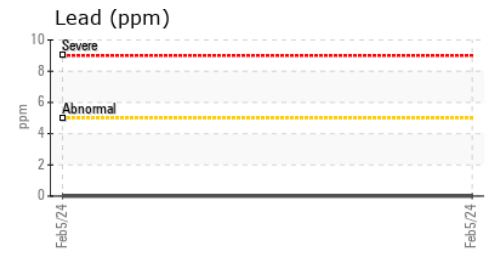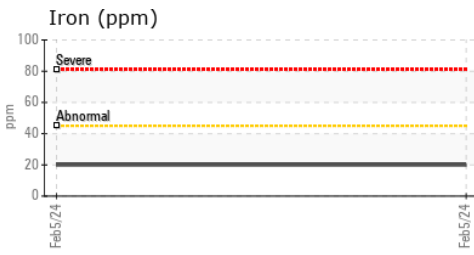

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0118699 **Received** : 05 Feb 2024
Lab Number : 06080894 **Tested** : 07 Feb 2024
Unique Number : 10862985 **Diagnosed** : 07 Feb 2024 - Sean Felton
Test Package : MOB 2 (Additional Tests: FuelDilution, PercentFuel)

DIVERSIFIED ENERGY - FRIERSON
 1716 FRIENDSHIP RD
 FRIERSON, LA
 US 71027
 Contact: ERIC FEUCHTENBERGER
 efeuchtenberger@dgoc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)