


# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

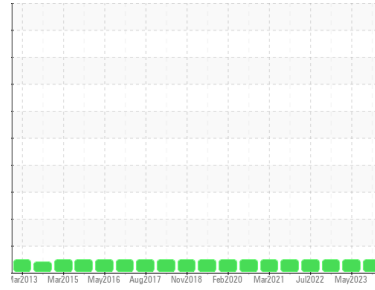

Area  
**DRYING [908193431]**  
 Machine Id  
**[DRYING] DB-13017 DB-13017**  
 Component  
**Gearbox**  
 Fluid  
**PETRO CANADA PURITY FG SYNTH EP GEAR 220 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.  
 NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PCA0111066</b>	PCA0078586	PCA0077242
Sample Date	Client Info	<b>23 Jan 2024</b>	11 May 2023	13 Oct 2022
Machine Age	hrs	Client Info	4201	4201
Oil Age	hrs	Client Info	<b>4201</b>	0
Oil Changed	Client Info	<b>N/A</b>	Not Changd	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184	<b>8</b>	12	7
Iron	ppm ASTM D5185m >200	<b>0</b>	2	<1
Chromium	ppm ASTM D5185m >15	<b>&lt;1</b>	0	0
Nickel	ppm ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	0	0
Silver	ppm ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >25	<b>2</b>	0	1
Lead	ppm ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm ASTM D5185m >200	<b>&lt;1</b>	0	<1
Tin	ppm ASTM D5185m >25	<b>0</b>	<1	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>2</b>	11	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	0	0
Manganese	ppm ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm ASTM D5185m	<b>0</b>	14	0
Calcium	ppm ASTM D5185m	<b>23</b>	15	17
Phosphorus	ppm ASTM D5185m	<b>501</b>	519	555
Zinc	ppm ASTM D5185m	<b>0</b>	88	27
Sulfur	ppm ASTM D5185m	<b>463</b>	559	607




## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	<b>4</b>	5	6
Sodium	ppm ASTM D5185m	<b>0</b>	0	0
Potassium	ppm ASTM D5185m >20	<b>0</b>	<1	0

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.59	<b>0.45</b>	0.50	0.53


# OIL ANALYSIS REPORT

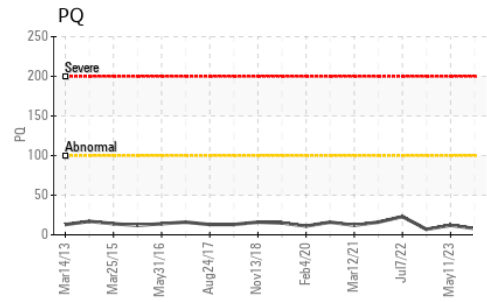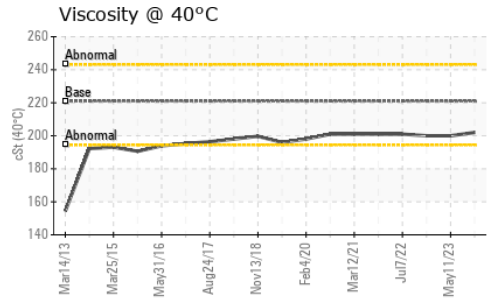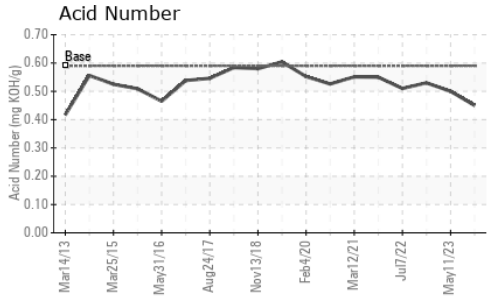






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 221	202	200	200

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

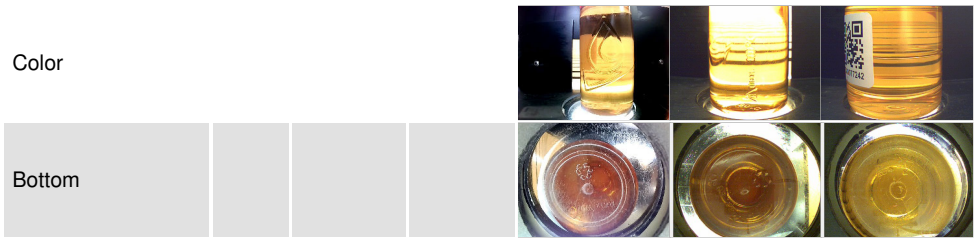

## GRAPHS

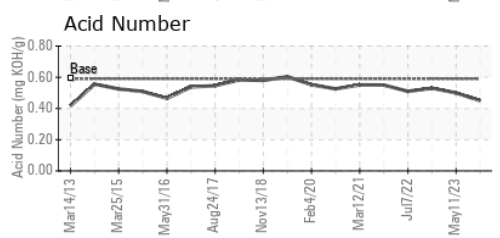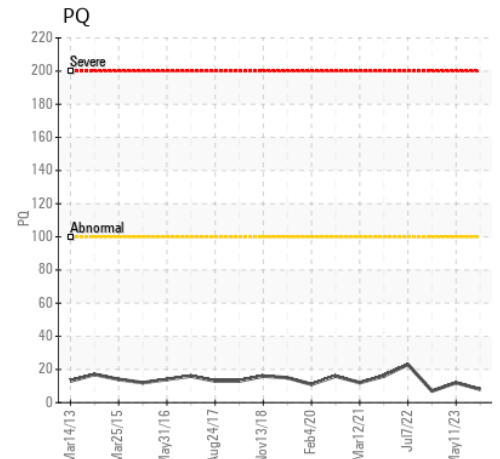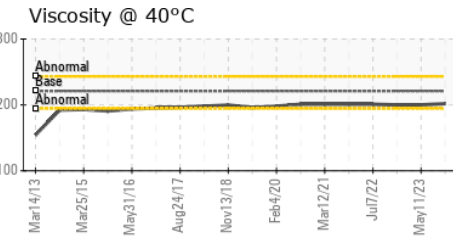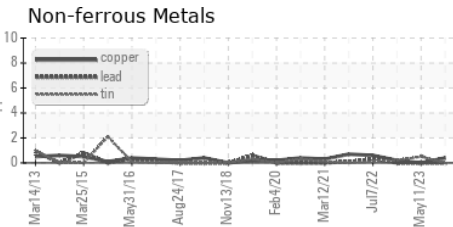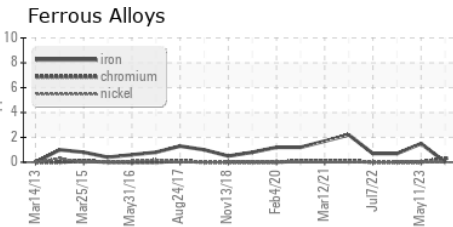

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0111066 **Received** : 07 Feb 2024  
**Lab Number** : 06082685 **Tested** : 08 Feb 2024  
**Unique Number** : 10870130 **Diagnosed** : 08 Feb 2024 - Wes Davis  
**Test Package** : IND 2 ( Additional Tests: PQ )

**THE HERSHEY COMPANY**  
 WEST HERSHEY - TECHNICAL ASSURANCE, 1033 OLDE WEST CHOCOLATE  
 HERSHEY, PA  
 US 17033  
 Contact: CLINTON ZOHNER  
 clintzohner@hersheys.com  
 T: (717)374-4846  
 F: (717)374-4594

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)