


# OIL ANALYSIS REPORT

Sample Rating Trend

**VISUAL METAL**

Area  
**PONCA CITY**  
 Machine Id  
**Unit 02 DB130102E**  
 Component  
**Natural Gas Engine**  
 Fluid  
**PETRO CANADA DURON MONOGRADE HD 40W (350 GAL)**

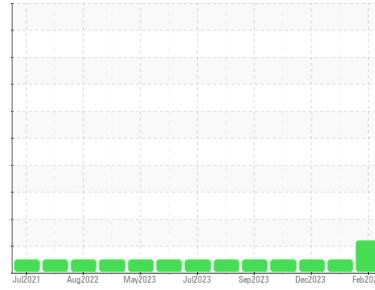

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

Moderate concentration of visible metal present. All component wear rates are normal.

### Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0100325</b>	PCA0100324	PCA0100327
Sample Date	Client Info		<b>05 Feb 2024</b>	09 Jan 2024	06 Dec 2023
Machine Age	hrs	Client Info	<b>1612</b>	1163	442
Oil Age	hrs	Client Info	<b>1612</b>	1163	442
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ABNORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>10</b>	4	4
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >9	<b>2</b>	1	1
Lead	ppm	ASTM D5185m >30	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >35	<b>1</b>	<1	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>3</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>5</b>	2	1
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>5</b>	2	2
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>1525</b>	900	1025
Calcium	ppm	ASTM D5185m	<b>1626</b>	1016	1110
Phosphorus	ppm	ASTM D5185m	<b>1683</b>	1022	1252
Zinc	ppm	ASTM D5185m	<b>2192</b>	1308	1440
Sulfur	ppm	ASTM D5185m	<b>4983</b>	2992	3587

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >+100	<b>6</b>	2	6
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	0	0
Fuel	%	ASTM D3524 >4.0	<b>1.2</b>	1.0	0.9





## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>4.0</b>	3.9	3.8
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>13.4</b>	13.5	13.0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>7.1</b>	7.1	7.0
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.55</b>	1.51	2.31
Base Number (BN)	mg KOH/g	ASTM D2896 8.5	<b>8.63</b>	8.41	8.43









# OIL ANALYSIS REPORT

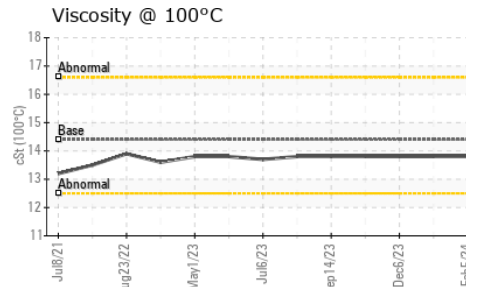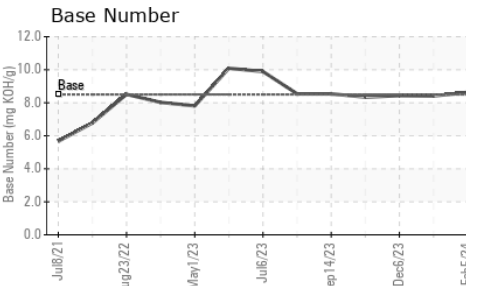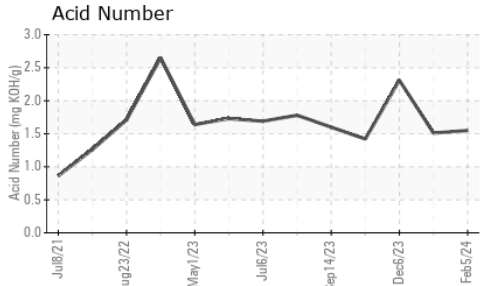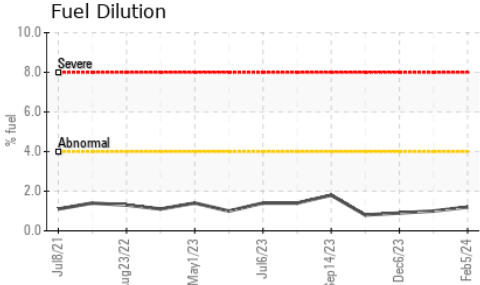

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	▲ MODER	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.8	13.8

## GRAPHS

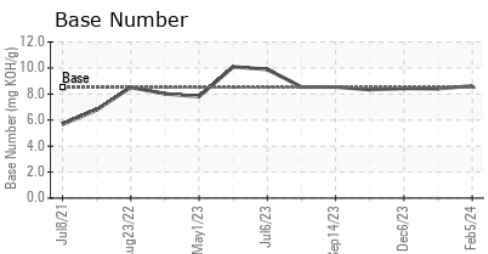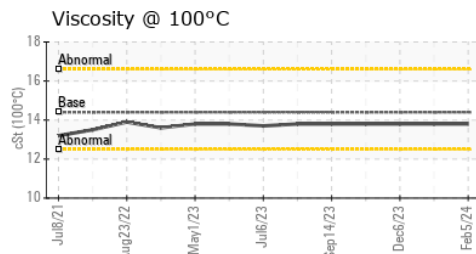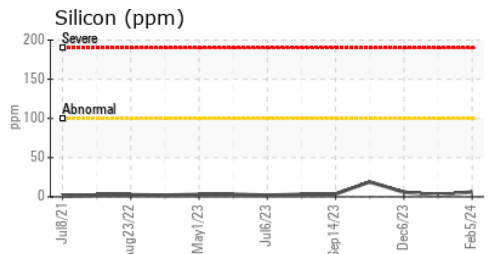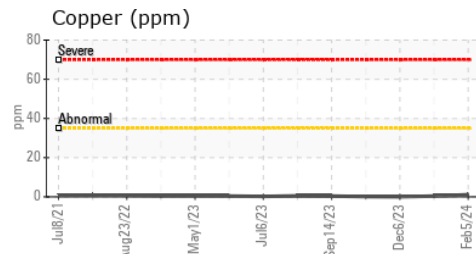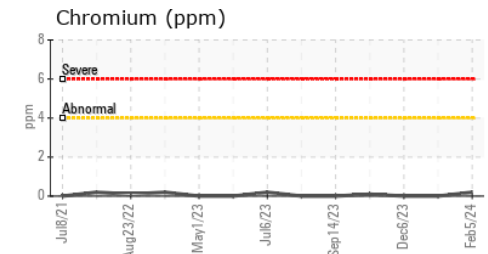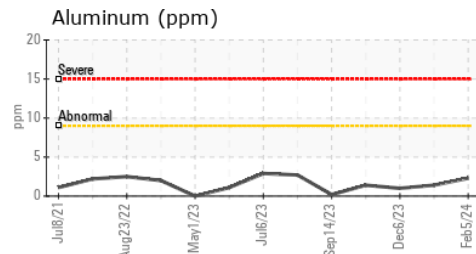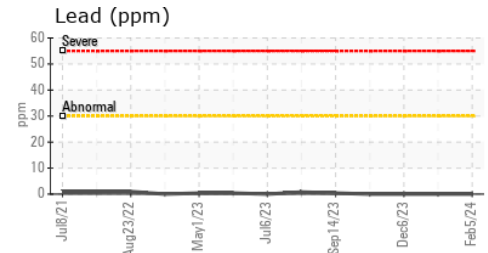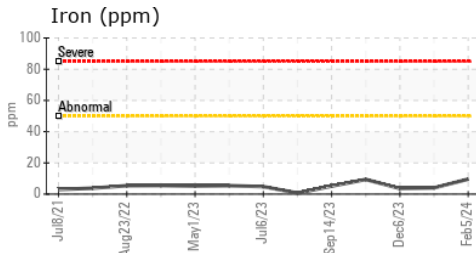

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0100325 **Received** : 13 Feb 2024  
**Lab Number** : 06087598 **Tested** : 14 Feb 2024  
**Unique Number** : 10875043 **Diagnosed** : 14 Feb 2024 - Sean Felton  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, PercentFuel )

**Magellan Midstream LP - Ponca City**  
 3990 South Union Street  
 Ponca City, OK  
 US 74601  
 Contact: Jake Daniel  
 Jacob.Daniel@magellanlp.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: