


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

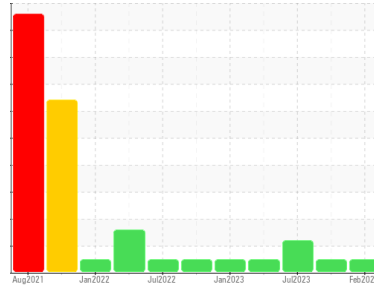

Area
Galv Line
Machine Id
[Galv Line] 640110-STEERING UNIT 3
Component
Hydraulic System
Fluid
QUAKER CHEMICAL QUINTOLUBRIC 865-68 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0112936	PCA0107724	PCA0095503
Sample Date	Client Info	12 Feb 2024	25 Oct 2023	01 Jul 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >20	2	0	3
Chromium	ppm	ASTM D5185m >20	0	0	0
Nickel	ppm	ASTM D5185m >20	0	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >20	<1	<1	0
Lead	ppm	ASTM D5185m >20	0	0	<1
Copper	ppm	ASTM D5185m >20	7	6	6
Tin	ppm	ASTM D5185m >20	126	128	122
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	4
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	<1	4	<1
Calcium	ppm	ASTM D5185m	<1	3	<1
Phosphorus	ppm	ASTM D5185m	122	139	126
Zinc	ppm	ASTM D5185m	28	22	18
Sulfur	ppm	ASTM D5185m	7187	7731	8057

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >15	<1	0	0
Sodium	ppm	ASTM D5185m	<1	0	0
Potassium	ppm	ASTM D5185m >20	5	<1	<1
Water	%	ASTM D6304 >0.05	NEG	NEG	NEG





FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	2785	2071	---
Particles >6µm	ASTM D7647 >1300	769	509	---
Particles >14µm	ASTM D7647 >160	60	28	---
Particles >21µm	ASTM D7647 >40	19	7	---
Particles >38µm	ASTM D7647 >10	1	0	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >19/17/14	19/17/13	18/16/12	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.7	4.87	4.52	4.37


OIL ANALYSIS REPORT

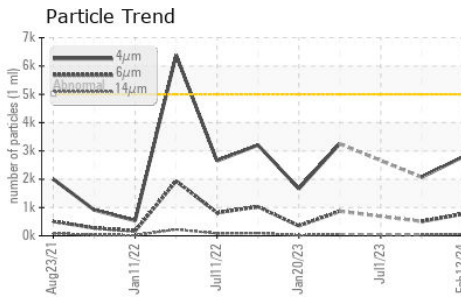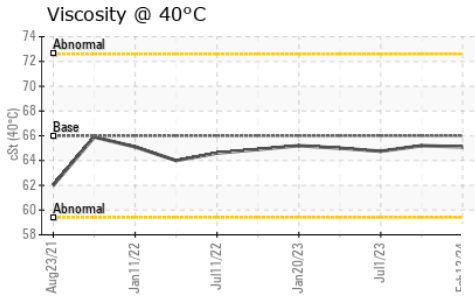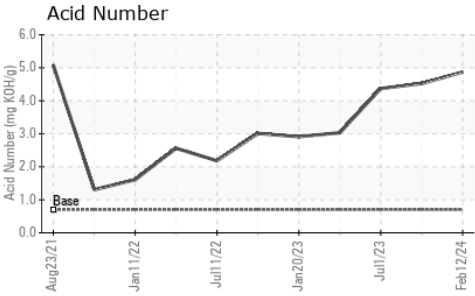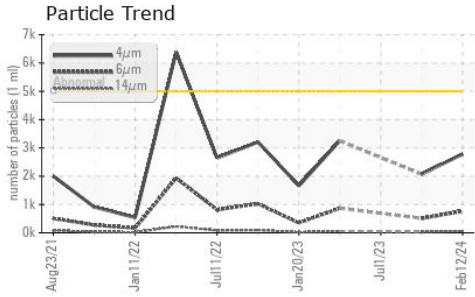





PARAMETER	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	▲ MODER
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 66	65.1	65.2	64.75

SAMPLE IMAGES method limit/base current history1 history2

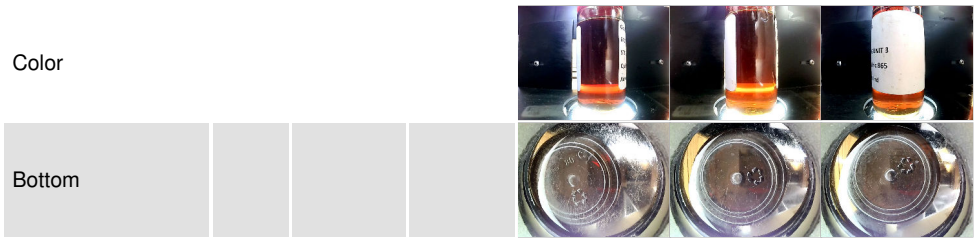

GRAPHS

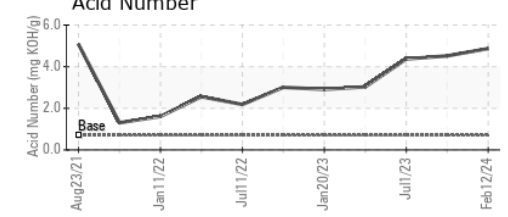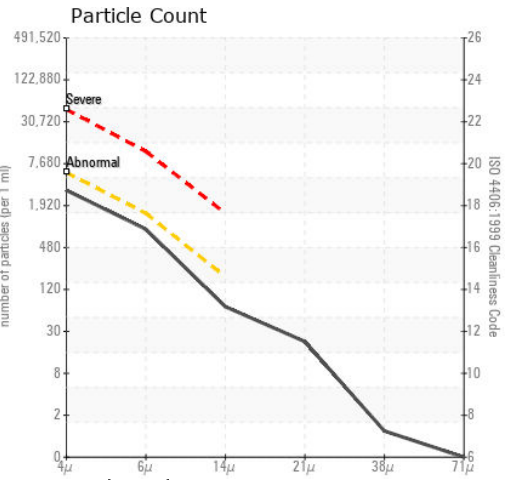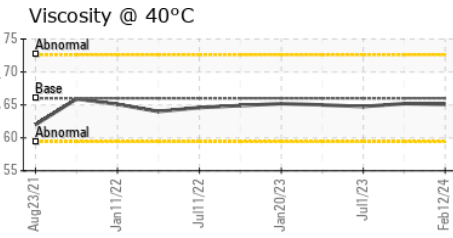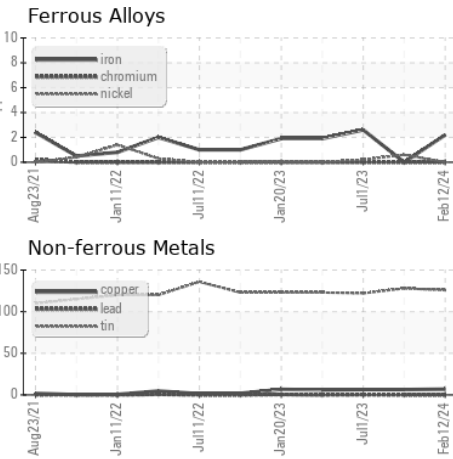

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0112936 **Received** : 13 Feb 2024
Lab Number : **06088125** **Tested** : 15 Feb 2024
Unique Number : 10875570 **Diagnosed** : 15 Feb 2024 - Don Baldrige
Test Package : PLANT

SDI - Steel Dynamics Inc. - Heartland
 455 West Industrial Drive
 Terre Haute, IN
 US 47802
 Contact: BRAD ELLIS
 brad.ellis@steeldynamics.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)