


FUEL REPORT

Sample Rating Trend

NORMAL

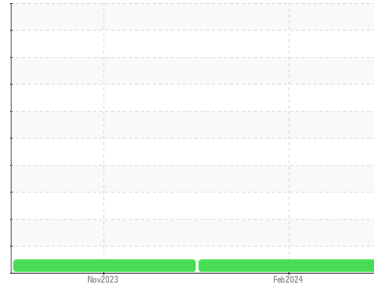

Machine Id
MH-87
Component
Diesel Fuel
Fluid
{not provided} (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0113824	PCA0113829	---
Sample Date	Client Info			12 Feb 2024	20 Nov 2023	---
Machine Age	hrs	Client Info		3476	2876	---
Sample Status				NORMAL	NORMAL	---

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		2.79	2.36	---

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m		0	0	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	0	---
Sodium	ppm	ASTM D5185m	<0.1	0	0	---
Potassium	ppm	ASTM D5185m	<0.1	0	<1	---
Water	%	ASTM D6304	<0.05	0.003	0.003	---
ppm Water	ppm	ASTM D6304	<500	29	36	---

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	2	1	---
Nickel	ppm	ASTM D5185m	<0.1	0	0	---
Lead	ppm	ASTM D5185m	<0.1	0	0	---
Vanadium	ppm	ASTM D5185m	<0.1	0	0	---
Iron	ppm	ASTM D5185m	<0.1	0	0	---
Calcium	ppm	ASTM D5185m	<0.1	0	0	---
Magnesium	ppm	ASTM D5185m	<0.1	0	0	---
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	---
Zinc	ppm	ASTM D5185m	<0.1	0	0	---





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

Color						no image
Bottom						no image



FUEL REPORT

GRAPHS

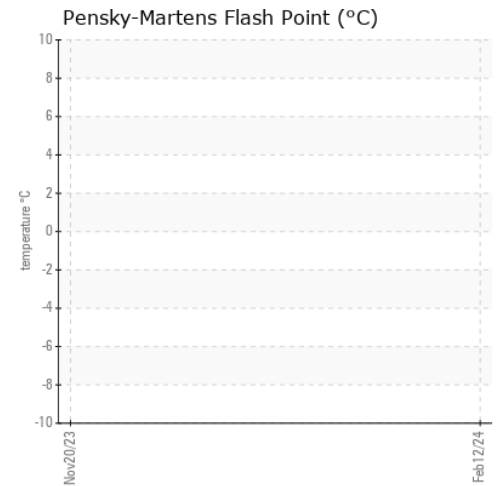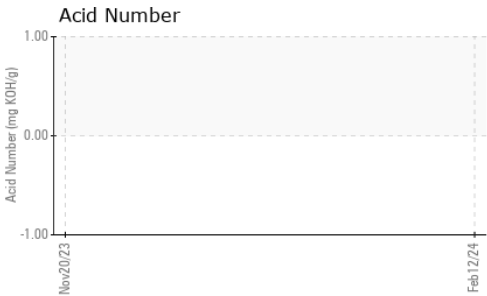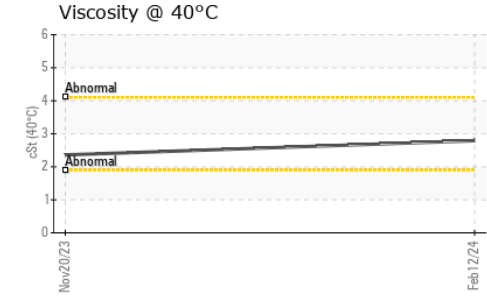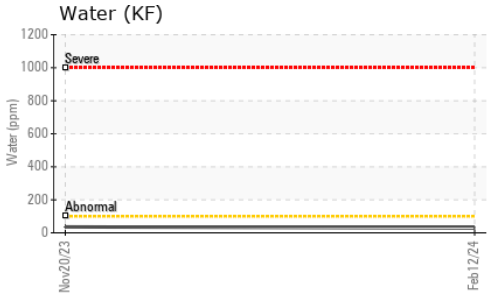

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0113824
Lab Number : 06092083
Unique Number : 10884936
Test Package : MOB 2 (Additional Tests: KF)

Received : 16 Feb 2024
Tested : 20 Feb 2024
Diagnosed : 20 Feb 2024 - Jonathan Hester

SCRAP METAL SERVICES NON-FERROUS DIVISION
 3000 W 139TH ST
 BLUE ISLAND, IL
 US 60406

Contact: SERGIO FERNANDEZ
 sfernandez@scrapmetalservices.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: