


# OIL ANALYSIS REPORT

## Sample Rating Trend



**NORMAL**

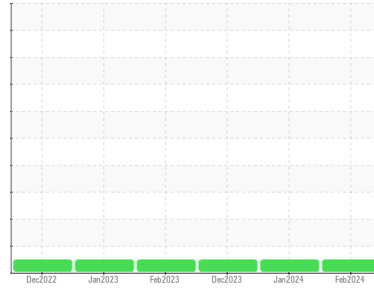

Machine Id  
**Poplar Gap B**

Component  
**Compressor**

Fluid  
**PETRO CANADA SENTRON LD 3000 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PCA0117165</b>	PCA0111963	PCA0111951
Sample Date	Client Info		<b>01 Feb 2024</b>	02 Jan 2024	04 Dec 2023
Machine Age	hrs	Client Info	<b>85570</b>	84864	84169
Oil Age	hrs	Client Info	<b>3801</b>	3095	2400
Oil Changed	Client Info		<b>Not Changed</b>	Not Changd	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>7</b>	8	6
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	2	1
Lead	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 1	<b>0</b>	0	11
Molybdenum	ppm	ASTM D5185m 2	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m 1	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 5	<b>7</b>	6	6
Calcium	ppm	ASTM D5185m 1220	<b>31</b>	31	29
Phosphorus	ppm	ASTM D5185m 298	<b>66</b>	96	95
Zinc	ppm	ASTM D5185m 350	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 1995	<b>501</b>	485	599




### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>5</b>	5	5
Sodium	ppm	ASTM D5185m	<b>7</b>	6	5
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	2

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.86	<b>0.26</b>	0.061	0.053


# OIL ANALYSIS REPORT

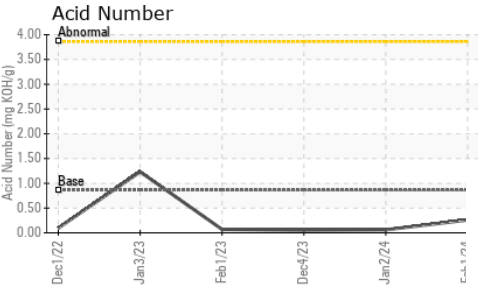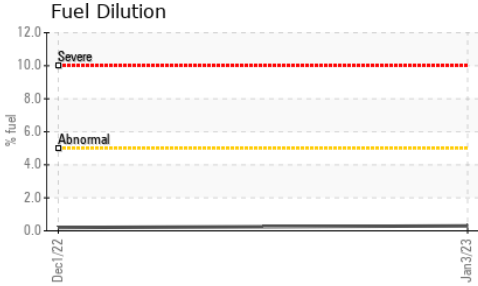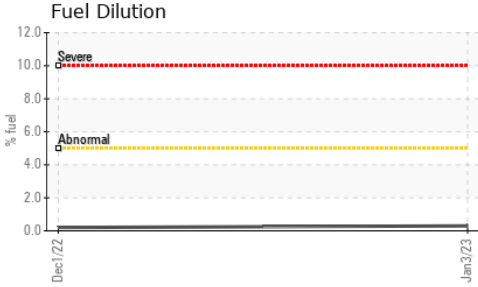









VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	124.3	102	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

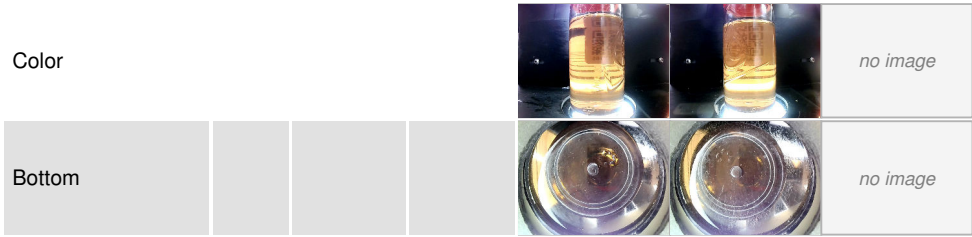

## GRAPHS

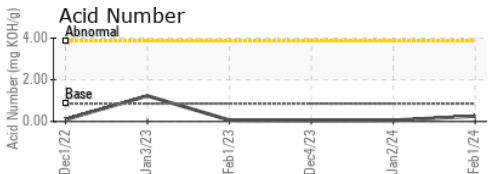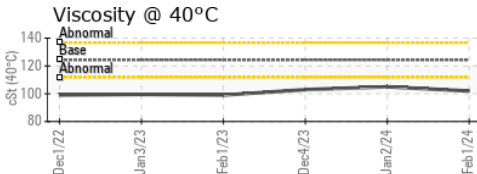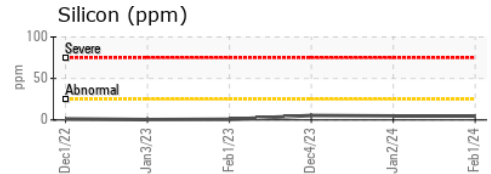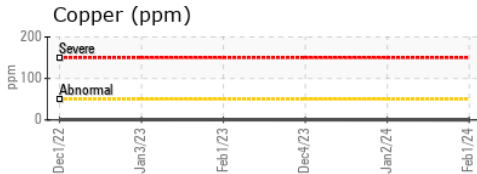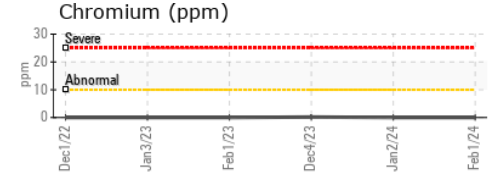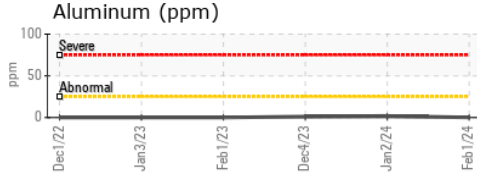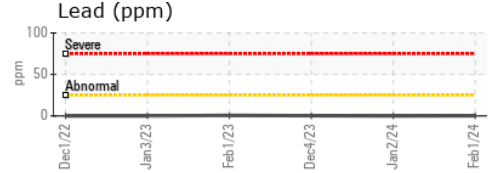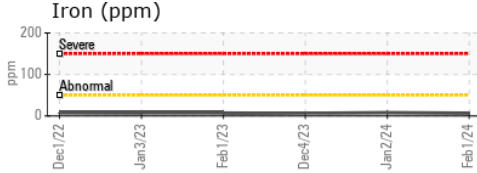

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0117165 **Received** : 16 Feb 2024  
**Lab Number** : 06092396 **Tested** : 20 Feb 2024  
**Unique Number** : 10885249 **Diagnosed** : 20 Feb 2024 - Jonathan Hester  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution )

**ENERVEST OPERATING - POPLAR GAP B**  
 1663 CRESCENT ROAD  
 GRUNDY, VA  
 US 24614  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: