

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 929144

Component

Diesel Engine

PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

_,		AugŽO23 Sep	2023 Nov2023 Nov2023	Nov2023 Dec2023 Jan2024 Jan20	24 Feb2024	
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0107955	GFL0107971	GFL0102578
Sample Date		Client Info		15 Feb 2024	30 Jan 2024	10 Jan 2024
Machine Age	hrs	Client Info		3503	3386	3261
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINAT	ION	method	limit/base	current	history1	history2
Fuel		WC Method	>5	<1.0	<1.0	<1.0
Water		WC Method	>0.2	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>110	36	23	17
Chromium	ppm	ASTM D5185m	>4	2	2	<1
Nickel	ppm	ASTM D5185m	>2	1	1	0
Titanium	ppm	ASTM D5185m		<1	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>25	6	4	3
Lead	ppm	ASTM D5185m	>45	0	<1	0
Copper	ppm	ASTM D5185m	>85	2	2	<1
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<1	0	<1
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	60	60	63	61
Manganese	ppm	ASTM D5185m	0	<1	<1	0
Magnesium	ppm	ASTM D5185m	1010	1069	930	1054
Calcium	ppm	ASTM D5185m	1070	1166	1031	1155
Phosphorus	ppm	ASTM D5185m	1150	1054	1045	1134
Zinc	ppm	ASTM D5185m	1270	1342	1177	1371
Sulfur	ppm	ASTM D5185m	2060	2979	2828	3399
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>30	7	5	4
Sodium	ppm	ASTM D5185m		5	5	3
Potassium				•	0	
1 otassiam	ppm	ASTM D5185m	>20	3	2	<1
INFRA-RED	ppm	ASTM D5185m method	>20 limit/base	3 current	2 history1	<1 history2
	ppm %					
INFRA-RED		method	limit/base	current	history1	history2
INFRA-RED Soot %	%	method *ASTM D7844 *ASTM D7624	limit/base >3	current 0.7	history1 0.6	history2 0.4
INFRA-RED Soot % Nitration	% Abs/cm Abs/.1mm	method *ASTM D7844 *ASTM D7624 *ASTM D7415	limit/base >3 >20	current 0.7 10.3 21.6	history1 0.6 9.1	history2 0.4 7.6
INFRA-RED Soot % Nitration Sulfation	% Abs/cm Abs/.1mm	method *ASTM D7844 *ASTM D7624 *ASTM D7415	limit/base >3 >20 >30	current 0.7 10.3 21.6	history1 0.6 9.1 20.6	history2 0.4 7.6 19.7
INFRA-RED Soot % Nitration Sulfation FLUID DEGRAD	% Abs/cm Abs/.1mm DATION	method *ASTM D7844 *ASTM D7624 *ASTM D7415 method	limit/base >3 >20 >30 limit/base	current 0.7 10.3 21.6 current	history1 0.6 9.1 20.6 history1	history2 0.4 7.6 19.7 history2




OIL ANALYSIS REPORT





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.5	13.5	13.5
GRAPHS						

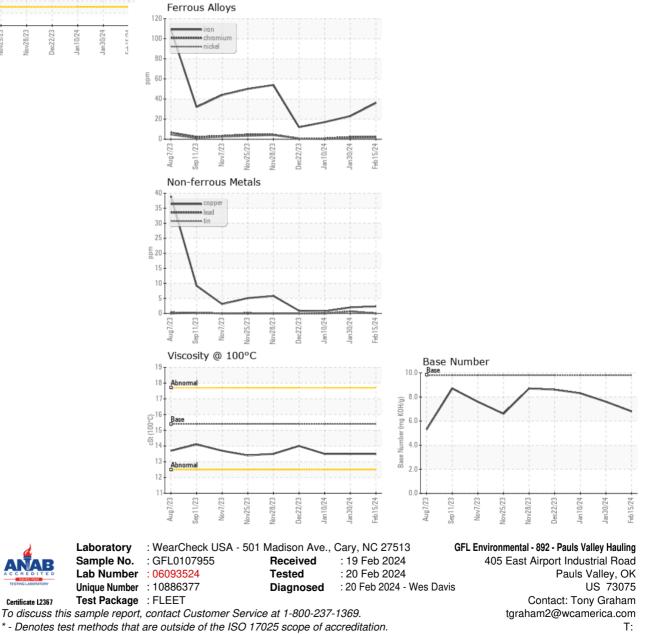

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

F: