



# OIL ANALYSIS REPORT

Sample Rating Trend


**NORMAL**



Machine Id  
**744008**

Component  
**Natural Gas Engine**

Fluid  
**PETRO CANADA DURON GEO LD 15W40 (--- LTR)**

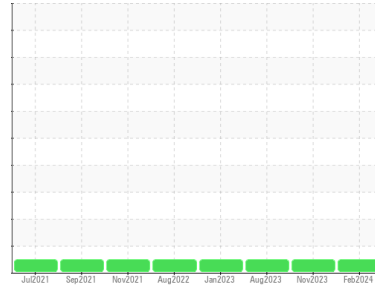

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>GFL0106998</b>	GFL0094239	GFL0085368
Sample Date	Client Info	<b>14 Feb 2024</b>	09 Nov 2023	04 Aug 2023
Machine Age	hrs	<b>6368</b>	5879	5288
Oil Age	hrs	<b>1080</b>	591	5288
Oil Changed	Client Info	<b>Changed</b>	Not Changd	Changed
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>20</b>	5	13
Chromium	ppm ASTM D5185m >4	<b>0</b>	<1	2
Nickel	ppm ASTM D5185m >2	<b>0</b>	<1	<1
Titanium	ppm ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm ASTM D5185m >3	<b>0</b>	<1	<1
Aluminum	ppm ASTM D5185m >9	<b>&lt;1</b>	2	2
Lead	ppm ASTM D5185m >30	<b>&lt;1</b>	<1	2
Copper	ppm ASTM D5185m >35	<b>&lt;1</b>	1	2
Tin	ppm ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 50	<b>2</b>	26	4
Barium	ppm ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m 50	<b>59</b>	51	57
Manganese	ppm ASTM D5185m 0	<b>&lt;1</b>	<1	<1
Magnesium	ppm ASTM D5185m 560	<b>842</b>	556	607
Calcium	ppm ASTM D5185m 1510	<b>1003</b>	1507	1798
Phosphorus	ppm ASTM D5185m 780	<b>973</b>	799	747
Zinc	ppm ASTM D5185m 870	<b>1142</b>	937	1052
Sulfur	ppm ASTM D5185m 2040	<b>2852</b>	2576	3037

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >+100	<b>3</b>	3	4
Sodium	ppm ASTM D5185m	<b>19</b>	2	11
Potassium	ppm ASTM D5185m >20	<b>6</b>	3	6

## INFRA-RED



method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	<b>1.5</b>	0	0.1
Nitration	Abs/cm *ASTM D7624 >20	<b>10.2</b>	8.4	9.7
Sulfation	Abs/.1mm *ASTM D7415 >30	<b>20.9</b>	18.8	21.1

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	<b>16.6</b>	16.2	17.1
Base Number (BN)	mg KOH/g ASTM D2896 10.2	<b>8.6</b>	8.0	4.9







# OIL ANALYSIS REPORT

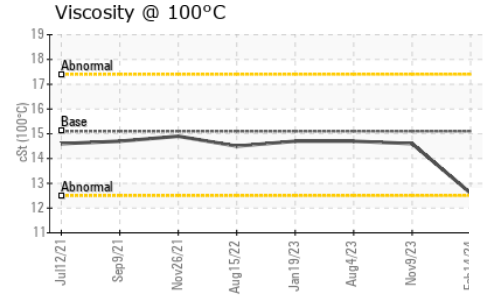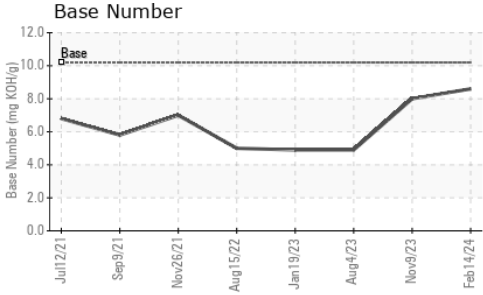

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.1	<b>12.6</b>	14.6	14.7

## GRAPHS

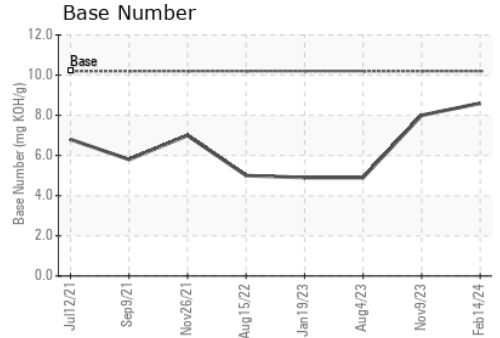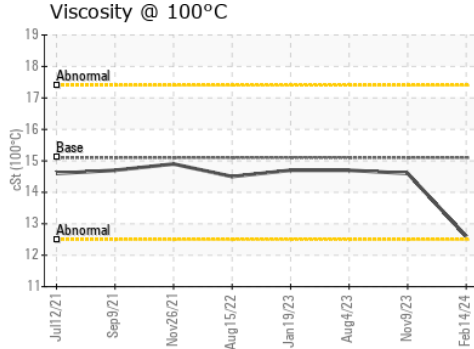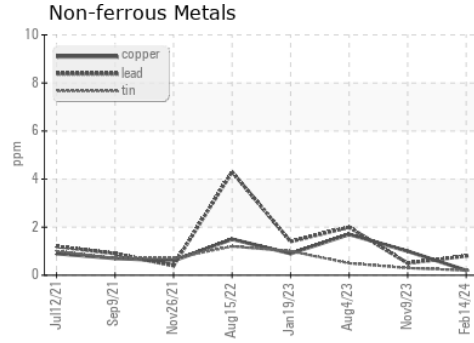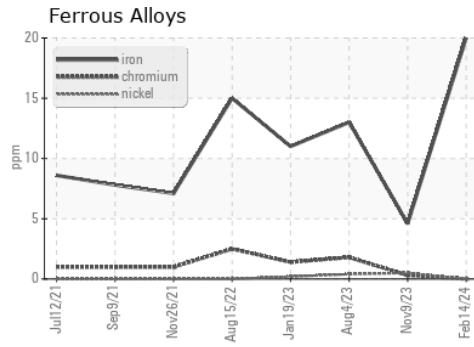

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0106998 **Received** : 20 Feb 2024  
**Lab Number** : **06093974** **Tested** : 21 Feb 2024  
**Unique Number** : 10886827 **Diagnosed** : 21 Feb 2024 - Don Baldrige  
**Test Package** : FLEET

**GFL Environmental - 882 - Gainesville**  
 5002 SW 41st Blvd  
 Gainesville, FL  
 US 32608  
 Contact: ROBERT CLARK  
 robert.clark@gflenv.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)