



OIL ANALYSIS REPORT

Sample Rating Trend


WEAR



Machine Id
948018

Component
Natural Gas Engine

Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

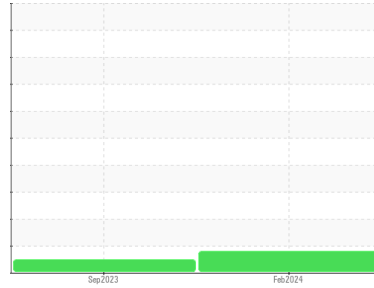

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. In the absence of other significant wear metals, suspect copper due to sources other than wear (i.e. cooling core). All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0108363	GFL0090350	---
Sample Date	Client Info	16 Feb 2024	27 Sep 2023	---
Machine Age	hrs	39586	32769	---
Oil Age	hrs	6817	32769	---
Oil Changed	Client Info	Changed	Changed	---
Sample Status		ABNORMAL	NORMAL	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	---

WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	17	19	---
Chromium	ppm	ASTM D5185m	>4	2	2	---
Nickel	ppm	ASTM D5185m	>2	0	<1	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m	>3	0	0	---
Aluminum	ppm	ASTM D5185m	>9	2	4	---
Lead	ppm	ASTM D5185m	>30	0	<1	---
Copper	ppm	ASTM D5185m	>35	157	<1	---
Tin	ppm	ASTM D5185m	>4	0	<1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	50	13	7	---
Barium	ppm	ASTM D5185m	5	0	0	---
Molybdenum	ppm	ASTM D5185m	50	50	63	---
Manganese	ppm	ASTM D5185m	0	<1	<1	---
Magnesium	ppm	ASTM D5185m	560	533	575	---
Calcium	ppm	ASTM D5185m	1510	1448	1596	---
Phosphorus	ppm	ASTM D5185m	780	622	732	---
Zinc	ppm	ASTM D5185m	870	821	997	---
Sulfur	ppm	ASTM D5185m	2040	1941	2795	---

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+100	6	5	---
Sodium	ppm	ASTM D5185m		25	7	---
Potassium	ppm	ASTM D5185m	>20	0	2	---

INFRA-RED





method	limit/base	current	history1	history2		
Soot %	%	*ASTM D7844		0	0	---
Nitration	Abs/cm	*ASTM D7624	>20	10.9	11.5	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.8	23.4	---

FLUID DEGRADATION

method	limit/base	current	history1	history2		
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.8	20.4	---
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	4.9	4.4	---







OIL ANALYSIS REPORT

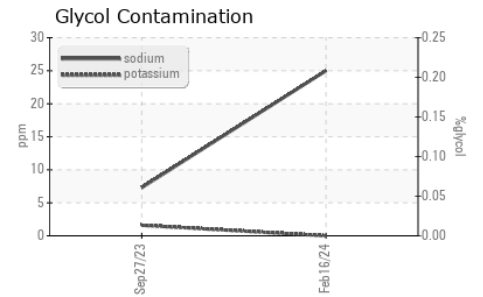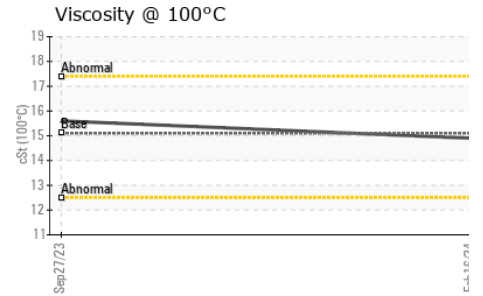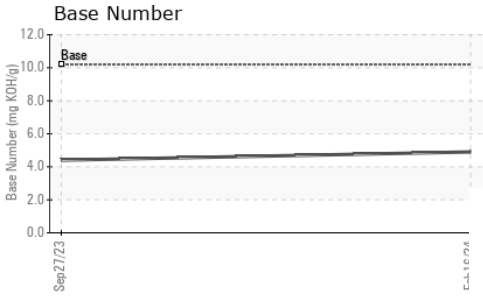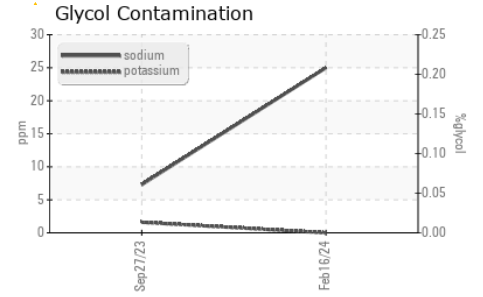

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.9	15.6

GRAPHS

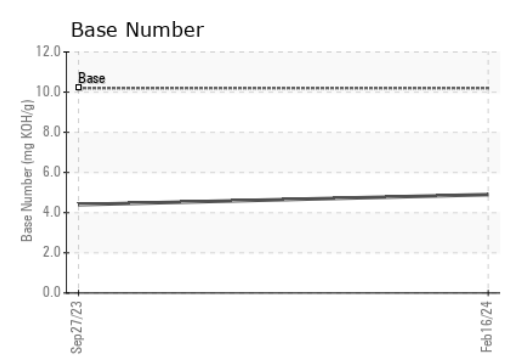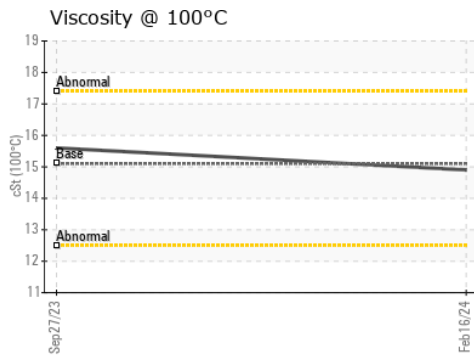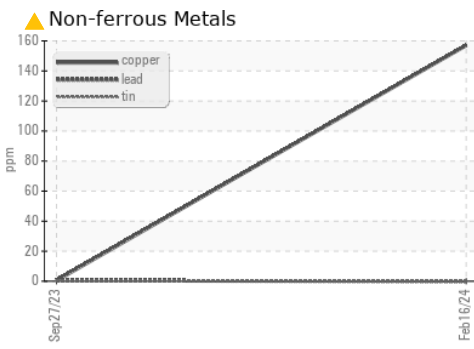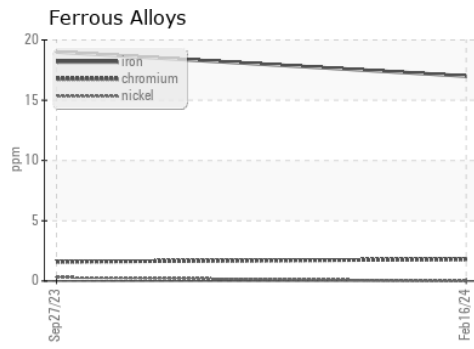

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0108363 **Received** : 21 Feb 2024
Lab Number : 06095246 **Tested** : 23 Feb 2024
Unique Number : 10888099 **Diagnosed** : 23 Feb 2024 - Sean Felton
Test Package : FLEET (Additional Tests: Glycol)

GFL Environmental - 963 - Peoria HC Disposal
 1113 N. Swords Ave.
 West Peoria, IL
 US 61604
 Contact: Corey Dozard
 cdozard@gflenv.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)