


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

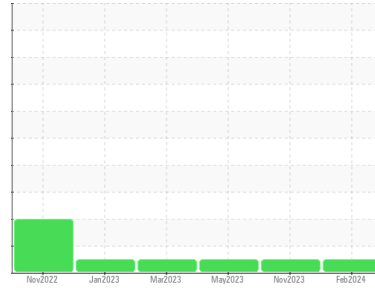

Area
SCOF [98827403]
 Machine Id
CURD BREAKER 1
 Component
Gearbox
 Fluid
GEAR OIL ISO 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PCA0117983	PCA0101646	PCA0096861
Sample Date	Client Info	24 Feb 2024	05 Nov 2023	23 May 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	Filtered	Filtered	Filtered
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.2	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	0	2	3
Chromium	ppm ASTM D5185m >15	<1	<1	<1
Nickel	ppm ASTM D5185m >15	0	<1	0
Titanium	ppm ASTM D5185m	0	<1	0
Silver	ppm ASTM D5185m	0	0	<1
Aluminum	ppm ASTM D5185m >25	0	2	2
Lead	ppm ASTM D5185m >100	0	0	<1
Copper	ppm ASTM D5185m >200	0	<1	0
Tin	ppm ASTM D5185m >25	0	<1	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 50	0	0	0
Barium	ppm ASTM D5185m 15	0	4	0
Molybdenum	ppm ASTM D5185m 15	0	<1	<1
Manganese	ppm ASTM D5185m	<1	<1	<1
Magnesium	ppm ASTM D5185m 50	<1	0	10
Calcium	ppm ASTM D5185m 50	4	2	4
Phosphorus	ppm ASTM D5185m 350	375	427	451
Zinc	ppm ASTM D5185m 100	0	0	7
Sulfur	ppm ASTM D5185m 12500	1294	1619	1621

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	2	4	3
Sodium	ppm ASTM D5185m	0	0	<1
Potassium	ppm ASTM D5185m >20	0	<1	1





FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	121	112	72
Particles >6µm	ASTM D7647 >320	39	57	43
Particles >14µm	ASTM D7647 >80	8	9	14
Particles >21µm	ASTM D7647 >20	2	3	7
Particles >38µm	ASTM D7647 >4	0	1	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >17/15/13	14/12/10	14/13/10	13/13/11

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.85	0.37	0.33	0.33


OIL ANALYSIS REPORT

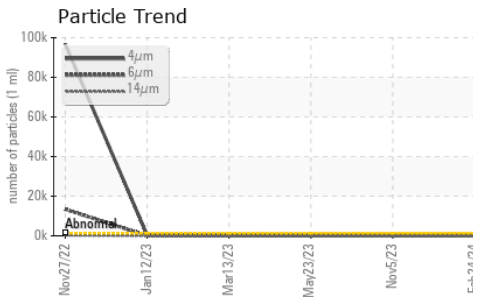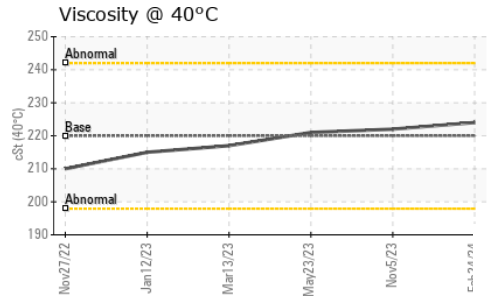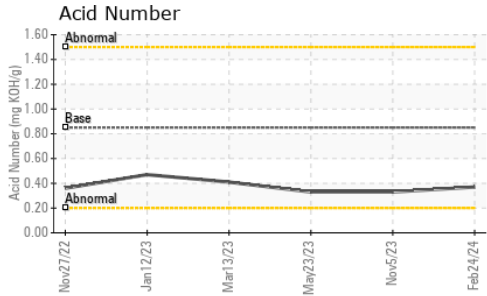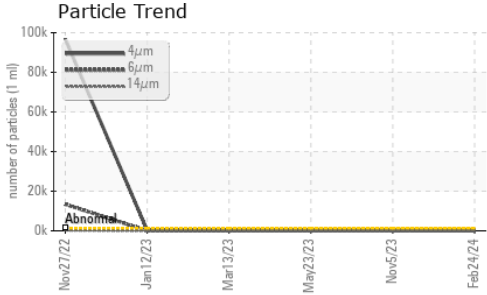






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 220	224	222	221

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

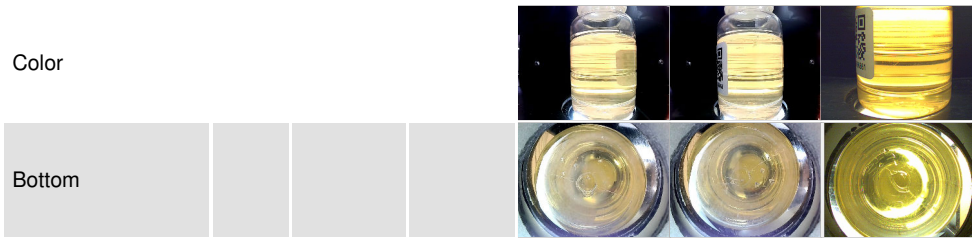

GRAPHS

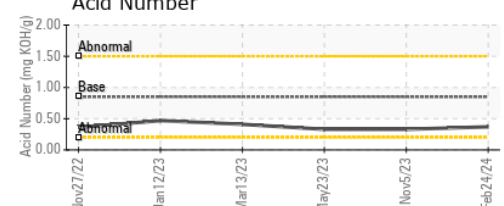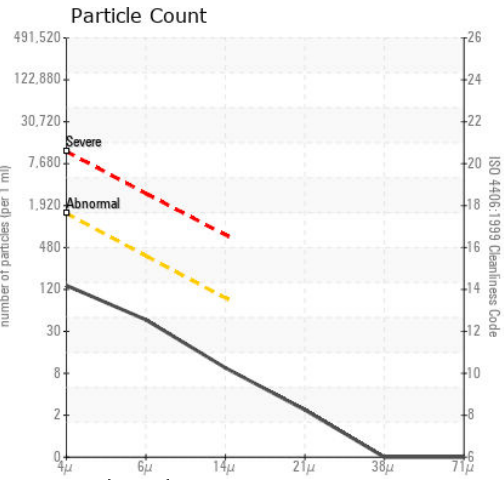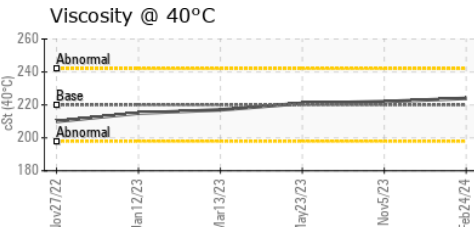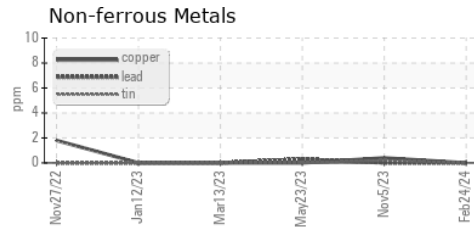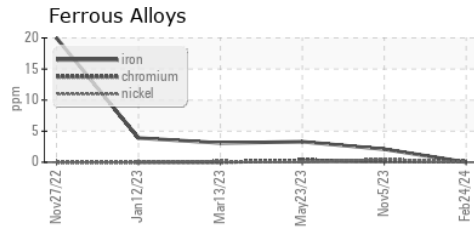

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0117983 **Received** : 27 Feb 2024
Lab Number : **06101585** **Tested** : 28 Feb 2024
Unique Number : 10899815 **Diagnosed** : 29 Feb 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Springfield - Plant 8311 PCA
 2035 E BENNETT
 SPRINGFIELD, MO
 US 65804
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: