


OIL ANALYSIS REPORT

Sample Rating Trend

VIS DEBRIS

Area
[9081935496]
 Machine Id
[] ELEC MAG SX19001
 Component
Gearbox
 Fluid
10095-782 (--- QTS)

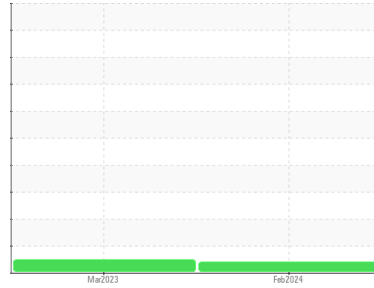

DIAGNOSIS

Recommendation
 We recommend you service the filters on this component. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
 All component wear rates are normal.

Contamination
 Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PCA0118553	PCA0077233	---
Sample Date	Client Info		02 Feb 2024	19 Mar 2023	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			ABNORMAL	NORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.2	NEG	NEG	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		12	12	---
Iron	ppm	ASTM D5185m >200	0	0	---
Chromium	ppm	ASTM D5185m >15	0	0	---
Nickel	ppm	ASTM D5185m >15	0	0	---
Titanium	ppm	ASTM D5185m	0	<1	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >25	0	<1	---
Lead	ppm	ASTM D5185m >100	0	0	---
Copper	ppm	ASTM D5185m >200	<1	0	---
Tin	ppm	ASTM D5185m >25	0	0	---
Vanadium	ppm	ASTM D5185m	0	<1	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	0	0	---
Molybdenum	ppm	ASTM D5185m	0	<1	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	<1	3	---
Calcium	ppm	ASTM D5185m	1	0	---
Phosphorus	ppm	ASTM D5185m	0	11	---
Zinc	ppm	ASTM D5185m	0	0	---
Sulfur	ppm	ASTM D5185m	82	0	---


CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	22	19	---
Sodium	ppm	ASTM D5185m	<1	<1	---
Potassium	ppm	ASTM D5185m >20	0	<1	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.046	0.051	---


OIL ANALYSIS REPORT

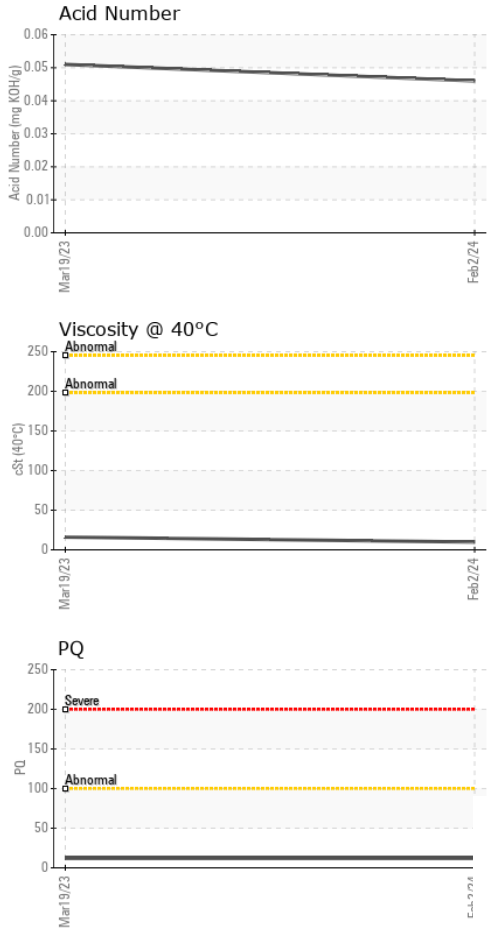



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	9.8	16.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

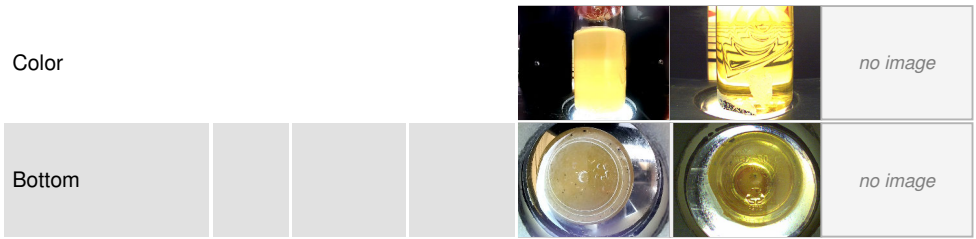

GRAPHS

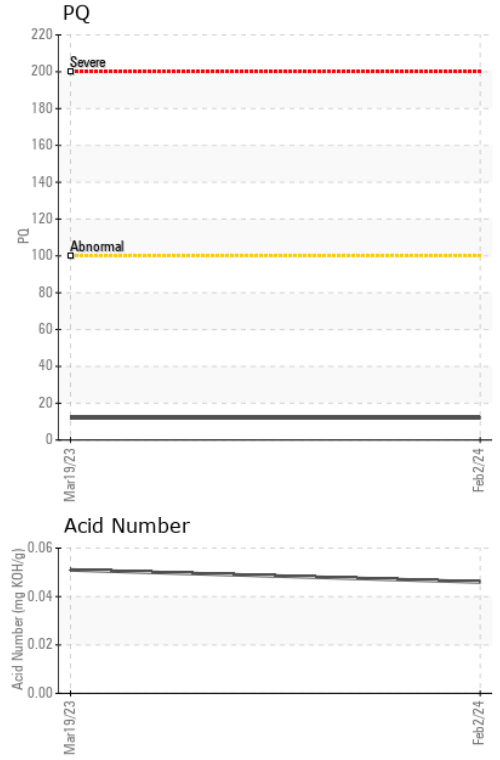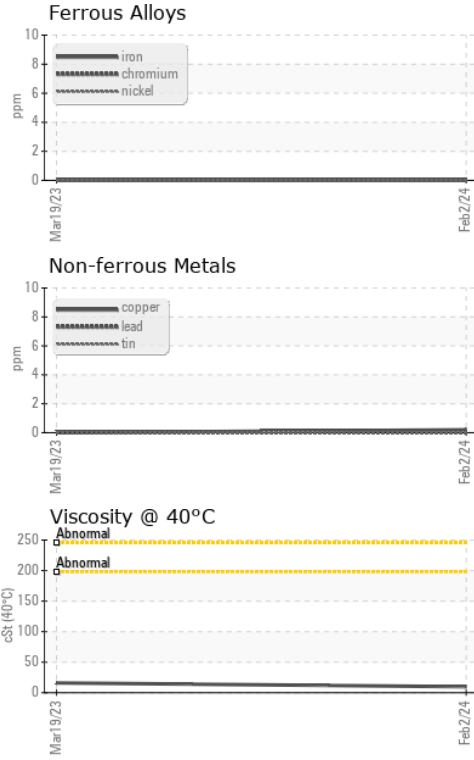

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0118553
Lab Number : 06102138
Unique Number : 10900368
Test Package : IND 2 (Additional Tests: PQ)

Received : 27 Feb 2024
Tested : 01 Mar 2024
Diagnosed : 01 Mar 2024 - Jonathan Hester

THE HERSHEY COMPANY
 WEST HERSHEY - TECHNICAL ASSURANCE, 1033 OLDE WEST CHOCOLATE
 HERSHEY, PA
 US 17033

Contact: CLINTON ZOHNER
 clintzohner@hersheys.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (717)374-4846
 F: (717)374-4594