




OIL ANALYSIS REPORT

Sample Rating Trend

GLYCOL



Machine Id
925032
Component
Natural Gas Engine
Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

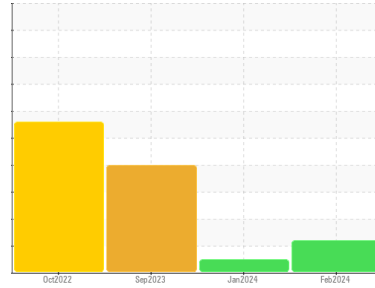

DIAGNOSIS

▲ Recommendation

We advise that you check for possible coolant leak. Check for low coolant level. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Sodium and/or potassium levels are high.

▲ Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0098089	GFL0086742	GFL0080375
Sample Date	Client Info	26 Feb 2024	25 Jan 2024	25 Sep 2023
Machine Age	hrs	22165	21931	21059
Oil Age	hrs	1106	872	21059
Oil Changed	Client Info	Changed	Not Changd	Changed
Sample Status		ABNORMAL	NORMAL	ABNORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	47	45	▲ 56
Chromium	ppm ASTM D5185m >5	5	5	▲ 8
Nickel	ppm ASTM D5185m >4	2	<1	2
Titanium	ppm ASTM D5185m >5	0	<1	<1
Silver	ppm ASTM D5185m >3	0	0	0
Aluminum	ppm ASTM D5185m >25	4	4	0
Lead	ppm ASTM D5185m >40	4	2	7
Copper	ppm ASTM D5185m >150	2	2	4
Tin	ppm ASTM D5185m >4	1	<1	<1
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 50	7	3	2
Barium	ppm ASTM D5185m 5	0	0	<1
Molybdenum	ppm ASTM D5185m 50	72	64	73
Manganese	ppm ASTM D5185m 0	2	1	2
Magnesium	ppm ASTM D5185m 560	816	633	656
Calcium	ppm ASTM D5185m 1510	1994	1850	1832
Phosphorus	ppm ASTM D5185m 780	879	862	806
Zinc	ppm ASTM D5185m 870	1279	1052	1052
Sulfur	ppm ASTM D5185m 2040	3010	2627	2742

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	12	8	20
Sodium	ppm ASTM D5185m	▲ 261	53	▲ 111
Potassium	ppm ASTM D5185m >20	14	5	25
Glycol	% *ASTM D2982	---	---	0.0

INFRA-RED




method	limit/base	current	history1	history2
Soot %	% *ASTM D7844	0.1	0	0.1
Nitration	Abs/cm *ASTM D7624 >20	15.6	14.2	16.9
Sulfation	Abs/.1mm *ASTM D7415 >30	28.4	28.3	32.5

FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	24.2	23.9	30.7
Base Number (BN)	mg KOH/g ASTM D2896 10.2	5.0	3.1	▲ 2.0







OIL ANALYSIS REPORT

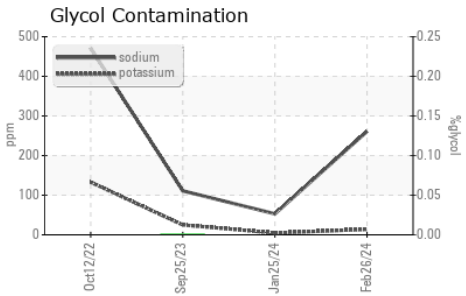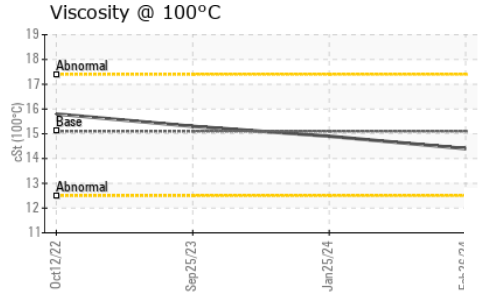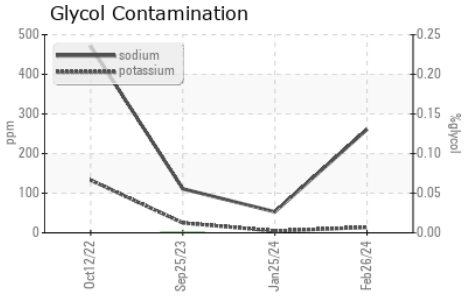

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.4	14.9

GRAPHS

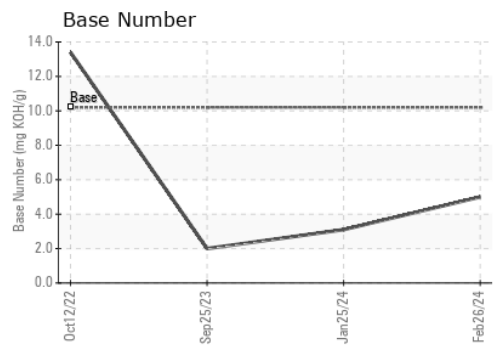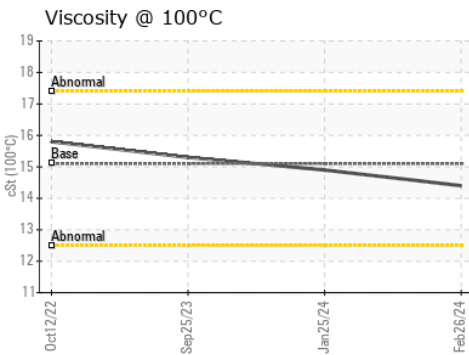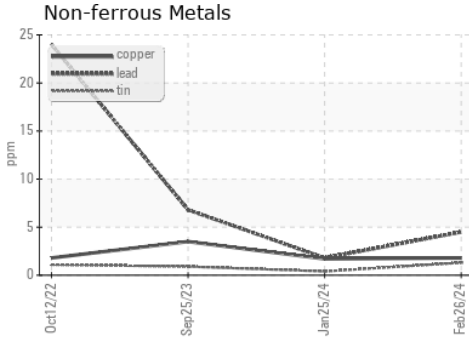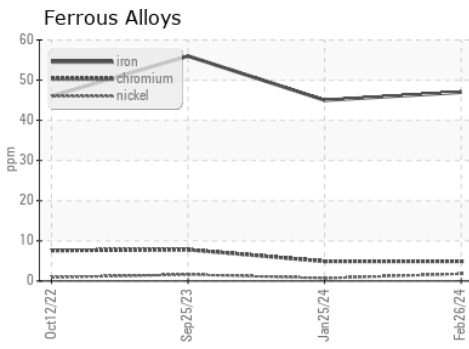

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0098089 **Received** : 29 Feb 2024
Lab Number : 06104191 **Tested** : 04 Mar 2024
Unique Number : 10902421 **Diagnosed** : 04 Mar 2024 - Jonathan Hester
Test Package : FLEET (Additional Tests: Glycol)

GFL Environmental - 932 - Muskego HC
 W144 S6400 College Ct.
 Muskego, WI
 US 53150
 Contact: Brian Schlomann
 brian.schlomann@gflenv.com
 T: (262)510-4586
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)