

OIL ANALYSIS REPORT

SAMPLE INFORMATI

CONTAMINATION

hrs

hrs

Sample Number

Sample Date

Machine Age

Oil Changed

Sample Status

Oil Age

Sample Rating Trend

GLYCOL

Machine Ic 929086-205277

Component **Diesel Engine** Fluid PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check for the source of the coolant leak. Check for low coolant level. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Sodium and/or potassium levels remain high.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil.

•					
	1b2019 Ju	12019 Dec2021 Dec2022	Mar2023 May2023 Aug2023	Feb2024	
ION	method	limit/base	current	history1	history2
	Client Info		GFL0115352	GFL0110878	GFL0074727
	Client Info		29 Feb 2024	08 Feb 2024	10 Jan 2024
	Client Info		53534	53378	53218
	Client Info		156	160	140
	Client Info		Changed	Changed	Changed
			ABNORMAL	ABNORMAL	ABNORMAL
	method	limit/base	current	history1	history2
	methou	in in base	Guiront	ristory I	Thotory Z

Fuel	WC Method >	5 <1.0	<1.0	<1.0
Water	WC Method >	0.2 NEG	NEG	NEG


WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	69	58	45
Chromium	ppm	ASTM D5185m	>20	1	1	<1
Nickel	ppm	ASTM D5185m	>4	<1	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	1	2
Lead	ppm	ASTM D5185m	>40	3	1	<1
Copper	ppm	ASTM D5185m	>330	3	2	1
Tin	ppm	ASTM D5185m	>15	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	11	11	16
Barium	ppm	ASTM D5185m	0	0	<1	0
Molybdenum	ppm	ASTM D5185m	60	82	74	70
Manganese	ppm	ASTM D5185m	0	<1	<1	<1
Magnesium	ppm	ASTM D5185m	1010	1122	940	946
Calcium	ppm	ASTM D5185m	1070	1214	1007	1026
Phosphorus	ppm	ASTM D5185m	1150	1171	1035	1099
Zinc	ppm	ASTM D5185m	1270	1391	1204	1262
Sulfur	ppm	ASTM D5185m	2060	3585	3101	3255


CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	11	9	8
Sodium	ppm	ASTM D5185m		<u> </u>	4 89	A 363
Potassium	ppm	ASTM D5185m	>20	30	27	22
Glycol	%	*ASTM D2982		NEG	NEG	NEG
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	0.2	0.2	0.1
Nitration	Abs/cm	*ASTM D7624	>20	8.9	7.7	6.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.5	19.7	18.5
FLUID DEGRAD	DATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.7	15.2	14.1
Base Number (BN)	mg KOH/g	ASTM D2896	9.8	9.2	9.4	9.6



OIL ANALYSIS REPORT







VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.6	13.9	14.1
CRADUS						


GRAPHS


Non-ferrous Metals

lead

250

200



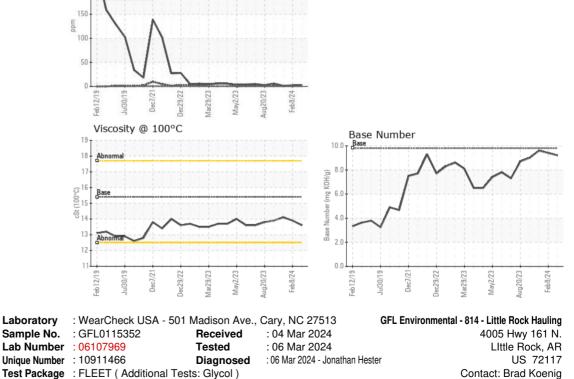

Certificate 12367 Test Package : FLEET (Additional Tests: Glycol) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

bkoenig@gflenv.com

Т:

F: