




OIL ANALYSIS REPORT

Sample Rating Trend

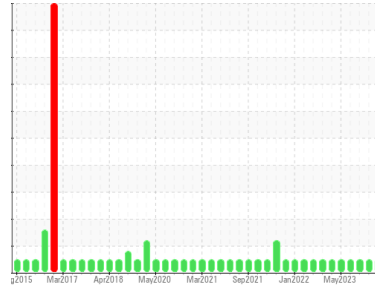

NORMAL



Area
(YA163846)
 Machine Id
10537C

Component
Natural Gas Engine
 Fluid

PETRO CANADA DURON GEO LD 15W40 (5 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | GFL0112957 | GFL0098126 | GFL0079599 |
| Sample Date | Client Info | 04 Mar 2024 | 04 Dec 2023 | 03 Oct 2023 |
| Machine Age | hrs | 12368 | 12368 | 12368 |
| Oil Age | hrs | 610 | 341 | 558 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| method | limit/base | current | history1 | history2 |
|--------|----------------|------------|----------|----------|
| Water | WC Method >0.1 | NEG | NEG | NEG |

WEAR METALS

| method | limit/base | current | history1 | history2 |
|----------|---------------------|--------------|----------|----------|
| Iron | ppm ASTM D5185m >50 | 10 | 7 | 12 |
| Chromium | ppm ASTM D5185m >4 | <1 | <1 | <1 |
| Nickel | ppm ASTM D5185m >2 | 0 | <1 | 0 |
| Titanium | ppm ASTM D5185m | <1 | 0 | 0 |
| Silver | ppm ASTM D5185m >3 | 0 | 0 | 0 |
| Aluminum | ppm ASTM D5185m >9 | 2 | 3 | 0 |
| Lead | ppm ASTM D5185m >30 | <1 | 1 | 2 |
| Copper | ppm ASTM D5185m >35 | <1 | 0 | <1 |
| Tin | ppm ASTM D5185m >4 | 0 | <1 | 1 |
| Vanadium | ppm ASTM D5185m | 0 | 0 | 0 |
| Cadmium | ppm ASTM D5185m | 0 | 0 | 0 |

ADDITIVES

| method | limit/base | current | history1 | history2 |
|------------|----------------------|--------------|----------|----------|
| Boron | ppm ASTM D5185m 50 | 14 | 20 | 12 |
| Barium | ppm ASTM D5185m 5 | 0 | 0 | 0 |
| Molybdenum | ppm ASTM D5185m 50 | 47 | 52 | 54 |
| Manganese | ppm ASTM D5185m 0 | <1 | <1 | <1 |
| Magnesium | ppm ASTM D5185m 560 | 622 | 613 | 576 |
| Calcium | ppm ASTM D5185m 1510 | 1746 | 1573 | 1604 |
| Phosphorus | ppm ASTM D5185m 780 | 817 | 848 | 712 |
| Zinc | ppm ASTM D5185m 870 | 1005 | 1024 | 976 |
| Sulfur | ppm ASTM D5185m 2040 | 2700 | 2589 | 2426 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 |
|-----------|-----------------------|----------|----------|----------|
| Silicon | ppm ASTM D5185m >+100 | 4 | 6 | 4 |
| Sodium | ppm ASTM D5185m | 5 | 4 | 5 |
| Potassium | ppm ASTM D5185m >20 | 0 | 1 | <1 |

INFRA-RED



| method | limit/base | current | history1 | history2 |
|-----------|--------------------------|-------------|----------|----------|
| Soot % | % *ASTM D7844 | 0 | 0 | 0 |
| Nitration | Abs/cm *ASTM D7624 >20 | 10.6 | 9.1 | 10.2 |
| Sulfation | Abs/.1mm *ASTM D7415 >30 | 20.2 | 19.3 | 20.8 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 |
|------------------|--------------------------|-------------|----------|----------|
| Oxidation | Abs/.1mm *ASTM D7414 >25 | 17.5 | 16.5 | 17.5 |
| Base Number (BN) | mg KOH/g ASTM D2896 10.2 | 5.3 | 6.9 | 5.1 |







OIL ANALYSIS REPORT

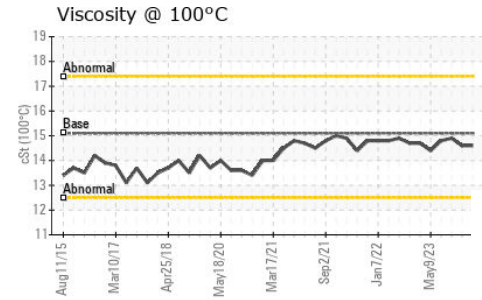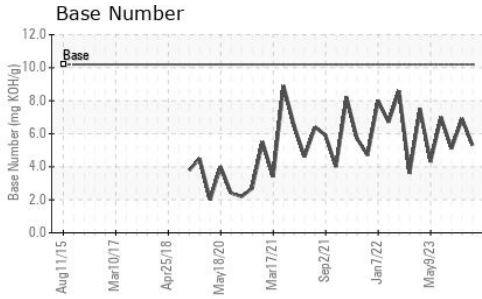

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt | ASTM D445 | 15.1 | 14.6 | 14.6 | 14.9 |

GRAPHS

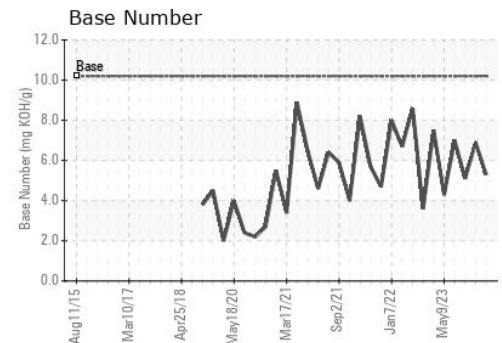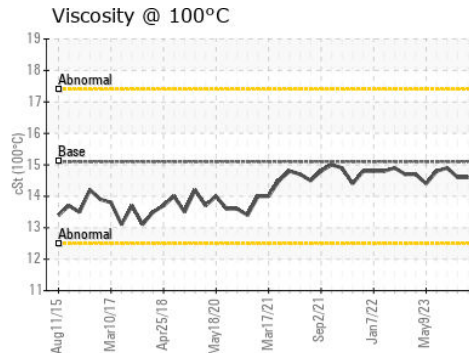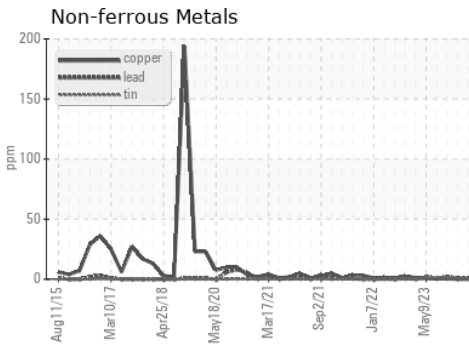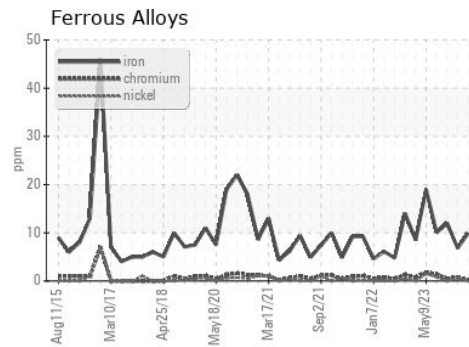

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : GFL0112957
Lab Number : **06108027**
Unique Number : 10911524
Test Package : FLEET

Received : 04 Mar 2024
Tested : 05 Mar 2024
Diagnosed : 05 Mar 2024 - Wes Davis

GFL Environmental - 017 - Durham
 148 Stone Park Court
 Durham, NC
 US 27703
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

bill.waring@wearcheck.com

T: (919)596-1363

F: (919)598-1852