

OIL ANALYSIS REPORT

Sample Rating Trend

الالاه الالاه ا

ISO

Area **PLANT** 1 [907308375] Machine Id **RC-6 PLANT** 1 (S/N MK61518) Component

Refrigeration Compressor

IRVING STAR C 4G ISO 68 (80 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		5ep2017 5e	p2010 06p2010 06p	2020 3692021 3692022	Jul2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PCA0116836	PCA0068401	PCA0071499
Sample Date		Client Info		21 Feb 2024	25 Jul 2023	13 Feb 2023
Machine Age	hrs	Client Info		78041	74302	70648
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				ABNORMAL	ABNORMAL	NORMAL
WEAR METALS	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	28	28	25
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	<1
Lead	ppm	ASTM D5185m	>2	<1	0	<1
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	1
Phosphorus	ppm	ASTM D5185m		0	0	2
Zinc	ppm	ASTM D5185m		0	5	5
Sulfur	ppm	ASTM D5185m		560	777	669
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	1	<1	0
Water	%	ASTM D6304	>0.01	0.00	0.003	0.005
ppm Water	ppm	ASTM D6304	>100	0	34.4	58.8
FLUID CLEANL	INESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	A 24369	A 31708	6470
Particles >6µm		ASTM D7647	>2500	<u> </u>	▲ 8033	1554
Particles >14µm		ASTM D7647	>320	207	123	56
Particles >21µm		ASTM D7647	>80	26	8	7
Particles >38µm		ASTM D7647	>20	0	0	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	A 22/20/15	▲ 22/20/14	20/18/13
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.01	0.014	0.014	0.015




OIL ANALYSIS REPORT






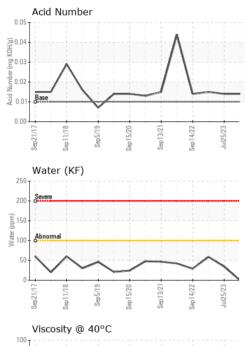



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	62.0	74.5	73.9	73.4
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

Bottom

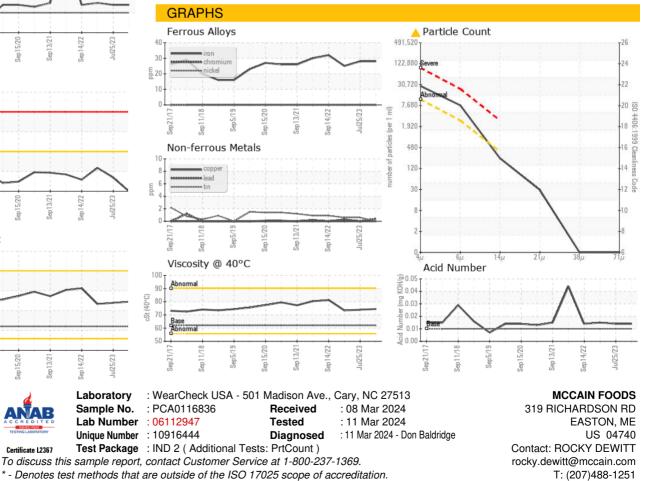

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Contact/Location: ROCKY DEWITT - MCCEASPCA

F: (207)488-1249