

## **OIL ANALYSIS REPORT**

### Sample Rating Trend



## Machine Id 731116

Component Natural Gas Engine

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

## DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.


## Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

GAL)		pr2022 Jan	2023 Mar2023 Jun2	003 Aug2023 Nov2023 M	1ar2024	
SAMPLE INFORM	<b>/</b> ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0114010	GFL0114098	GFL0114092
Sample Date		Client Info		07 Mar 2024	07 Mar 2024	05 Mar 2024
Machine Age	hrs	Client Info		6611	7368	6593
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATI	ON	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	9	9	12
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>9	<1	<1	1
Lead	ppm	ASTM D5185m	>30	<1	1	2
Copper	ppm	ASTM D5185m	>35	0	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	50	11	11	7
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	50	50	50	57
Manganese	ppm	ASTM D5185m	0	0	0	0
Magnesium	ppm	ASTM D5185m	560	481	489	527
Calcium	ppm	ASTM D5185m	1510	1579	1582	1553
Phosphorus	ppm	ASTM D5185m	780	626	631	627
Zinc	ppm	ASTM D5185m	870	863	890	891
Sulfur	ppm	ASTM D5185m	2040	2243	2306	2208
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+100	3	3	4
Sodium	ppm	ASTM D5185m		6	6	6
Potassium	ppm	ASTM D5185m	>20	0	0	0
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	10.8	10.9	11.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.7	20.7	24.4
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	17.3	17.4	20.0
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	4.8	4.9	3.3




# **OIL ANALYSIS REPORT**





VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.1	14.2	14.2	14.5
GRAPHS						

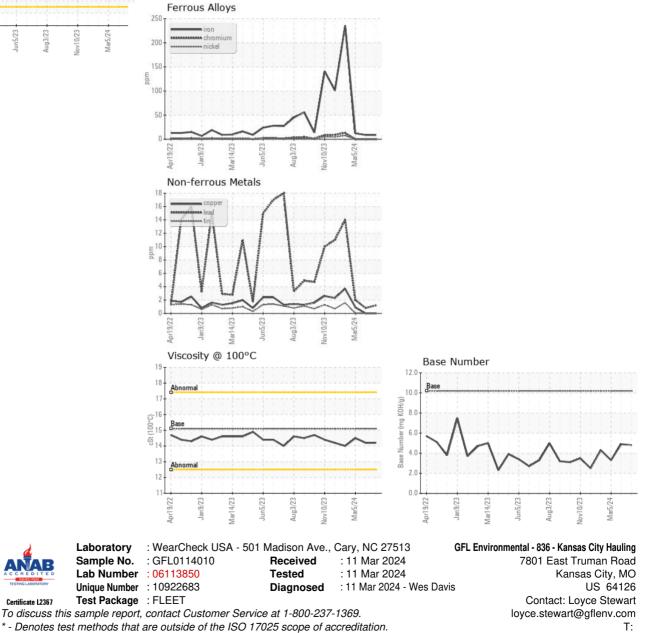

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: