

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 933021

Component **Natural Gas Engine**

PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.







| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
|---|--|---|--|--|--|--|
| Sample Number | | Client Info | | GFL0114011 | GFL0108082 | GFL0108132 |
| Sample Date | | Client Info | | 11 Mar 2024 | 09 Feb 2024 | 21 Jan 2024 |
| Machine Age | hrs | Client Info | | 3932 | 3732 | 3565 |
| Oil Age | hrs | Client Info | | 0 | 34 | 0 |
| Oil Changed | | Client Info | | Not Changd | Not Changd | Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| CONTAMINAT | ION | method | limit/base | current | history1 | history2 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| WEAR METAL | S | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 3 | 3 | 8 |
| Chromium | ppm | ASTM D5185m | >4 | <1 | <1 | 2 |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Silver | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >9 | 3 | 2 | 4 |
| Lead | ppm | ASTM D5185m | >30 | <1 | 0 | 6 |
| Copper | ppm | ASTM D5185m | >35 | 1 | <1 | 3 |
| Tin | ppm | ASTM D5185m | >4 | <1 | <1 | 1 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | <1 |
| | | | | | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| ADDITIVES Boron | ppm | Method ASTM D5185m | limit/base | current 15 | history1 26 | 4 |
| | ppm ppm | | | | | |
| Boron | | ASTM D5185m | 50 | 15 0 46 | 26 | 4 |
| Boron Barium | ppm | ASTM D5185m ASTM D5185m | 50 5 50 | 15 0 | 26 0 | 4 |
| Boron Barium Molybdenum | ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 | 15 0 46 | 26 0 42 | 4 0 53 |
| Boron Barium Molybdenum Manganese | ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 | 15 0 46 <1 | 26 0 42 <1 | 4 0 53 <1 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus | ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 780 | 15 0 46 <1 520 1515 724 | 26 0 42 <1 491 1465 687 | 4 0 53 <1 576 1460 664 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc | ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 | 15 0 46 <1 520 1515 | 26 0 42 <1 491 1465 687 728 | 4 0 53 <1 576 1460 664 970 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus | ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 780 | 15 0 46 <1 520 1515 724 | 26 0 42 <1 491 1465 687 | 4 0 53 <1 576 1460 664 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc | ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 780 870 | 15 0 46 <1 520 1515 724 888 | 26 0 42 <1 491 1465 687 728 | 4 0 53 <1 576 1460 664 970 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur | ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 780 870 2040 | 15 0 46 <1 520 1515 724 888 2515 | 26 0 42 <1 491 1465 687 728 2124 | 4 0 53 <1 576 1460 664 970 2229 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN | ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 50 5 50 0 560 1510 780 870 2040 | 15 0 46 <1 520 1515 724 888 2515 current | 26 0 42 <1 491 1465 687 728 2124 history1 | 4 0 53 <1 576 1460 664 970 2229 history2 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m method | 50 5 50 0 560 1510 780 870 2040 | 15 0 46 <1 520 1515 724 888 2515 current 6 | 26 0 42 <1 491 1465 687 728 2124 history1 5 | 4 0 53 <1 576 1460 664 970 2229 history2 11 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m | 50 50 0 560 1510 780 870 2040 limit/base >+100 | 15 0 46 <1 520 1515 724 888 2515 current 6 4 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m | 50 50 0 560 1510 780 870 2040 limit/base >+100 | 15 0 46 <1 520 1515 724 888 2515 current 6 4 0 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 0 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 2 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED | ppm ppm ppm ppm ppm ppm ppm TS ppm ppm ppm | ASTM D5185m ASTM D5185m | 50 50 0 560 1510 780 870 2040 limit/base >+100 | 15 0 46 <1 520 1515 724 888 2515 current 6 4 0 0 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 0 0 history1 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 2 2 history2 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m | 50 50 0 560 1510 780 870 2040 Iimit/base >+100 >20 | 15 0 46 <1 520 1515 724 888 2515 current 6 4 0 current 0 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 0 0 history1 0.1 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 2 2 history2 0 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m | 50 50 0 560 1510 780 870 2040 <i>limit/base</i> >+100 20 <i>limit/base</i> | 15 0 46 <1 520 1515 724 888 2515 <i>current</i> 6 4 0 <i>current</i> 0 10.1 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 0 0 history1 0.1 8.3 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 2 history2 0 history2 0 |
| Boron Barium Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m | 50 50 560 1510 780 870 2040 Iinit/base >20 Iinit/base >20 Iinit/base | 15 0 46 <1 520 1515 724 888 2515 current 6 4 0 current 0 10.1 19.9 | 26 0 42 <1 491 1465 687 728 2124 history1 5 6 0 0 history1 0.1 8.3 19.8 | 4 0 53 <1 576 1460 664 970 2229 history2 11 0 2 history2 0 11.9 24.4 |




OIL ANALYSIS REPORT

Ferrous Alloys





| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|-----------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPE | RTIES | method | limit/base | current | history1 | history2 |
| Visc @ 100°C | cSt | ASTM D445 | 15.1 | 14.1 | 14.3 | 13.4 |
| GRAPHS | | | | | | |

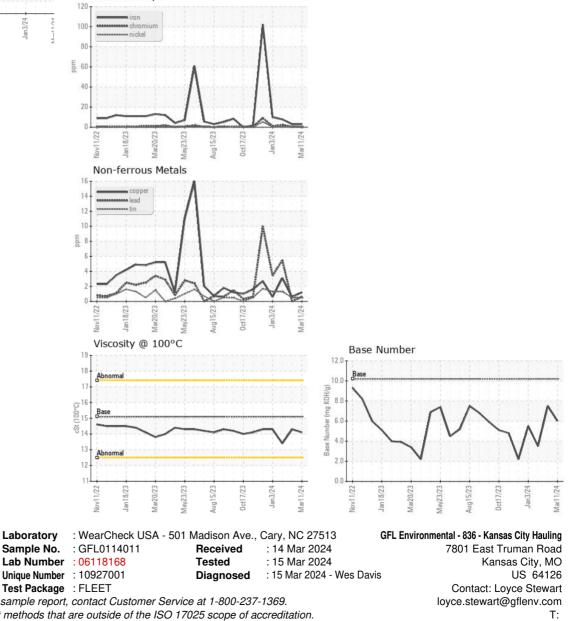



To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Certificate L2367

F: