

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL





		il2019 Mar2	020 Nov2020 Aug202	1 Dec2021 May2022 Mar202	3 Dec2023		
	SAMPLE INFORMA	TION	method	limit/base	current	history1	history2
	Sample Number		Client Info		GFL0094656	GFL0103242	GFL0103207
service interval to monitor.	Sample Date		Client Info		12 Mar 2024	28 Dec 2023	20 Dec 2023
	Machine Age h	rs	Client Info		13601	13024	12949
ates are normal.	Oil Age h	rs	Client Info		577	1129	1054
	Oil Changed		Client Info		Changed	Changed	Not Changd
f any contamination in the	Sample Status				NORMAL	NORMAL	NORMAL
	CONTAMINATIO	N	method	limit/base	current	history1	history2
s that there is suitable the oil. The condition of the er service.	Fuel		WC Method	>3.0	<1.0	<1.0	<1.0
	Water		WC Method	>0.2	NEG	NEG	NEG
	Glycol		WC Method		NEG	NEG	NEG
	WEAR METALS		method	limit/base	current	history1	history2
	lron p	pm	ASTM D5185m	>165	11	15	15
			ASTM D5185m	>5	1	1	1
		pm	ASTM D5185m		0	0	0
			ASTM D5185m	>2	<1	<1	0
		pm	ASTM D5185m		<1	0	0
			ASTM D5185m	>20	2	1	2
		pm	ASTM D5185m		3	2	<1
			ASTM D5185m	>90	2	<1	<1
		pm	ASTM D5185m		1	<1	<1
			ASTM D5185m		<1	0	<1
		pm	ASTM D5185m		<1	0	<1
	ADDITIVES		method	limit/base	current	history1	history2
	Boron p	pm	ASTM D5185m	0	2	3	1
	Barium p	pm	ASTM D5185m	0	0	0	0
	Molybdenum p	pm	ASTM D5185m	60	57	62	63
	Manganese p	pm	ASTM D5185m	0	<1	<1	<1
	Magnesium p	pm	ASTM D5185m	1010	984	1021	1016
	Calcium p	pm	ASTM D5185m	1070	1152	1147	1136
	Phosphorus p	pm	ASTM D5185m	1150	1066	1009	1115
	Zinc p	pm	ASTM D5185m	1270	1312	1361	1339
		pm	ASTM D5185m	2060	3734	3045	3267
	CONTAMINANTS	5	method	limit/base	current	history1	history2
	Silicon p	pm	ASTM D5185m	>35	4	7	7
	Sodium p	pm	ASTM D5185m		4	5	5
	Potassium p	pm	ASTM D5185m	>20	2	1	1
	p otdoordin p						
	INFRA-RED		method	limit/base	current	history1	history2
		6	method *ASTM D7844		current 0.4	history1 0.4	history2 0.3
	INFRA-RED Soot % %			>7.5			
	INFRA-REDSoot %%NitrationA	lbs/cm	*ASTM D7844	>7.5 >20	0.4	0.4	0.3
	INFRA-REDSoot %%NitrationA	.bs/cm bs/.1mm	*ASTM D7844 *ASTM D7624 *ASTM D7415	>7.5 >20	0.4 8.6 20.2	0.4 9.2	0.3 8.9
	INFRA-RED Soot % % Nitration A Sulfation A FLUID DEGRADA	.bs/cm bs/.1mm TION	*ASTM D7844 *ASTM D7624 *ASTM D7415	>7.5 >20 >30 limit/base	0.4 8.6 20.2	0.4 9.2 20.4	0.3 8.9 20.1

Diesel Engine Fluic

PETRO CANADA DURON SHP 15W40 (48 QTS)

DIAGNOSIS

Recommendation

Resample at the nex

Wear

All component wear

Contamination


There is no indication oil.


Fluid Condition

The BN result indicat alkalinity remaining ir oil is suitable for furth




OIL ANALYSIS REPORT





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPE	RTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.4	13.4	13.3	13.3
GRAPHS						

Ferrous Alloys

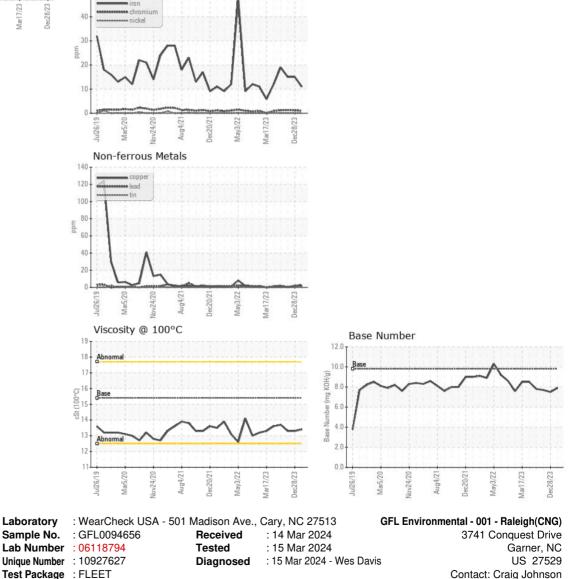

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

craig.johnson@gflenv.com

T: (919)662-7100

F: (919)662-7130