

OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area
Phase 3 HTS
Machine Id
HT 51
Component
Agitator Gearbox
Fluid
SCHAEFFER 220 (--- LTR)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PCA0111032	USP0000224	---
Sample Date	Client Info			09 Mar 2024	31 Aug 2023	---
Machine Age	yrs	Client Info		0	0	---
Oil Age	yrs	Client Info		0	0	---
Oil Changed	Client Info			Not Changed	N/A	---
Sample Status				ABNORMAL	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>150	51	53	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>10	0	0	---
Titanium	ppm	ASTM D5185m		0	<1	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	<1	1	---
Lead	ppm	ASTM D5185m	>100	0	0	---
Copper	ppm	ASTM D5185m	>50	29	23	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		129	167	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		42	46	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m		<1	0	---
Calcium	ppm	ASTM D5185m		359	406	---
Phosphorus	ppm	ASTM D5185m		777	871	---
Zinc	ppm	ASTM D5185m		115	130	---
Sulfur	ppm	ASTM D5185m		18433	21842	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	15	16	---
Sodium	ppm	ASTM D5185m		9	6	---
Potassium	ppm	ASTM D5185m	>20	48	51	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	▲ 227535	▲ 296909	---
Particles >6µm		ASTM D7647	>5000	▲ 72487	▲ 108382	---
Particles >14µm		ASTM D7647	>640	135	79	---
Particles >21µm		ASTM D7647	>160	26	21	---
Particles >38µm		ASTM D7647	>40	1	1	---
Particles >71µm		ASTM D7647	>10	0	0	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	▲ 25/23/14	▲ 25/24/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.82	0.80	---


OIL ANALYSIS REPORT

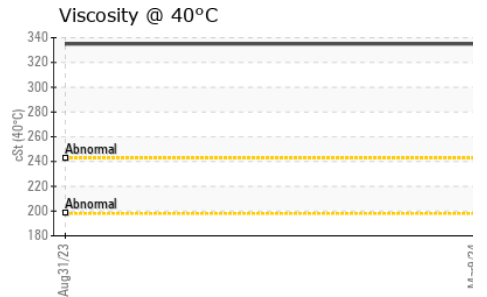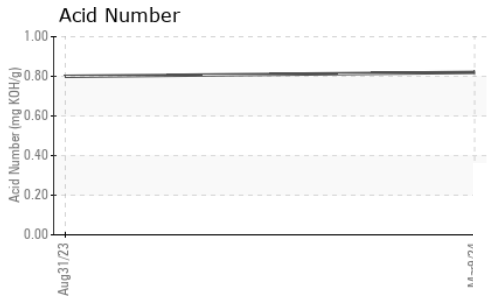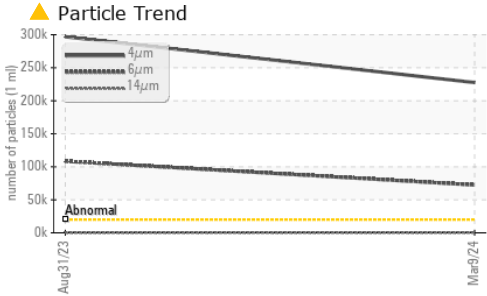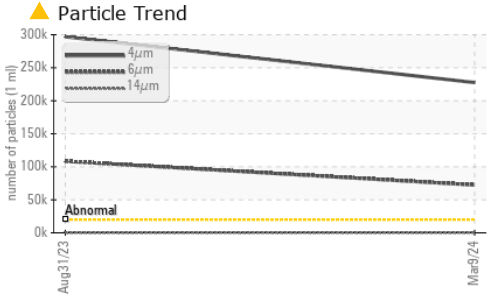






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	335	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

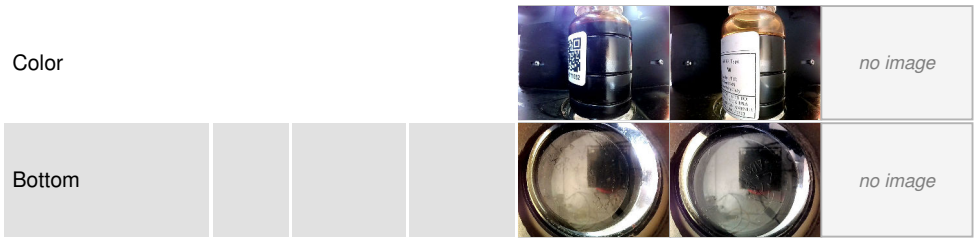

GRAPHS

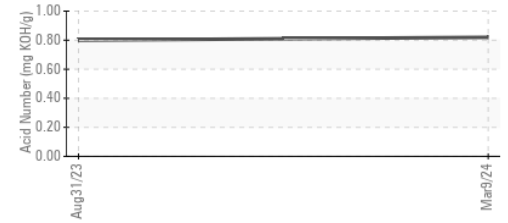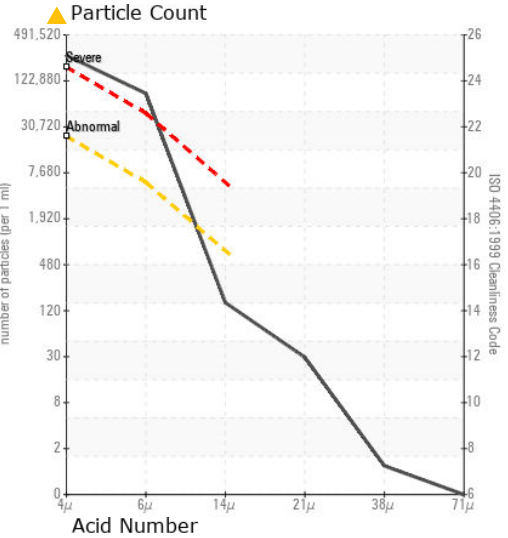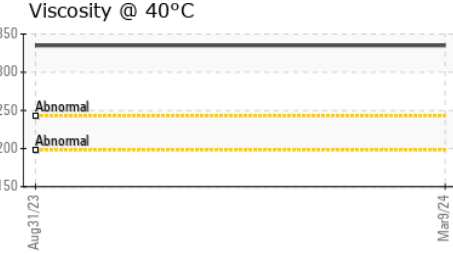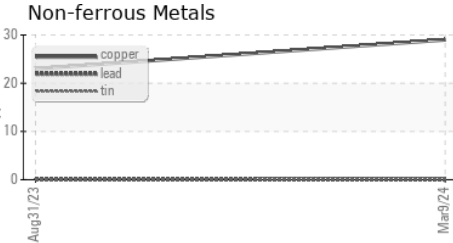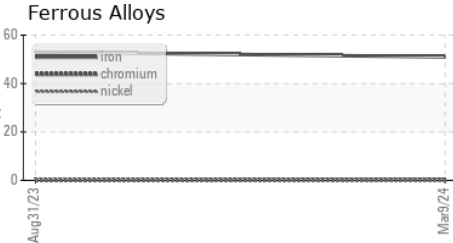

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PCA0111032 **Received** : 15 Mar 2024
Lab Number : 06119543 **Tested** : 18 Mar 2024
Unique Number : 10928376 **Diagnosed** : 20 Mar 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: PrtCount)

KraftHeinz - Mason City - Plant 8360
 1022 12TH ST
 MASON CITY, IA
 US 50401
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (641)421-2936