




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

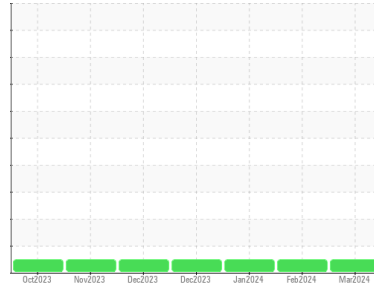

Machine Id  
**834050**  
 Component  
**Natural Gas Engine**  
 Fluid  
**PETRO CANADA DURON GEO LD 15W40 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0114126</b>	GFL0102413	GFL0108155
Sample Date	Client Info		<b>07 Mar 2024</b>	07 Feb 2024	15 Jan 2024
Machine Age	hrs	Client Info	<b>1063</b>	868	737
Oil Age	hrs	Client Info	<b>1063</b>	737	0
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>53</b>	65	56
Chromium	ppm	ASTM D5185m	>5	<b>&lt;1</b>	1	1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	1	2
Titanium	ppm	ASTM D5185m	>5	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>3	<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185m	>25	<b>3</b>	4	4
Lead	ppm	ASTM D5185m	>40	<b>&lt;1</b>	2	2
Copper	ppm	ASTM D5185m	>150	<b>14</b>	16	16
Tin	ppm	ASTM D5185m	>4	<b>2</b>	3	2
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	50	<b>12</b>	8	17
Barium	ppm	ASTM D5185m	5	<b>2</b>	3	0
Molybdenum	ppm	ASTM D5185m	50	<b>59</b>	64	62
Manganese	ppm	ASTM D5185m	0	<b>8</b>	10	9
Magnesium	ppm	ASTM D5185m	560	<b>667</b>	777	706
Calcium	ppm	ASTM D5185m	1510	<b>1133</b>	1042	1023
Phosphorus	ppm	ASTM D5185m	780	<b>690</b>	731	672
Zinc	ppm	ASTM D5185m	870	<b>871</b>	919	878
Sulfur	ppm	ASTM D5185m	2040	<b>2172</b>	2340	2387

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>20</b>	27	28
Sodium	ppm	ASTM D5185m		<b>4</b>	4	9
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	3

## INFRA-RED



	method	limit/base	current	history1	history2	
Soot %	%	*ASTM D7844		<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>11.7</b>	11.6	11.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>23.9</b>	24.5	23.3

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>21.9</b>	22.7	21.4
Base Number (BN)	mg KOH/g	ASTM D2896	10.2	<b>3.7</b>	3.0	3.2







# OIL ANALYSIS REPORT

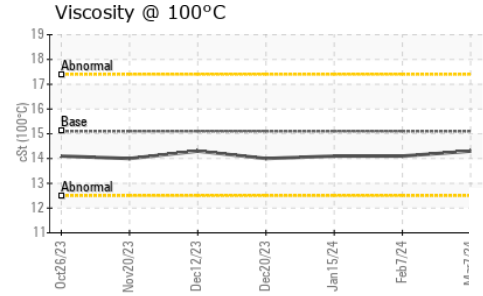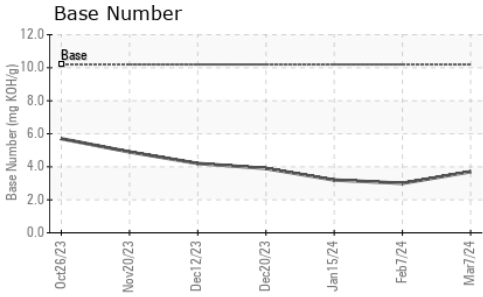

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.1	<b>14.3</b>	14.1	14.1

## GRAPHS

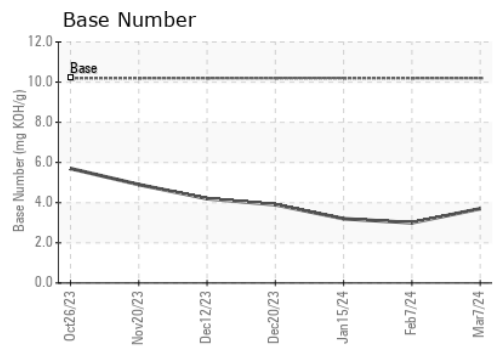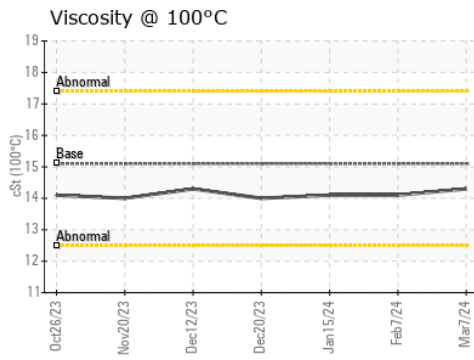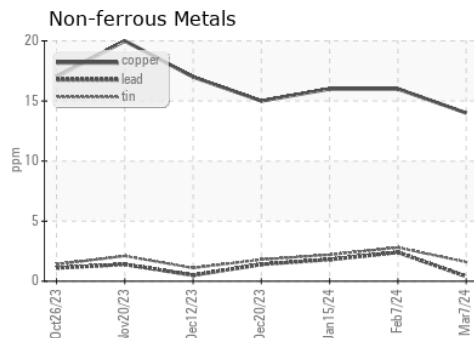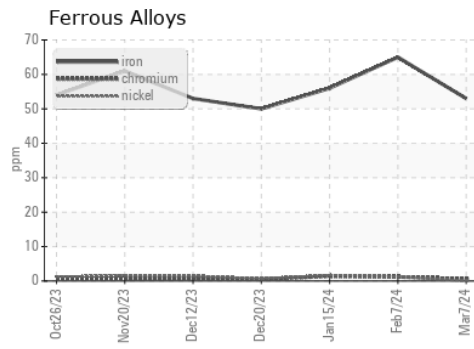

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0114126      **Received** : 15 Mar 2024  
**Lab Number** : **06120118**      **Tested** : 18 Mar 2024  
**Unique Number** : 10928951      **Diagnosed** : 19 Mar 2024 - Don Baldrige  
**Test Package** : FLEET

**GFL Environmental - 837 - Harrison TS**  
 22820 S State Route 291  
 Harrisonville, MO  
 US 64701  
 Contact: JOHNNY PEREZ  
 johnny.perez@gflenv.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)