



# OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id  
**933028**

Component  
**Natural Gas Engine**

Fluid  
**PETRO CANADA DURON SHP 15W40 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material.

### ● Fluid Condition

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil. Confirm oil type.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>GFL0113985</b>	---	---
Sample Date	Client Info	<b>11 Mar 2024</b>	---	---
Machine Age	hrs	Client Info	<b>1205</b>	---
Oil Age	hrs	Client Info	<b>1205</b>	---
Oil Changed	Client Info	<b>Changed</b>	---	---
Sample Status		<b>ABNORMAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	---

## WEAR METALS

method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	<b>46</b>	---	---
Chromium	ppm	ASTM D5185m	>4	<b>2</b>	---	---
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>9	<b>5</b>	---	---
Lead	ppm	ASTM D5185m	>30	<b>7</b>	---	---
Copper	ppm	ASTM D5185m	>35	<b>16</b>	---	---
Tin	ppm	ASTM D5185m	>4	<b>3</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m	0	<b>7</b>	---	---
Barium	ppm	ASTM D5185m	0	<b>4</b>	---	---
Molybdenum	ppm	ASTM D5185m	60	<b>57</b>	---	---
Manganese	ppm	ASTM D5185m	0	<b>4</b>	---	---
Magnesium	ppm	ASTM D5185m	1010	<b>816</b>	---	---
Calcium	ppm	ASTM D5185m	1070	<b>1277</b>	---	---
Phosphorus	ppm	ASTM D5185m	1150	<b>724</b>	---	---
Zinc	ppm	ASTM D5185m	1270	<b>969</b>	---	---
Sulfur	ppm	ASTM D5185m	2060	<b>2665</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>+100	<b>▲ 91</b>	---	---
Sodium	ppm	ASTM D5185m		<b>5</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>14</b>	---	---

## INFRA-RED




method	limit/base	current	history1	history2		
Soot %	%	*ASTM D7844		<b>0</b>	---	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>12.3</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>26.3</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2		
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>22.2</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	9.8	<b>3.0</b>	---	---







# OIL ANALYSIS REPORT

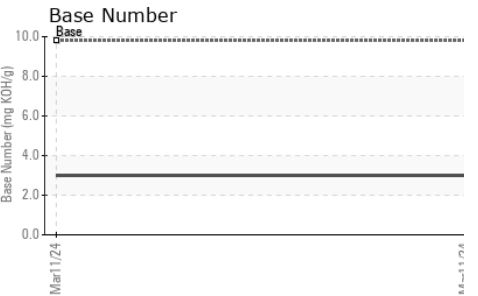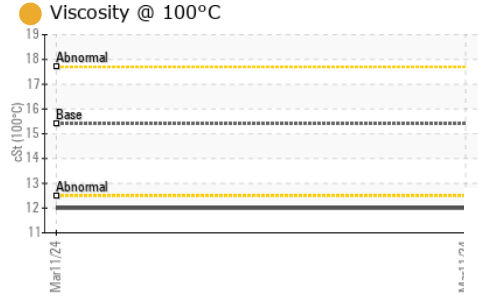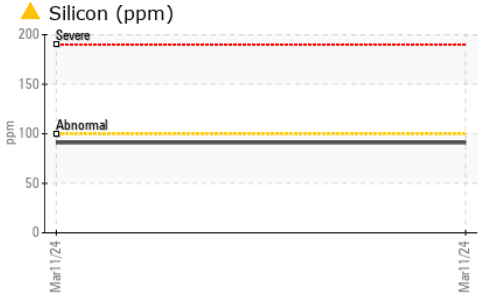

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 100°C	cSt	ASTM D445	15.4	● 12.0	---	---

## GRAPHS

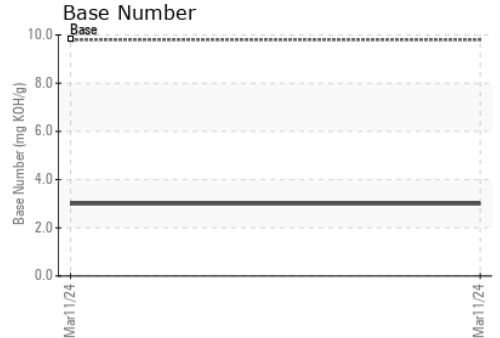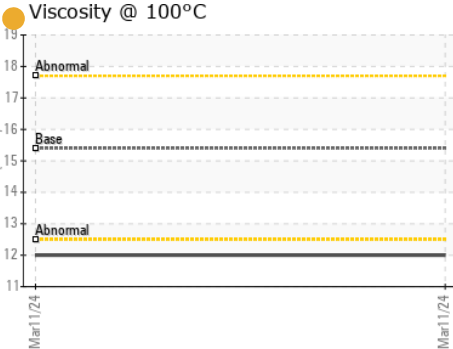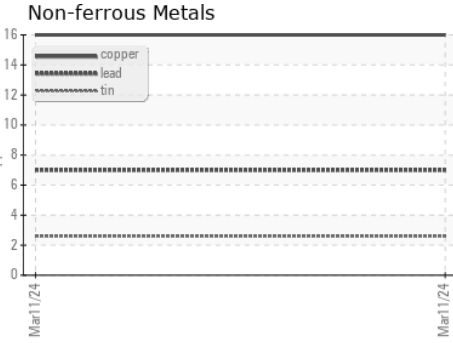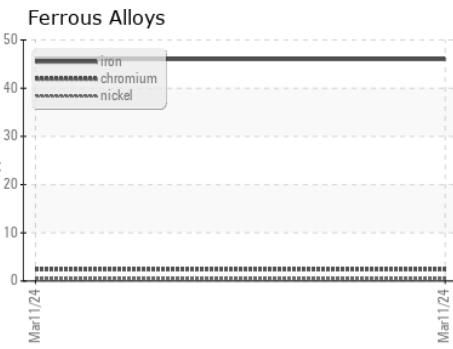

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : GFL0113985  
**Lab Number** : 06122209  
**Unique Number** : 10936360  
**Test Package** : FLEET

**Received** : 19 Mar 2024  
**Tested** : 20 Mar 2024  
**Diagnosed** : 21 Mar 2024 - Don Baldrige

**GFL Environmental - 932 - Muskego HC**  
 W144 S6400 College Ct.  
 Muskego, WI  
 US 53150

Contact: Brian Schломann  
 brian.schlomann@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (262)510-4586

F: