

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 914031

Component Diesel Engine Fluid DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| | | 0x2023 0x2023 Nov2023 Dex2023 Jan2024 Feb2024 Mar2024 | | | | | | | | |
|--|--|---|--|--|--|---|--|--|--|--|
| SAMPLE INFOR | MATION | method | limit/base | current | history1 | history2 | | | | |
| Sample Number | | Client Info | | GFL0115359 | GFL0110889 | GFL0110918 | | | | |
| Sample Date | | Client Info | | 12 Mar 2024 | 20 Feb 2024 | 01 Feb 2024 | | | | |
| Machine Age | hrs | Client Info | | 1327 | 1180 | 1035 | | | | |
| Oil Age | hrs | Client Info | | 147 | 145 | 152 | | | | |
| Oil Changed | | Client Info | | Changed | Changed | Changed | | | | |
| Sample Status | | | | NORMAL | NORMAL | NORMAL | | | | |
| CONTAMINAT | ION | method | limit/base | current | history1 | history2 | | | | |
| Fuel | | WC Method | >5 | <1.0 | <1.0 | <1.0 | | | | |
| Water | | WC Method | >0.2 | NEG | NEG | NEG | | | | |
| Glycol | | WC Method | | NEG | NEG | NEG | | | | |
| WEAR METAL | S | method | limit/base | current | history1 | history2 | | | | |
| Iron | ppm | ASTM D5185m | >100 | 29 | 22 | 16 | | | | |
| Chromium | ppm | ASTM D5185m | >20 | <1 | <1 | <1 | | | | |
| Nickel | ppm | ASTM D5185m | >4 | 4 | 3 | 3 | | | | |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | <1 | | | | |
| Silver | ppm | ASTM D5185m | >3 | 0 | 1 | 1 | | | | |
| Aluminum | ppm | ASTM D5185m | >20 | 1 | 1 | 1 | | | | |
| Lead | ppm | ASTM D5185m | >40 | 1 | 0 | <1 | | | | |
| Copper | ppm | ASTM D5185m | >330 | 151 | 179 | 81 | | | | |
| Tin | ppm | ASTM D5185m | >15 | 0 | <1 | 1 | | | | |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | <1 | | | | |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | <1 | | | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 | | | | |
| Boron | ppm | ASTM D5185m | 250 | 7 | 11 | 10 | | | | |
| | pp | | | | | | | | | |
| Barium | ppm | ASTM D5185m | 10 | 0 | 0 | 0 | | | | |
| Barium Molybdenum | | ASTM D5185m ASTM D5185m | 10 100 | 0 61 | 0 61 | 0 58 | | | | |
| | ppm | | | - | | ÷ | | | | |
| Molybdenum | ppm ppm | ASTM D5185m | | 61 | 61 | 58 | | | | |
| Molybdenum Manganese | ppm ppm ppm | ASTM D5185m ASTM D5185m | 100 | 61 <1 | 61 1 | 58 1 | | | | |
| Molybdenum Manganese Magnesium | ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 | 61 <1 924 | 61 1 916 | 58 1 871 | | | | |
| Molybdenum Manganese Magnesium Calcium | ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 | 61 <1 924 1081 | 61 1 916 1024 | 58 1 871 1048 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus | ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 1150 | 61 <1 924 1081 951 | 61 1 916 1024 983 | 58 1 871 1048 1099 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc | ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 | 61 <1 924 1081 951 1111 | 61 1 916 1024 983 1198 | 58 1 871 1048 1099 1091 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur | ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 | 61 <1 924 1081 951 1111 2785 | 61 1 916 1024 983 1198 2527 | 58 1 871 1048 1099 1091 3171 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN | ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base | 61 <1 924 1081 951 1111 2785 current | 61 1 916 1024 983 1198 2527 history1 | 58 1 871 1048 1099 1091 3171 history2 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m Method ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base >25 | 61 <1 924 1081 951 1111 2785 current 8 | 61 1 916 1024 983 1198 2527 history1 8 | 58 1 871 1048 1099 1091 3171 history2 8 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m method ASTM D5185m | 100 450 3000 1150 1350 4250 imit/base >25 >216 | 61 <1 924 1081 951 1111 2785 current 8 4 | 61 1 916 1024 983 1198 2527 history1 8 3 | 58 1 871 1048 1099 1091 3171 history2 8 2 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base >25 >216 >20 | 61 <1 924 1081 951 1111 2785 current 8 4 1 | 61 1 916 1024 983 1198 2527 history1 8 3 1 | 58 1 871 1048 1099 1091 3171 history2 8 2 2 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base >25 >216 >20 limit/base | 61 <1 924 1081 951 1111 2785 current 8 4 1 1 current | 61 1 916 1024 983 1198 2527 history1 8 3 1 history1 | 58 1 871 1048 1099 1091 3171 history2 8 2 2 kistory2 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % | ppm ppm ppm ppm ppm ppm ppm ppm TS | ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base >25 >216 >20 limit/base >3 | 61 <1 924 1081 951 1111 2785 current 8 4 1 2 current 0.4 | 61 1 916 1024 983 1198 2527 history1 8 3 1 1 history1 0.4 | 58 1 871 1048 1099 1091 3171 history2 8 2 2 history2 0.3 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 limit/base >25 >216 >20 limit/base >3 >20 | 61 <1 924 1081 951 1111 2785 current 8 4 1 1 current 0.4 9.1 | 61 1 916 1024 983 1198 2527 history1 8 3 1 history1 0.4 8.7 | 58 1 871 1048 1099 1091 3171 history2 8 2 2 history2 0.3 7.9 | | | | |
| Molybdenum Manganese Magnesium Calcium Phosphorus Zinc Sulfur CONTAMINAN Silicon Sodium Potassium INFRA-RED Soot % Nitration Sulfation | ppm ppm ppm ppm ppm ppm ppm ppm ppm ppm | ASTM D5185m ASTM D5185m | 100 450 3000 1150 1350 4250 Iimit/base >25 >216 >20 Iimit/base >3 >20 >30 | 61 <1 924 1081 951 1111 2785 current 8 4 1 1 current 0.4 9.1 20.5 | 61 1 916 1024 983 1198 2527 history1 8 3 1 history1 0.4 8.7 20.1 | 58 1 871 1048 1099 1091 3171 history2 8 2 2 history2 0.3 7.9 19.9 | | | | |




OIL ANALYSIS REPORT





| VISUAL | | method | | | | history2 |
|------------------|--------|-----------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG | NEG |
| FLUID PROPE | RTIES | method | limit/base | current | history1 | history2 |
| Visc @ 100°C | cSt | ASTM D445 | 14.4 | 13.3 | 13.3 | 13.3 |
| GRAPHS | | | | | | |

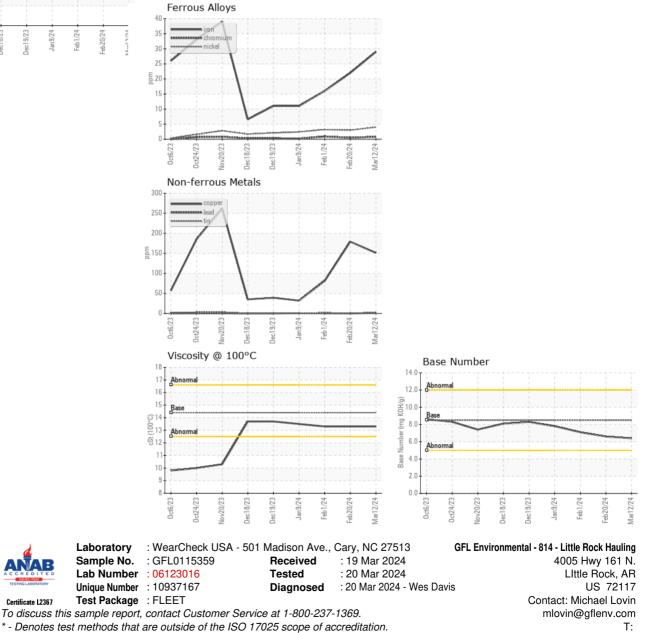

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

F: